



U.S. Department Of Energy

San Francisco Operations Office, Oakland, California 94612

Lawrence Livermore National Laboratory
University of California Livermore, California 94551



UCRL-AR-116583

Remedial Design Report No. 5
for Treatment Facilities G-1 and G-2
Lawrence Livermore National Laboratory
Livermore Site

May 1, 1995

Technical Editors

L. L. Berg*
M. D. Dresen*
R. W. Bainer
E. N. Folsom

Contributors

S. M. Bahowick	J. K. Macdonald*
L. L. Berg*	P. F. McKereghan*
R. G. Blake	C. M. Noyes*
M. D. Dresen*	C. N. Okano*
S. E. Hassan	M. N. Ridley
L. S. Kita	H. M. Walker*

*Weiss Associates, Emeryville, California



Environmental Protection Department
Environmental Restoration Division

UCRL-AR-116583

**Remedial Design Report No. 5
for Treatment Facilities G-1 and G-2
Lawrence Livermore National Laboratory
Livermore Site**

May 1, 1995

Technical Editors

**L. L. Berg*
M. D. Dresen*
R. W. Bainer
E. N. Folsom**

Contributors

S. M. Bahowick	J. K. Macdonald*
L. L. Berg*	P. F. McKereghan*
R. G. Blake	C. M. Noyes*
M. D. Dresen*	C. N. Okano*
S. E. Hassan	M. N. Ridley
L. S. Kita	H. M. Walker*

***Weiss Associates, Emeryville, California**

Contents

Summary	vii
1. Introduction	1
2. Wellfield Design	5
2.1. Hydrostratigraphic Analysis and VOC Distribution	5
2.1.1. Basis for Defining Hydrostratigraphic Units	5
2.1.2. Hydrostratigraphic Units in the TFG-1 and TFG-2 Areas	7
2.1.3. VOC Distribution	11
2.2. Extraction Wells and Piezometers	12
2.2.1. Extraction Well Location and Design	12
2.2.2. Piezometer Location and Design	16
3. Remedial Design	16
3.1. Specifications, Design, Treatability Tests, Controls, and Safeguards	18
3.1.1. Specifications and Design	18
3.1.2. Treatability Tests	22
3.1.3. Controls and Safeguards	23
3.2. Discharge of Treated Ground Water	26
3.3. Construction and Startup Schedules and Cost Estimates	26
3.3.1. Schedules	26
3.3.2. Cost Estimates	27
4. Remedial Action Workplan	27
4.1. Quality Assurance/Quality Control and Health and Safety Plans	27
4.2. Monitoring and Reporting	27
4.2.1. Treatment Facility Self-Monitoring Programs	29
4.2.2. Ground Water Monitoring Sampling Schedule	34
4.2.3. Extraction Well Pumping Strategy	34
4.3. Requirements for Onsite Storage and Offsite Shipment of Hazardous Waste	36
4.4. Requirements for Closeout	39
5. References	40
5.1. References Cited	40

5.2. References for LLNL Facilities Standards, Specifications, and Guide Documents	41
5.2.1. General	41
5.2.2. Regulations.....	42
5.2.3. Codes.....	42
5.2.4. Standards	43
5.2.5. LLNL Manuals and Reports	43
6. Acronyms and Abbreviations.....	44
7. Acknowledgments.....	46
Appendix A–Soil and Ground Water Analytical Results	A-1
Appendix B–Waste Discharge Requirement Order Nos. 91-091 and 88-075	B-1
Appendix C–Operations and Maintenance Quality Assurance/Quality Control Plan	C-1
Appendix D–Operations and Maintenance Health and Safety Plan	D-1
Appendix E–TFG-1 and TFG-2 Sampling Procedures	E-1

List of Figures

Figure 1. Location of the LLNL Livermore Site	2
Figure 2. Planned ground water and soil vapor extraction locations at the LLNL Livermore Site (modified from the RAIP).....	3
Figure 3. Monitor well, extraction well, piezometer, and borehole locations in the TFG Area	4
Figure 4. Proposed TFG Area remedial wellfield design.....	6
Figure 5. Hydrogeochemical and geophysical cross section A-A´ and proposed remedial wellfield design in the TFG-1 and TFG-2 Areas	8
Figure 6. Hydrogeochemical and geophysical cross section B-B´ and proposed remedial wellfield design in the TFG-1 Area	9
Figure 7. Estimated hydraulic capture zones and recharge well locations	13
Figure 8. TFG-1 and TFG-2 airflow design graph using ground water from MW-464.....	24
Figure 9. General skid-mounted facility airflow design graph using ground water from MW-361	25
Figure 10. Schematic diagram of TFG-1 and TFG-2 NPDES self-monitoring program sampling stations	30
Figure 11. Locations of Recharge Basin self-monitoring program sampling stations	33

Figure 12. Cumulative volume of VOCs that may be removed from ground water by TFG-1 over time.....37

Figure 13. Cumulative volume of VOCs that may be removed from ground water by TFG-2 over time.....38

List of Plates

Plate 1. TFG-1 and TFG-2 Location PlansPocket in back cover

Plate 2. TFG-1 and TFG-2 Piping and Instrument DiagramPocket in back cover

List of Tables

Table 1. TFG-1 and TFG-2 extraction well specifications14

Table 2. TFG-1 and TFG-2 piezometer specifications17

Table 3. TFG-1 and TFG-2 design influent concentrations (as of April 1994)19

Table 4. TFG-1 and TFG-2 inorganic ground water chemistry influent concentrations since 198819

Table 5. TFG-1 and TFG-2 equipment specifications20

Table 6. Air stripper treatability test results for MW-46422

Table 7. Air stripper treatability test results for MW-36122

Table 8. TFG-1 design and construction schedule26

Table 9. TFG-2 design and construction schedule27

Table 10. TFG-1 and TFG-2 cost summary28

Table 11. WDR Order No. 91-091 self-monitoring sampling schedule31

Table 12. WDR Order No. 88-075 self-monitoring sampling schedule32

Table 13. Ground water sampling schedule for monitor wells and piezometers in the vicinity of TFG-1 and TFG-2 extraction wells35

Summary

This is the fifth of six Remedial Design reports that describe plans for implementing ground water and soil cleanup at the Lawrence Livermore National Laboratory (LLNL) Livermore Site. The cleanup has been divided into 9 geographic areas with 11 treatment facilities that are addressed by the Remedial Design reports. The U.S. Department of Energy (DOE) and LLNL are preparing these reports over a 5-year period. The sixth report, for the Building 518 Area in the southeastern portion of the Livermore Site, was added in December 1993 in consultation with the regulatory agencies. The cleanup plans described in each report are designed to optimize the overall site cleanup and be consistent with projected funding levels. The overall cleanup approach for the LLNL Livermore Site is defined in the Remedial Action Implementation Plan (Dresen *et al.*, 1993), which can be found in the Information Repositories located at the LLNL Visitors Center and at the Livermore Public Library.

This Remedial Design report is for Treatment Facilities G-1 and G-2 in the south-central portion of the Livermore Site, referred to as the Treatment Facility G Area. The primary soil and ground water contaminants in the Treatment Facility G Area are the volatile organic compounds trichloroethylene, perchloroethylene, chloroform, 1,1-dichloroethylene, carbon tetrachloride, 1,2-dichloroethylene, 1,1,1-trichloroethane, and trichlorotrifluoroethane.

The planned ground water extraction wellfields for Treatment Facilities G-1 and G-2 were developed using hydrogeologic and volatile organic compound data. Six hydrostratigraphic units have been identified in the Treatment Facility G Area, although volatile organic compounds are restricted to only two of these units. A hydrostratigraphic unit consists of sediments correlated on the basis of hydraulic properties.

Five extraction wells and 16 piezometers are planned in the Treatment Facility G Area. The extraction wells will be used to pump ground water to the treatment facilities, and piezometers will be used to measure well communication at various depths and distances from the extraction wells. Monitoring the water levels in piezometers provides information about the size of the area being affected by the ground water extraction. One of the extraction wells has been installed, and the remaining four wells are planned for phased installation in the future. This phased approach will help determine the actual versus the estimated effectiveness of the initial planned extraction wells and treatment systems before proceeding with subsequent phases.

Treatment Facilities G-1 and G-2 are identical skid-mounted facilities that can be moved to different well locations, as needed. Although Treatment Facilities G-1 and G-2 are expected to remain at their proposed locations for the duration of the cleanup, they are prototypes for additional portable less costly facilities that may be used throughout the Livermore Site. Both treatment facilities will consist of air strippers and, if necessary, an ion-exchange or chromium reduction unit for metals treatment. Ground water will be pumped from the extraction wells to the air stripper. As the water passes through the air

stripper, a blower will aerate the water and strip the volatile organic compounds from it. The volatile organic compounds will be collected by filtering the air through granular activated carbon. The air stripper will remove all of the above-described compounds from the ground water except for metals including chromium, which will be removed by an ion-exchange unit or a hexavalent chromium reduction unit to reduce it to the trivalent state, if necessary.

Treatment Facilities G-1 and G-2 are designed to remediate up to 30 gallons per minute of ground water. Three ground water extraction wells are planned to supply water to Treatment Facility G-1, and two ground water extraction wells are planned for Treatment Facility G-2. As discussed in the Record of Decision and the Remedial Action Implementation Plan, the extraction wells will be installed at locations to remove the highest volatile organic compound concentrations and to achieve hydraulic control of the southern edge of the volatile organic compound plume. Treated ground water from these facilities will be discharged to the nearest storm drain. Alternatively, the discharge may be sent to the Recharge Basin under an existing permit, if approved by the California Regional Water Quality Control Board. Any contaminants that remain in the treated water will be at or below the limits set by the California Regional Water Quality Control Board, as specified in Waste Discharge Requirement Order No. 91-091 for the storm sewer, or Waste Discharge Requirement Order No. 88-075 for the Recharge Basin.

Treatment Facility G-1 is scheduled to become operational in April 1996, and startup of Treatment Facility G-2 is scheduled for August 1999. The estimated total design and construction costs for both facilities are about \$1,560,000.

To monitor the progress of the cleanup and determine the size and shape of the area being affected by the extraction wells, DOE/LLNL will sample for volatile organic compounds and metals, including chromium, and monitor water levels in the wells and piezometers within the Treatment Facility G Area. Results of all treatment system, extraction well, and piezometer monitoring will be included in the LLNL Monthly, and/or Annual Reports as currently required by the regulatory agencies.

DOE/LLNL will manage the extraction wellfield by varying the rates and locations of ground water extraction. The goal is to maximize the rate of volatile organic compound mass removal, and ensure remediation of all portions of the plume that exceed drinking water standards. In addition, DOE/LLNL are evaluating reinjection of the treated water to accelerate the cleanup.


1. Introduction

This report is the fifth of six Remedial Design (RD) reports for the Lawrence Livermore National Laboratory (LLNL) Livermore Site, which is located about 40 miles east of San Francisco, California (Fig. 1). The sixth report, for the Building 518 Area in the southeastern portion of the Livermore Site, was added in December 1993 during consultation with the regulatory agencies. This RD report is for Treatment Facilities G-1 and G-2 (TFG-1 and TFG-2). TFG-1 and TFG-2 will be located in the south-central portion of the Livermore Site, referred to as the Treatment Facility G (TFG) Area (Figs. 2 and 3). As stated in the Remedial Action Implementation Plan (RAIP) (Dresen *et al.*, 1993), extraction locations 15 and 16 (Fig. 2) will be used to extract ground water in the TFG Area. The TFG Area is primarily located in a high-security area of LLNL that is extensively developed with buildings and underground utilities. Thus, for logistical and practical purposes, ground water will initially be treated at two, separate skid-mounted treatment facilities with shorter pipelines to the extraction wells rather than at a single larger facility with longer pipelines. Ground water extracted from location 15 will be treated at TFG-2, and ground water extracted from location 16 will be treated at TFG-1 (Fig. 2).

The six RD reports are being prepared over a 5-year period in accordance with a revised schedule in the RAIP (Dresen *et al.*, 1993). As described in the RAIP, the remedial actions presented in the Record of Decision (ROD) for the Livermore Site (DOE, 1992) will be phased-in to enable determination of the actual versus predicted effectiveness of the planned extraction and treatment systems prior to proceeding with subsequent phases and to be consistent with projected funding levels.


The Livermore Site was placed on the U.S. Environmental Protection Agency's (EPA's) National Priorities List in 1987. In November 1988, the U.S. Department of Energy (DOE), EPA, the California Department of Toxic Substances Control (DTSC), and the California Regional Water Quality Control Board (RWQCB) signed a Federal Facility Agreement (FFA) to facilitate compliance with the Comprehensive Environmental Response, Compensation, and Liability Act of 1980 (CERCLA), as amended. As part of the CERCLA process, the LLNL Environmental Restoration Division (ERD) has prepared a series of documents: the Remedial Investigation (RI) (Thorpe *et al.*, 1990) characterized the site hydrogeology and contaminant distribution; the Feasibility Study (FS) (Isherwood *et al.*, 1990) screened and evaluated possible remedial alternatives; the Proposed Remedial Action Plan (Dresen *et al.*, 1991) further evaluated conceptual remedial alternatives and recommended particular alternatives for ground water and soil cleanup; the ROD (DOE, 1992) codified and bound DOE and EPA to a cleanup approach for ground water and soil; and the RAIP (Dresen *et al.*, 1993) presented the cleanup approach and a schedule for the remaining remedial actions.

As discussed in the ROD, the contaminants of concern at the Livermore Site are volatile organic compounds (VOCs), primarily trichloroethylene (TCE) and perchloroethylene (PCE); fuel hydrocarbons; tritium; and, possibly, chromium and lead. VOCs, and possibly chromium, are the only chemicals of concern at TFG-1 and TFG-2. The Applicable or Relevant and Appropriate Requirements (ARARs) for the Livermore Site are detailed in the FS and the ROD.

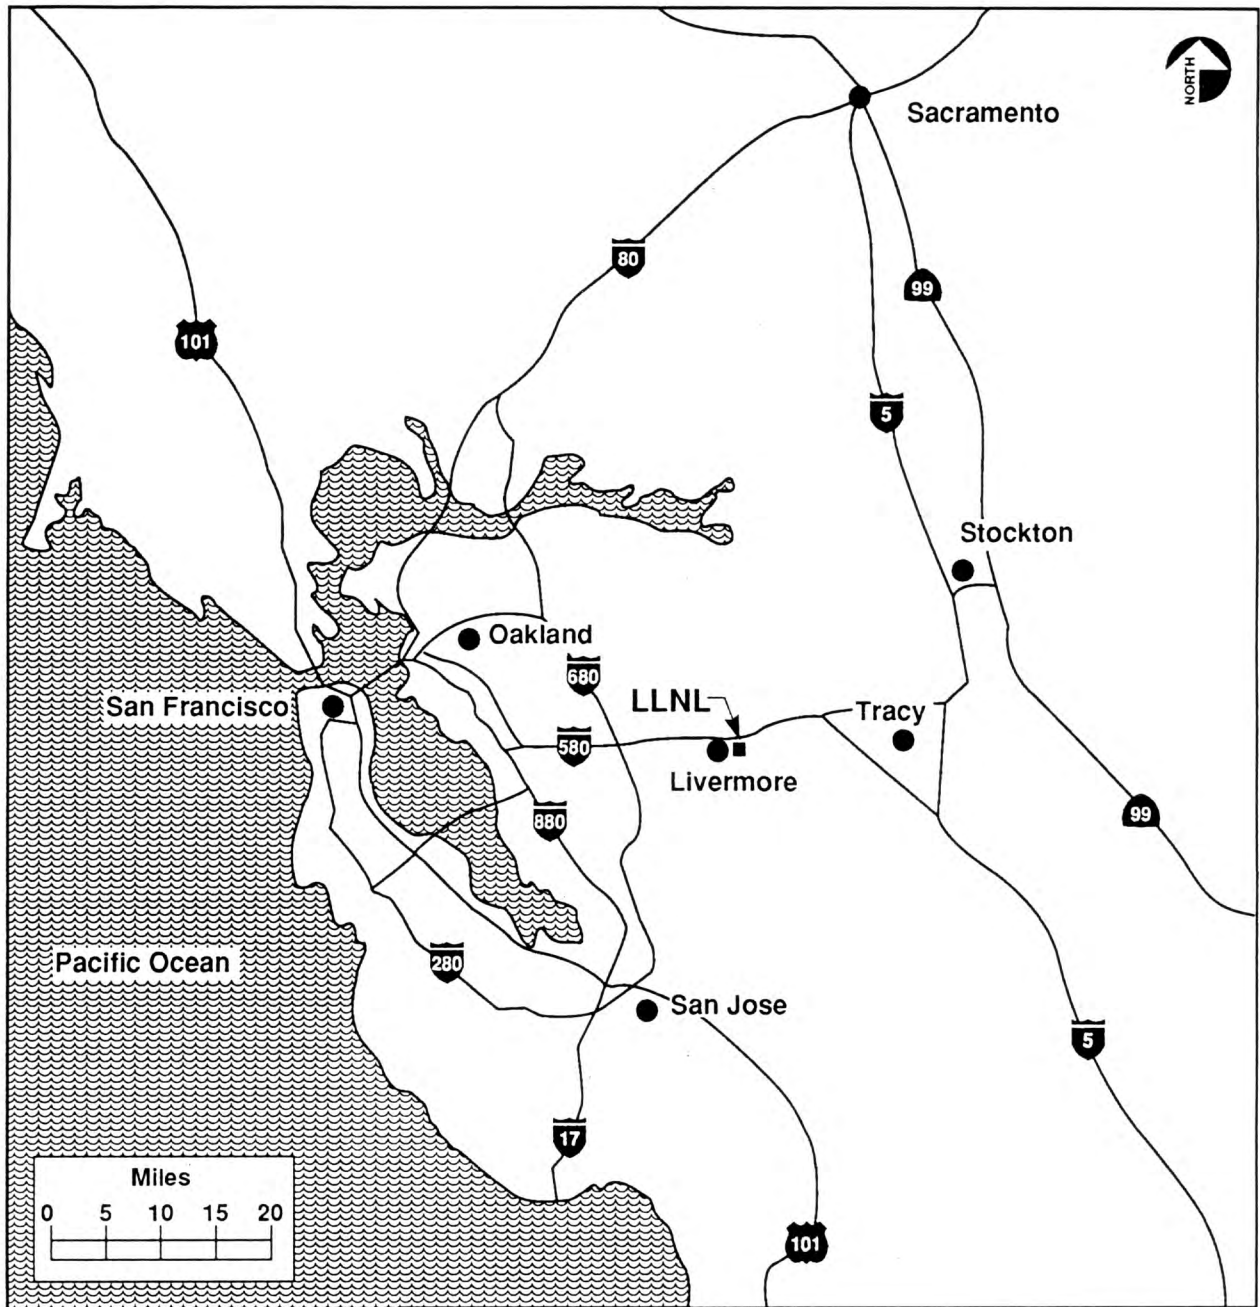


ERD-LSR-93-0110/RD5

Figure 1. Location of the LLNL Livermore Site.

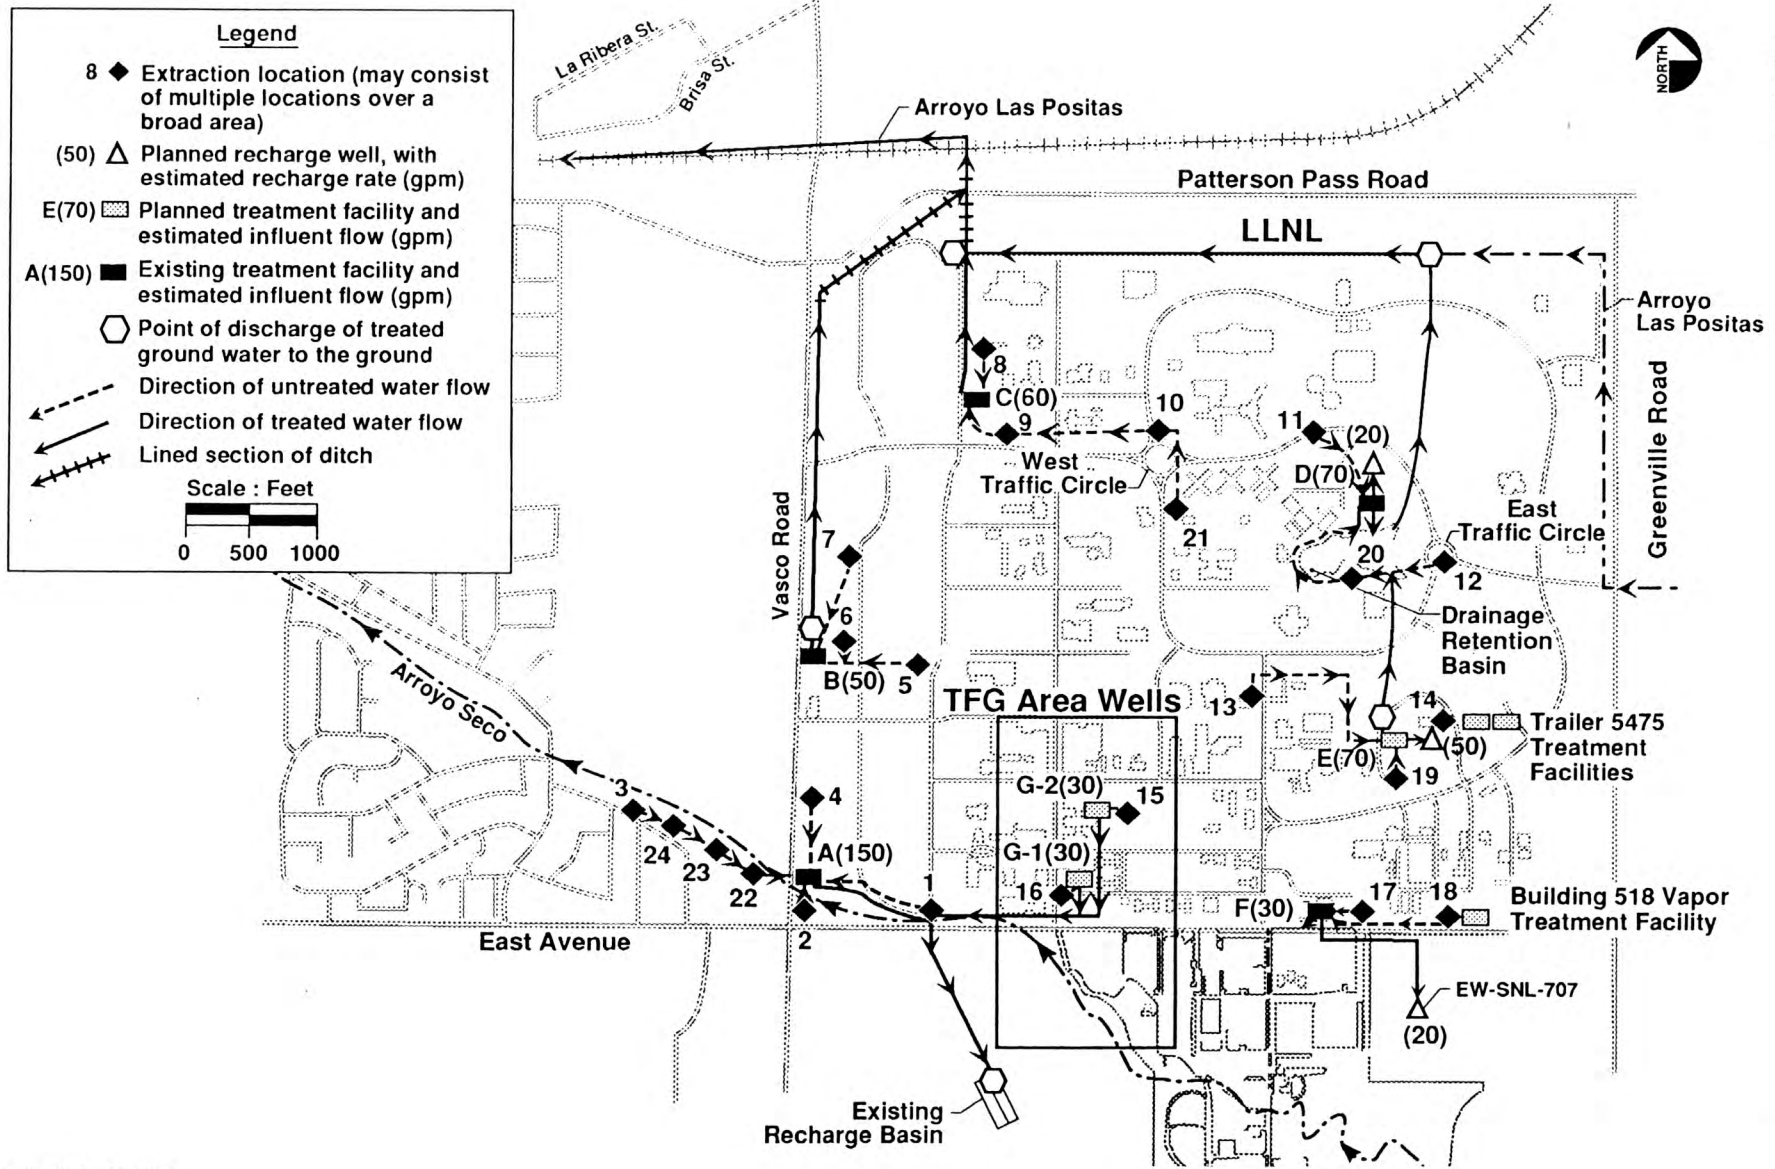

ERD-LSR-93-0116/RD5

Figure 2. Planned ground water and soil vapor extraction locations at the LLNL Livermore Site (modified from the RAIP).

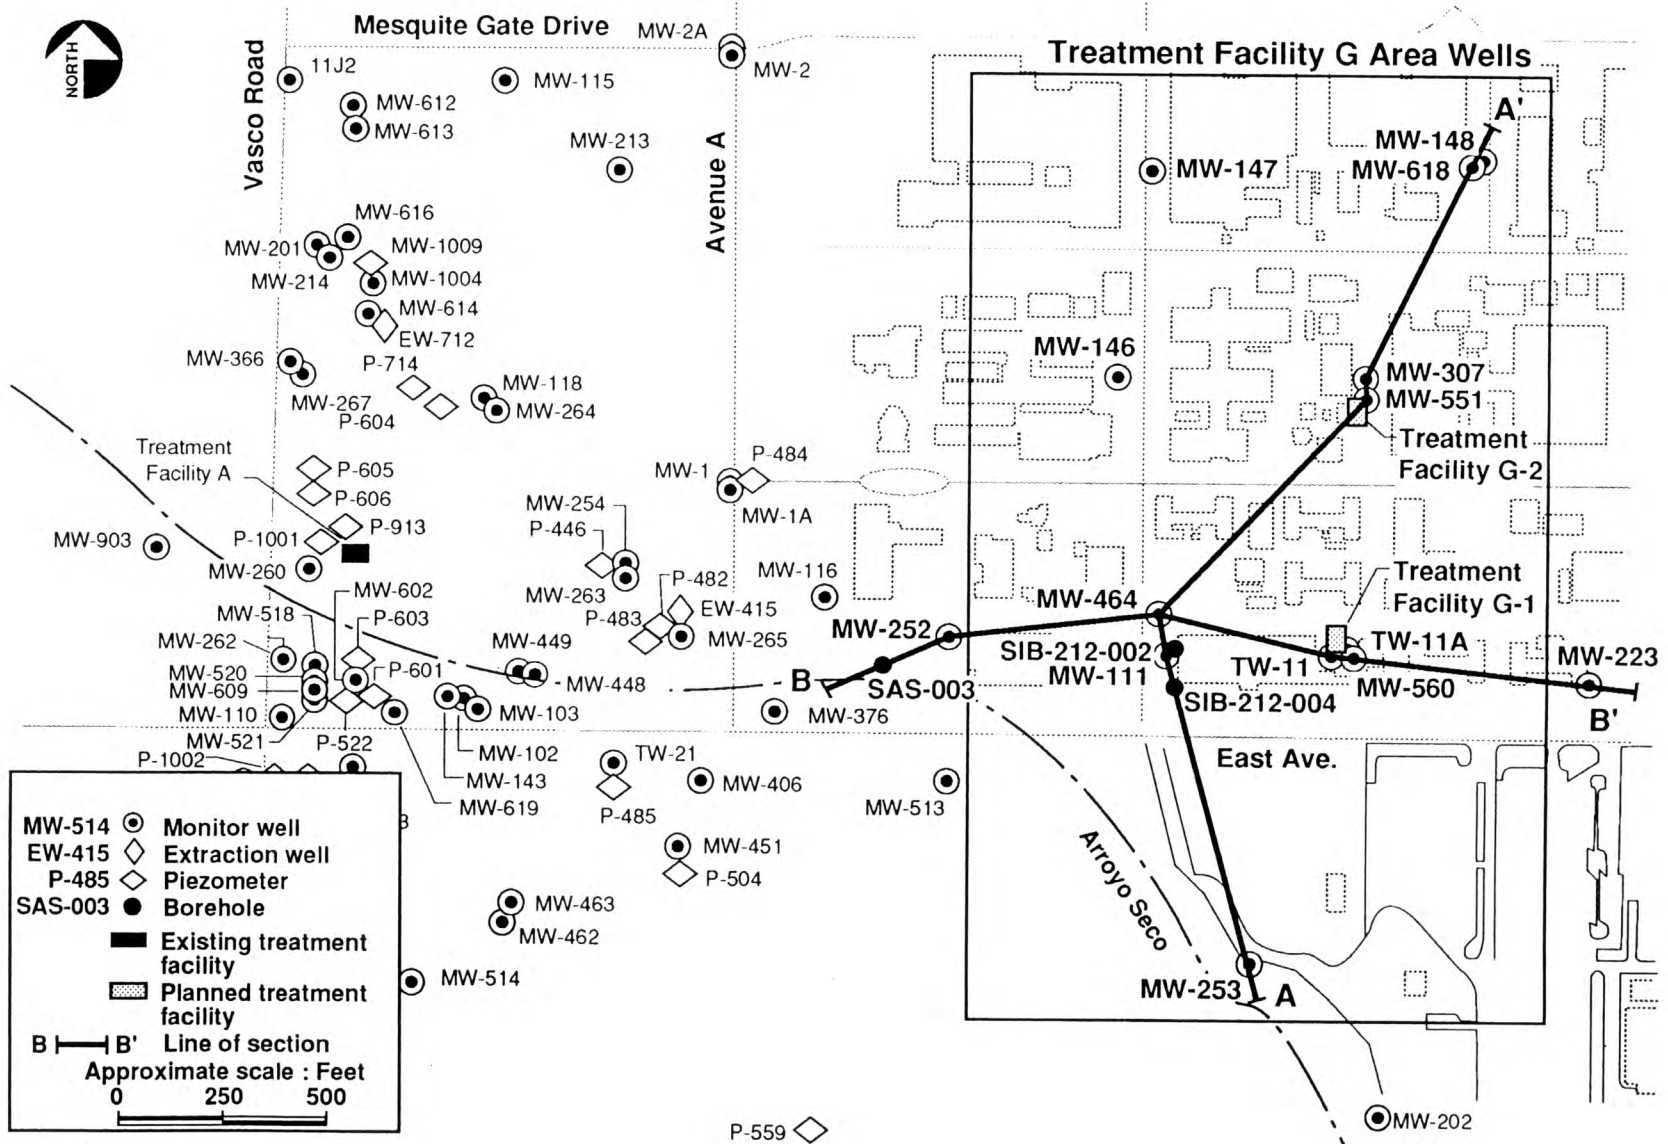

ERD-LSR-94-00

Figure 3. Monitor well, extraction well, piezometer, and borehole locations in the TFG Area.

The scope and format of this report are based on EPA guidance documents (EPA, 1989; 1990), an outline provided by EPA (Gill, 1993), and subsequent discussions with EPA. As specified by EPA, each RD report contains engineering design specifications for the ground water and/or vapor extraction and treatment systems, including piping and instrument diagrams (P&IDs), system descriptions, monitoring and construction schedules, and cost estimates. The RD reports also include a Remedial Action Work Plan that contains Quality Assurance/Quality Control (QA/QC) Plans and Health and Safety Plans (HASPs) for operation and maintenance, and the requirements for offsite shipment of hazardous waste and for project closeout. The QA/QC Plans and HASPs for construction are the same for all RD reports. Therefore, these documents were submitted only with Remedial Design Report No. 1 (RD1) (Boegel *et al.*, 1993).

This document was prepared by LLNL for DOE with oversight from EPA, DTSC, and RWQCB. The six RD reports are primary documents under the FFA for the Livermore Site.

Section 2 of this report presents the hydrostratigraphy and wellfield designs for TFG-1 and TFG-2. Section 3 presents the remedial design for the treatment facilities. Both TFG-1 and TFG-2 will be identical, skid-mounted treatment facilities. Section 4 is the Remedial Action Work Plan for TFG-1 and TFG-2. Appendices A through E present the soil and ground water analytical results, waste discharge permits, the Operations and Maintenance (O&M) QA/QC Plan, O&M HASP, and sampling procedures for TFG-1 and TFG-2, respectively.

2. Wellfield Design

The TFG Area ground water extraction wellfield design is based on hydrostratigraphic analyses, and VOC and chromium distribution data. These are discussed in Section 2.1, and the extraction well and piezometer locations and design are presented in Section 2.2.

2.1. Hydrostratigraphic Analysis and VOC Distribution

2.1.1. Basis for Defining Hydrostratigraphic Units

For this RD report, hydrostratigraphic units were defined and used to design the TFG-1 and TFG-2 wellfields (Fig. 4). A similar approach was used in RD reports 3 and 6 to design the Treatment Facility D and E (TFD and TFE) and the Building 518 Vapor Treatment Facility wellfields. Conversely, RDs 1 and 2 utilized water-bearing zones as the basis to plan the wellfields. The use of hydrostratigraphic units reflects ongoing work to interpret and synthesize the Livermore Site hydrogeology on a site-wide scale, and is a logical progression from the use of borehole-specific water-bearing zones to more regional interpretations. The progression from the use of water-bearing zones to hydrostratigraphic units is discussed further below.

A water-bearing zone is defined at the Livermore Site as saturated permeable sediment greater than about 3 ft thick, separated from other permeable sediments above and below by at least 5 ft of low-permeability sediment. The water-bearing zones are numbered consecutively downward from ground surface at each borehole. During the hydrogeologic investigation

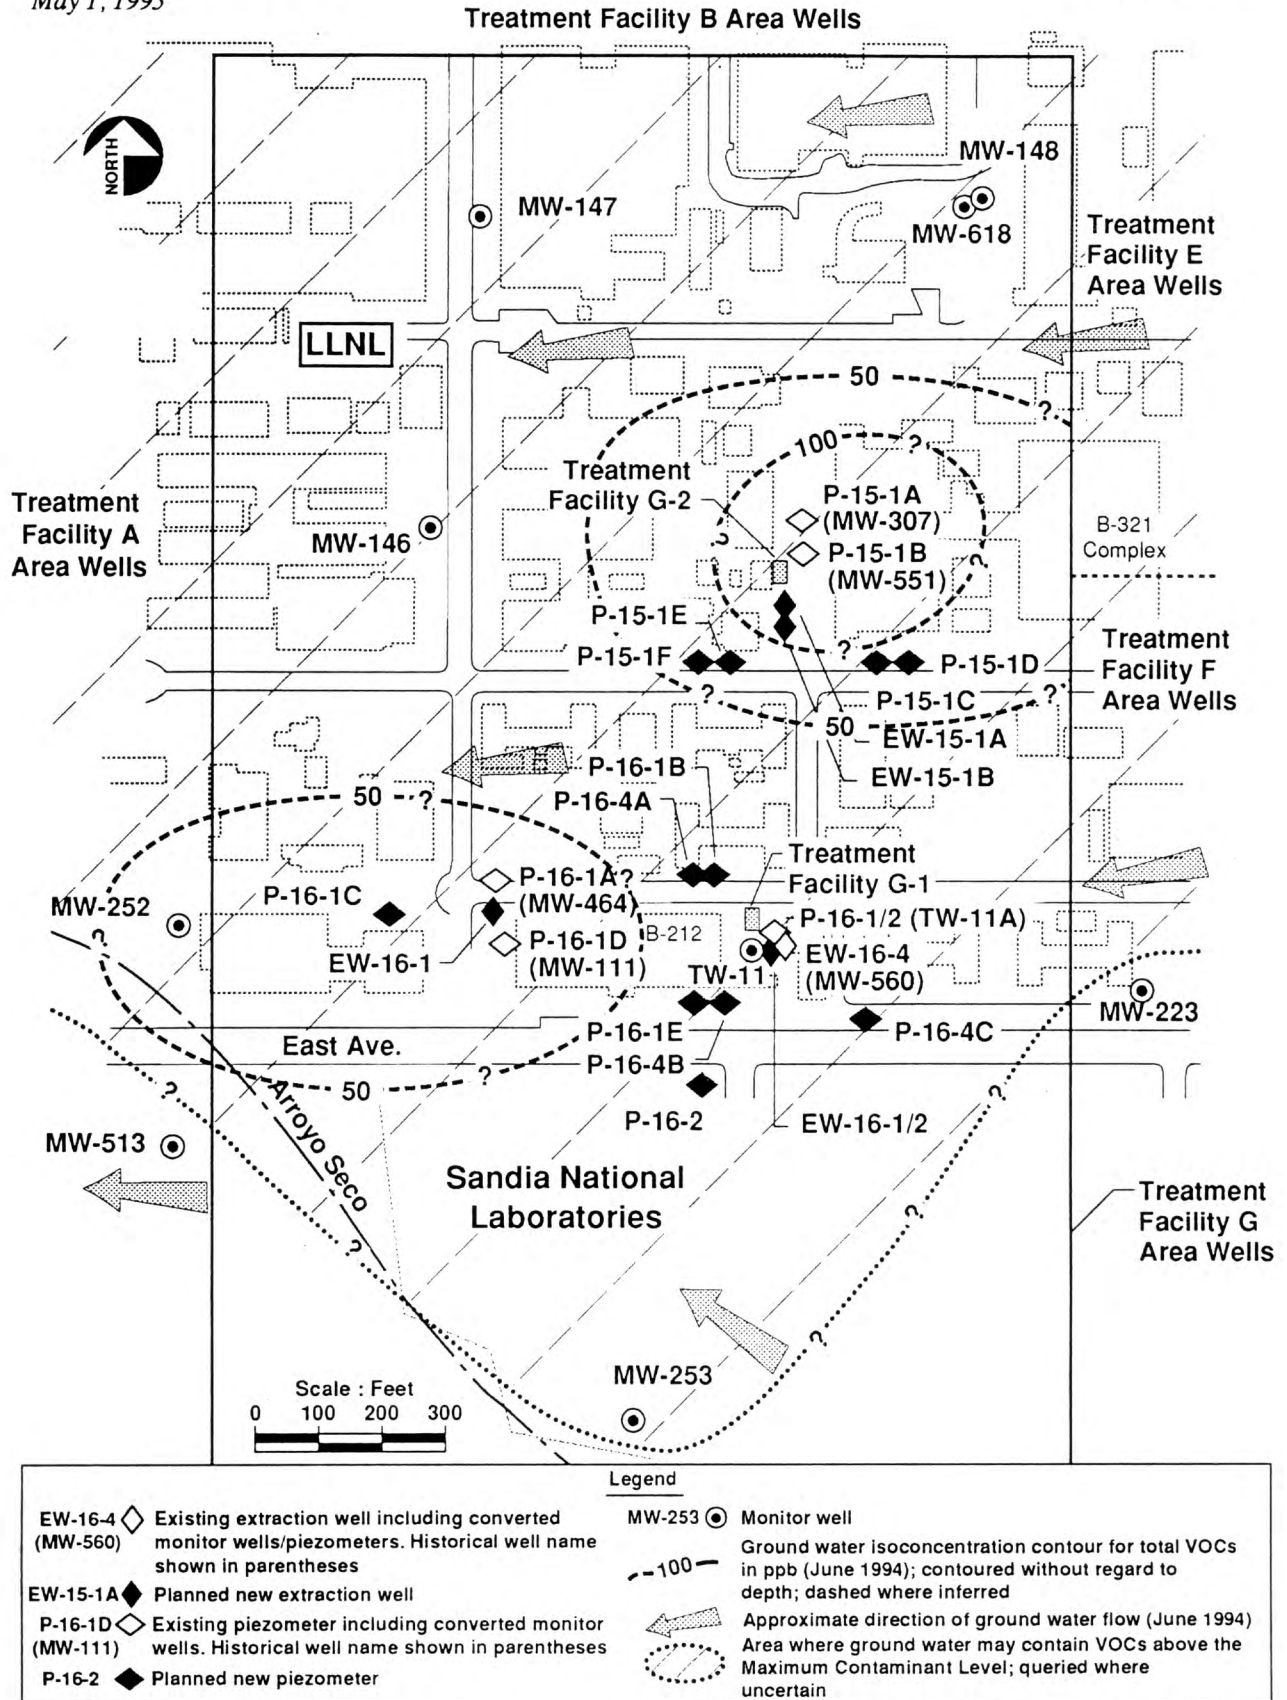


Figure 4. Proposed TFG Area remedial wellfield design.


conducted for RD3 (Berg *et al.*, 1994), several of the water-bearing zones in the TFD and TFE Areas were identified as being hydraulically connected, based on pumping tests, chemical data, and geologic correlation. Hydrostratigraphic units consist of sediments grouped together primarily on the basis of their hydraulic properties.

The six hydrostratigraphic units previously defined in the TFD and TFE Areas have also been identified in the TFG Area. Hydraulic test analyses, soil and ground water chemical data, geologic core descriptions, and borehole geophysical logs were used to define the six hydrostratigraphic units in the TFG Area. VOC distribution and hydraulic properties within these units were analyzed to select the extraction well and piezometer locations. The primary purposes of TFG-1 Area extraction wells are to remove VOC mass and control the southern VOC plume margin. The primary purpose of TFG-2 Area extraction wells is to expedite cleanup by removing VOC mass.

Ten cross sections, incorporating hydrogeologic descriptions, geophysical logs, and soil and ground water chemical concentrations, were extended from the TFE Area to the TFG Area to design the extraction wellfields. Hydraulic communication data from pumping tests were also incorporated into the cross sections. Maps depicting geologic structure, unit thickness, hydraulic communication, VOC and chromium concentrations, and the potentiometric surface were then constructed for each hydrostratigraphic unit. The planned location and screened interval of each proposed extraction well and piezometer in the TFG-1 and TFG-2 Areas were determined by synthesizing the data presented on these maps and cross sections. DOE/LLNL will make available project files containing this hydrogeologic information upon request to the LLNL Area Public Relations Manager. After completion of all RD documents, a report is planned that will summarize the detailed analyses on which the hydrostratigraphy is based. Preliminary wellfield designs presented in RD reports may be modified based on new information or interpretations presented by DOE/LLNL or regulatory agencies.


2.1.2. Hydrostratigraphic Units in the TFG-1 and TFG-2 Areas

Figure 3 shows the lines of section for the TFG-1 and TFG-2 hydrostratigraphic interpretations presented in Figures 5 and 6. The first hydrostratigraphic unit (Unit 1) is a 60- to 90-ft-thick interval of interbedded sand, silt, clay, and gravel. The top of this unit is found from about 55 ft depth [570 ft above mean sea level (amsl)] in the southeast to over 105 ft (520 ft amsl) in the northwest, reflecting the general northwesterly dip of the sediments in the TFG-1 and TFG-2 Areas. High electrical resistivity geophysical log response and generally low gamma ray response are typical for the sands and gravels in this unit, with low resistivity and high gamma ray responses in the intervening silts and clays. Due to the relative small amount of hydraulic data in the TFG Area, the extent of lateral communication in Unit 1 is not known. However, based on correlating geophysical log response with Unit 1 hydraulic analyses in the TFD and TFE Areas, we anticipate good hydraulic communication (over 0.5 ft of drawdown between the sandy interbeds over a lateral distance of 400 ft) in the east-west direction. Although Unit 1 has a similar geophysical log signature as that in the TFD and TFE Areas, Unit 1 is thicker and contains more fine-grained interbeds in the TFG Area than in the eastern part of LLNL.

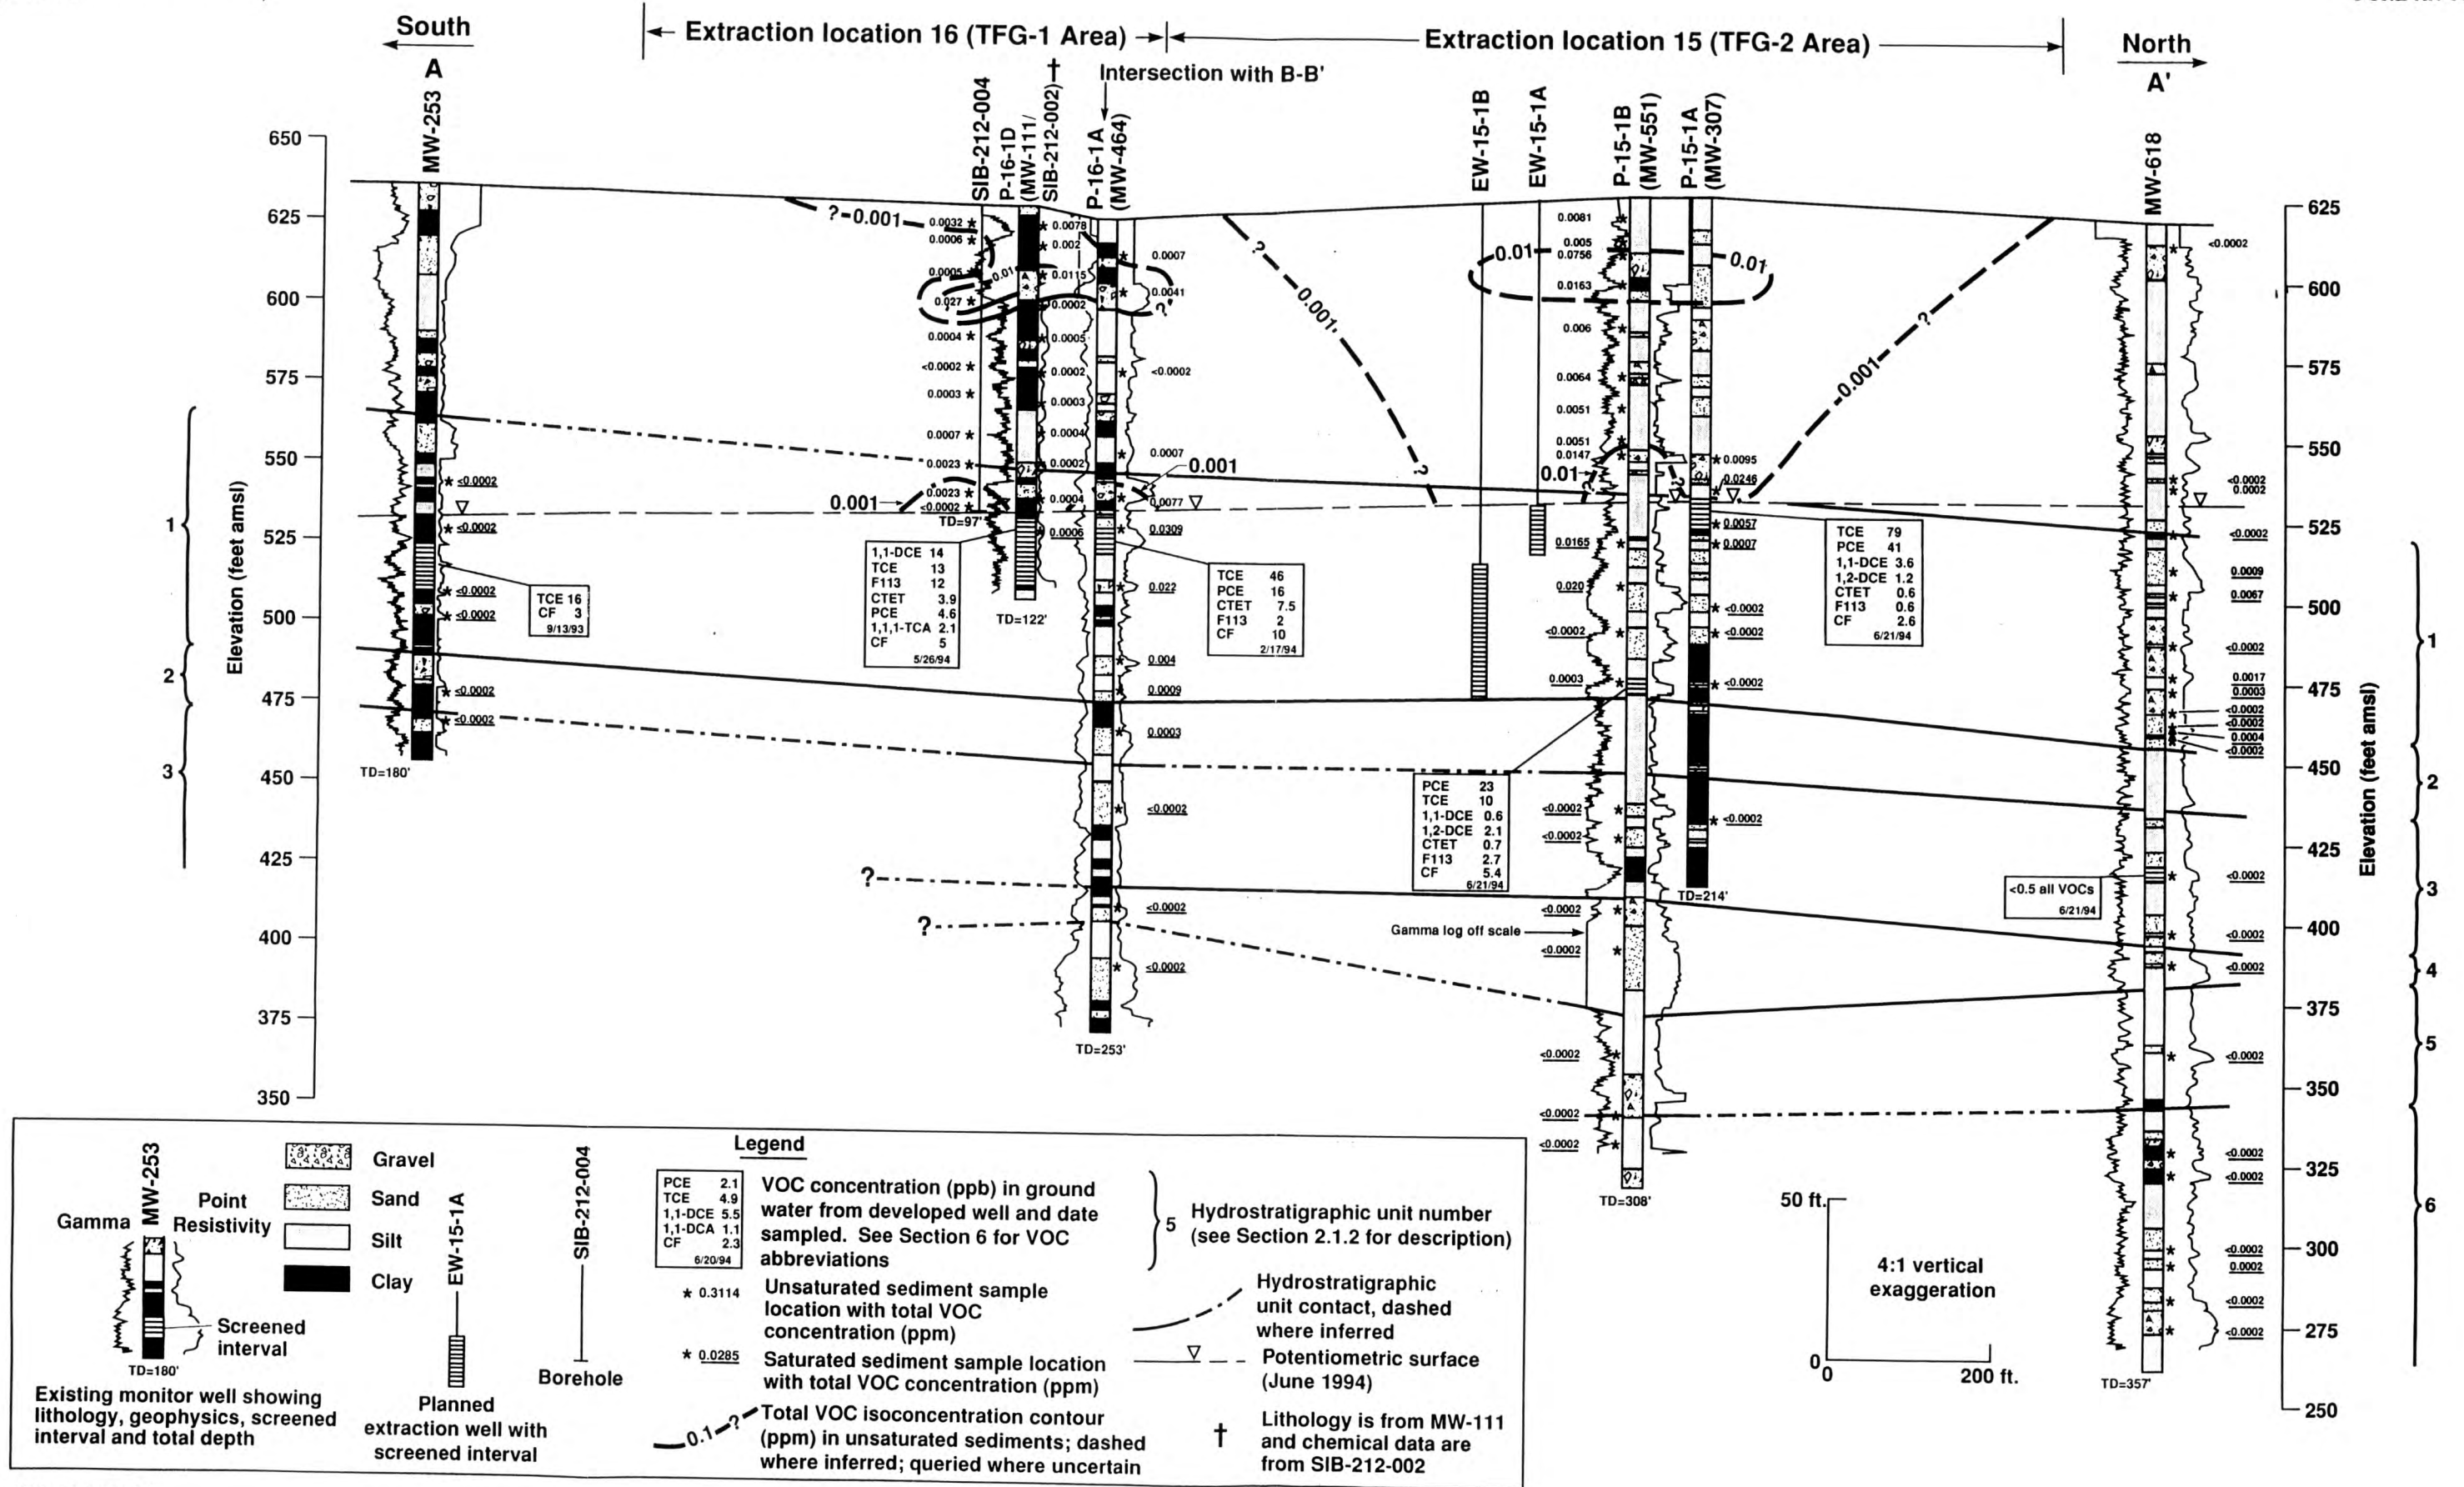

RDS cross section A-A'

Figure 5. Hydrogeochemical and geophysical cross section A-A' and proposed remedial wellfield design in the TFG-1 and TFG-2 Areas.

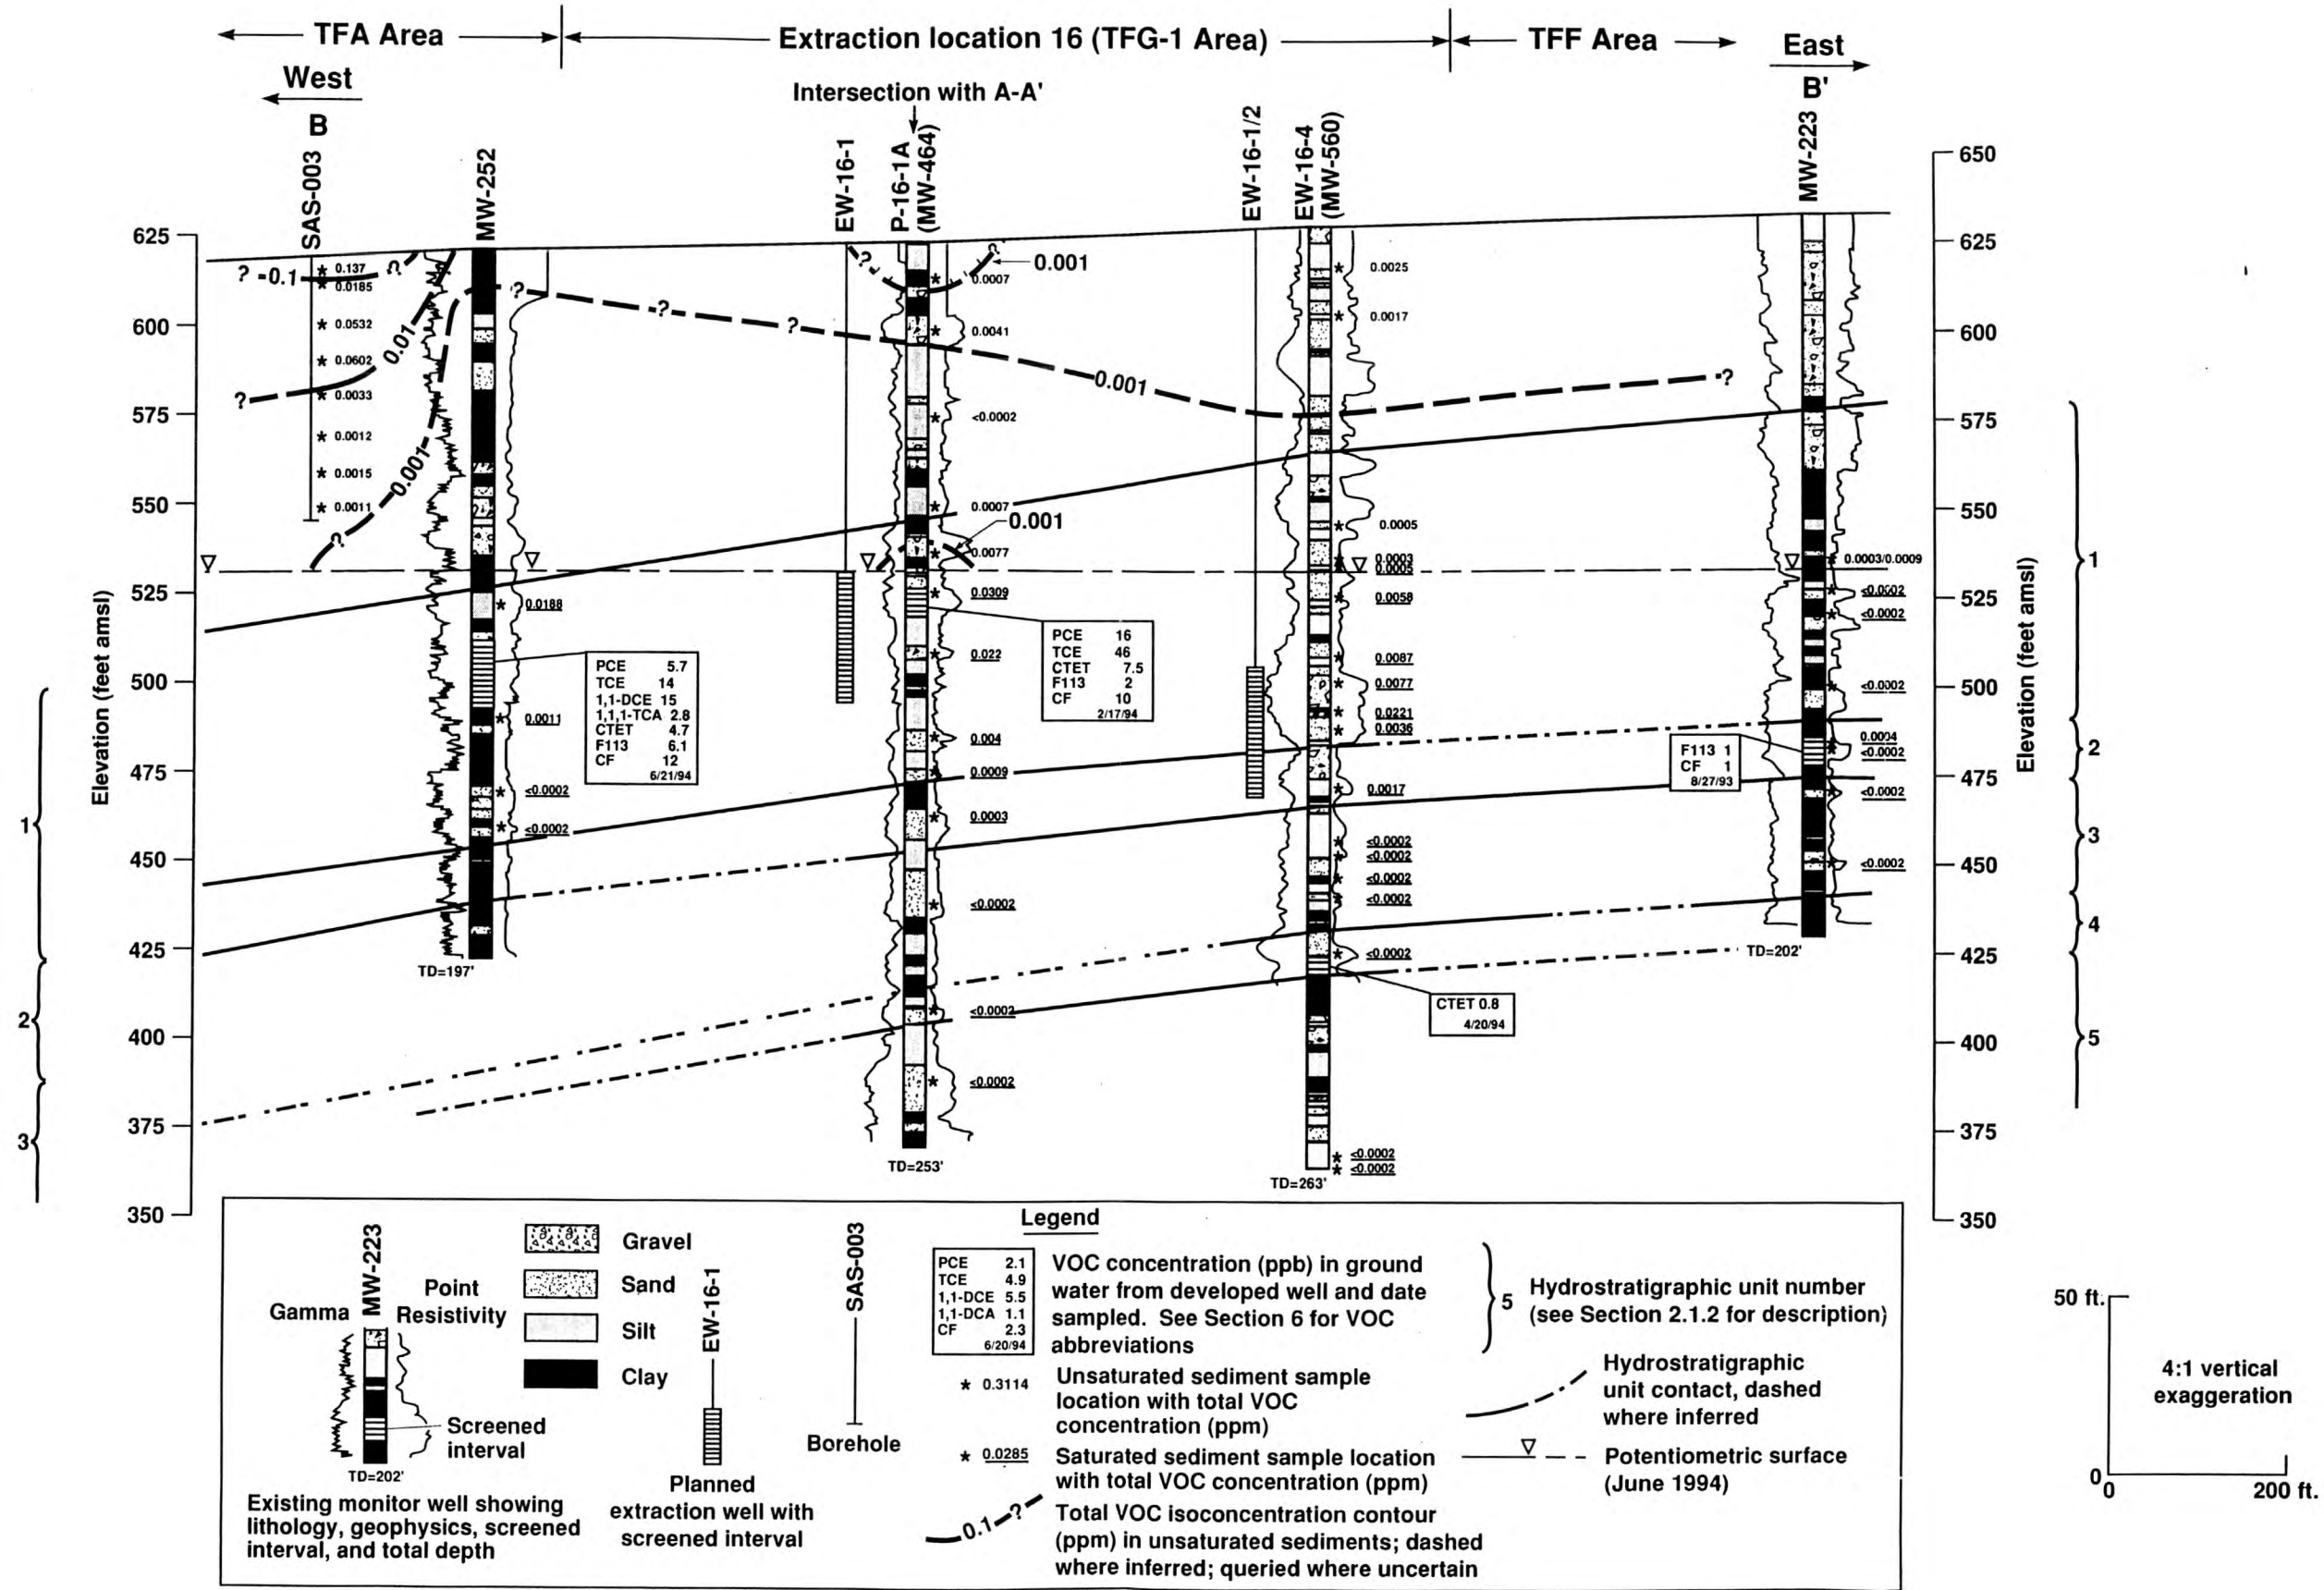

RD5 cross section B-B'

Figure 6. Hydrogeochemical and geophysical cross section B-B' and proposed remedial wellfield design in the TFG-1 Area.

The top of the second hydrostratigraphic unit (Unit 2) occurs between depths of about 140 and 175 ft (485 and 450 ft amsl) and is about 15- to 30-ft thick in the TFG Area. Unit 2 consists predominantly of lower permeability silts, clayey silts, and clayey sands with at least one laterally continuous, permeable sand and gravel interbed in the eastern TFG-1 Area (Fig. 6). The geophysical response of this interbed is similar to the more laterally continuous sand interbeds observed in Unit 2 in the southwestern TFE Area. Therefore, good hydraulic communication is anticipated within this unit, similar to that observed in the southwestern TFE Area (over 0.5 ft of drawdown over a lateral distance of 400 ft). The contact between Units 1 and 2 is commonly marked by a change to predominantly finer grained sediments in Unit 2 and a decrease in VOC concentrations in saturated soil samples (Figs. 5 and 6). The geophysical logs generally reflect this lithologic change as an increased gamma ray response and a lower resistivity response compared to Unit 1.

The third hydrostratigraphic unit (Unit 3) is a 30- to 45-ft-thick sequence of lower permeability clayey silts and clayey sands, with 1- to 5-ft thick interbeds of sands and gravels. The top of Unit 3 occurs at depths of 160 to 185 ft (465 to 440 ft amsl). The higher permeability sand sequence comprising Unit 3 in the western TFE Area is not present in the TFG Area. Unit 3 consists of two fining-upward sequences with a characteristic increasing gamma ray and a decreasing resistivity response (see well MW-464 on Fig. 6). The top of the upper sequence forms the boundary between Units 2 and 3. To date, no VOCs have been detected in Unit 3 in the TFG-1 and TFG-2 Areas.

The fourth hydrostratigraphic unit (Unit 4) is a laterally continuous, 5- to 10-ft-thick, higher permeability sand and gravel unit that occurs on top of the Lower Member of the Livermore Formation. The top of Unit 4 is typically found at depths ranging from 185 to 230 ft (440 to 395 ft amsl). Geophysical logs, geologic core descriptions, and pumping test data indicate that this unit is thinner and less permeable than in the western portions of the TFD and TFE Areas. Sustainable flow rates are anticipated to range between 5 and 10 gallons per minute (gpm). Based on limited pumping test data, a high degree of lateral hydraulic continuity is expected within Unit 4 across both the TFG-1 and TFG-2 Areas. Although no VOCs were found above detection limits in Unit 4 sediments, ground water chemical analyses report carbon tetrachloride ranging from 0.5 to 2 parts per billion (ppb) in well MW-560 since 1989 (0.8 ppb reported April 20, 1994). The Maximum Contaminant Level (MCL) for carbon tetrachloride is 0.5 ppb.

The fifth hydrostratigraphic unit (Unit 5) is the uppermost part of the Lower Member of the Livermore Formation. This unit is equivalent to the transition zone between the Upper Member of the Livermore Formation and the green and blue units below (Thorpe *et al.*, 1990). Unit 5 is about 20 to 50 ft thick, and its top occurs at depths from 210 to 255 ft (415 to 370 ft amsl) in the TFG-1 and TFG-2 Areas. Unit 5 consists predominantly of fine-grained, mottled greenish-gray to yellow-brown silt and clay with interbeds of silty to clayey gravels and sands. The laterally continuous, coarse-grained permeable sediments that form the base of this unit over much of the TFD and TFE Area are present in well MW-551 in the TFG Area (Fig. 5). Elevated gamma ray response, accompanied by a subdued resistivity response, is typical of Unit 5 fine-grained sediments. The basal sand layer, where present, exhibits a low gamma ray response and a high resistivity response. No VOCs have been observed above the detection limit in Unit 5 sediments or ground water in the TFG-1 or TFG-2 Areas.

The upper portion of the sixth hydrostratigraphic unit (Unit 6) consists of low-permeability, light-green silty clay to clayey silt, with minor interbeds of clayey sand and gravel. The top of Unit 6 occurs at depths of 280 to 290 ft (345 to 335 ft amsl). This upper sequence in Unit 6 forms a regional confining layer throughout the Livermore Site area. This unit is equivalent to the green unit in the Lower Member of the Livermore Formation (Thorpe *et al.*, 1990). Elevated gamma ray response reflects the higher clay content within this unit. Based on field descriptions and laboratory tests, the clay unit exhibits very low hydraulic conductivity, on the order of 10^{-7} to 10^{-8} centimeters per second (3.3×10^{-9} to 3.3×10^{-10} feet per second). Limited data indicate that laterally continuous, high-permeability gravel units occur below this clay layer. No VOCs have been detected in Unit 6 soil or ground water in the TFG-1 or TFG-2 Areas except for 0.0002 parts per million (ppm) 1,2-dichloroethylene (1,2-DCE) in a saturated soil sample collected from a depth of 326 ft (293 ft amsl) from the borehole for MW-618. The absence of VOCs in all other Unit 5 and Unit 6 ground water and soil samples from the TFG-1 and TFG-2 Areas, strongly indicates that the reported 1,2-DCE is a laboratory error and that VOCs are not in the confining layer.

2.1.3. VOC Distribution

Building 212 and Building 321 in the TFG Area were identified as potential source areas in the RI (Thorpe *et al.*, 1990). Building 212 was constructed and used by the U.S. Navy in the early 1940s as a drill hall and gymnasium. Starting in the early 1950s this building was used for accelerator research. This research program ended and all of the equipment was removed by the early 1990s. Past releases probably occurred from leaking drums, plating shop spills, and a cold trap cleaning area. Construction of the Building 321 Complex began in 1954 with subsequent additions through 1985. The complex has housed various machine, plating, and small support shops. Releases probably occurred from plating shop sumps and spills, and storm drains which may have received coolant and oils. As concluded in the RI, the small releases and low VOC concentrations in unsaturated sediments at Buildings 212 and 321 do not currently contribute significant quantities of VOCs to the ground water.

The interpreted distribution of total VOCs in unsaturated sediment in the TFG-1 and TFG-2 Areas are shown on Figures 5 and 6. Unsaturated sediment chemical data indicate that the highest reported VOC concentrations in the TFG-1 and TFG-2 vadose zone occur at 19.5 ft (605.5 ft amsl) in well MW-551, where 0.0756 ppm total VOCs, consisting of TCE, PCE, and carbon tetrachloride are reported (Fig. 5). These low VOC concentrations indicate there are no known active potential VOC sources in this area (Thorpe *et al.*, 1990). Therefore, no vadose zone remediation is planned in the TFG-1 or TFG-2 Areas.

Saturated sediment VOC concentrations in the TFG-1 and TFG-2 Areas are also depicted on Figures 5 and 6. Other than the anomalous Unit 6 soil analysis in well MW-618 discussed in Section 2.1.2, all reported VOCs in saturated sediment are confined to Units 1 and 2 in the TFG-1 Area and to Unit 1 in the TFG-2 Area. Chloroform has not been included in the total sediment VOC concentrations cited in this report because chlorinated drinking water is used to mix the drilling mud.

The highest total VOC ground water concentration in the TFG-1 and TFG-2 areas occurs in well MW-307 (Figs. 4 and 5), where 128.6 ppb total VOCs consisting of TCE, PCE, 1,1-dichloroethylene (1,1-DCE), 1,2-DCE, trichlorotrifluoroethane (Freon 113), chloroform, and

carbon tetrachloride, were detected in June 1994. As indicated on Figure 4, at least one VOC exceeds its MCL in ground water across most of the TFG Area.

2.2. Extraction Wells and Piezometers

To estimate the hydraulic capture areas of the planned 24 ground water extraction locations shown in the RAIP, ground water flow paths were calculated using the numerical model CFEST (Coupled Fluid, Energy, and Solute Transport; Gupta *et al.*, 1987). Ground water extraction at the 24 planned extraction locations, and recharge at 2 planned injection wells, the Recharge Basin, and the Treatment Facility B and C drainage ditches, were simulated using the two-dimensional numerical flow model. The results of the simulation are shown in Figure 7.


Previous estimates of ground water capture zones presented in the ROD (DOE, 1992) and the RAIP (Dresen *et al.*, 1993) were calculated using the two-dimensional analytical flow model CAPTURE (McEdwards, 1986). Unlike the previous CAPTURE model, the CFEST results shown in Figure 7 incorporate the effects of aquifer recharge and heterogeneities, such as varying permeability and aquifer thickness. The development and results of the CFEST model are discussed in more detail in Tompson *et al.* (in preparation).

As stated in the RAIP (Dresen *et al.*, 1993), extraction locations 15 and 16 (Fig. 2) will supply ground water to TFG. Further analysis conducted since the RAIP for this RD indicate that it is more cost effective to treat this water at two separate, skid-mounted facilities rather than at a single facility. Ground water from extraction location 15 will be treated at TFG-2, and ground water from extraction location 16 will be treated at TFG-1 (Fig. 2).

2.2.1. Extraction Well Location and Design

Five extraction wells are planned in the TFG Area. One of these wells is currently installed, and the remaining four are planned for phased installation in the future. The phased approach will help to determine the actual effectiveness, compared to the estimated effectiveness, of the initial planned extraction wells and treatment systems before proceeding with subsequent phases. Design specifications for the TFG-1 and TFG-2 extraction wells are presented in Table 1; extraction well locations are shown on Figure 4. Extraction wells will be designed and constructed according to the principles specified in the RAIP (Dresen *et al.*, 1993).

Three of the five planned extraction wells are located in the TFG-1 Area (Fig. 4). Extraction well EW-16-1, located about 50 ft west of Building 212 (B-212) (Fig. 4), will remove VOCs from the first hydrostratigraphic unit where total VOC concentrations currently exceed 80 ppb (February 1994 data). EW-16-1/2 is located about 75 ft east of Building 212, and will capture VOCs in the deeper portion of the first hydrostratigraphic unit and in the upper portion of the second hydrostratigraphic unit. As discussed in the RAIP, if VOC concentrations in these two intervals are not within one order of magnitude in the EW-16-1/2 borehole, separate extraction wells may be installed in each hydrostratigraphic unit, or a bentonite/grout seal will be placed between the two screened intervals in EW-16-1/2 to inhibit vertical migration of VOCs when the well is not pumping and to prevent communication between zones when one zone is selectively pumped. EW-16-1/2 may be also completed with a bentonite seal if a confining zone 3 ft thick or greater occurs between the two intervals.

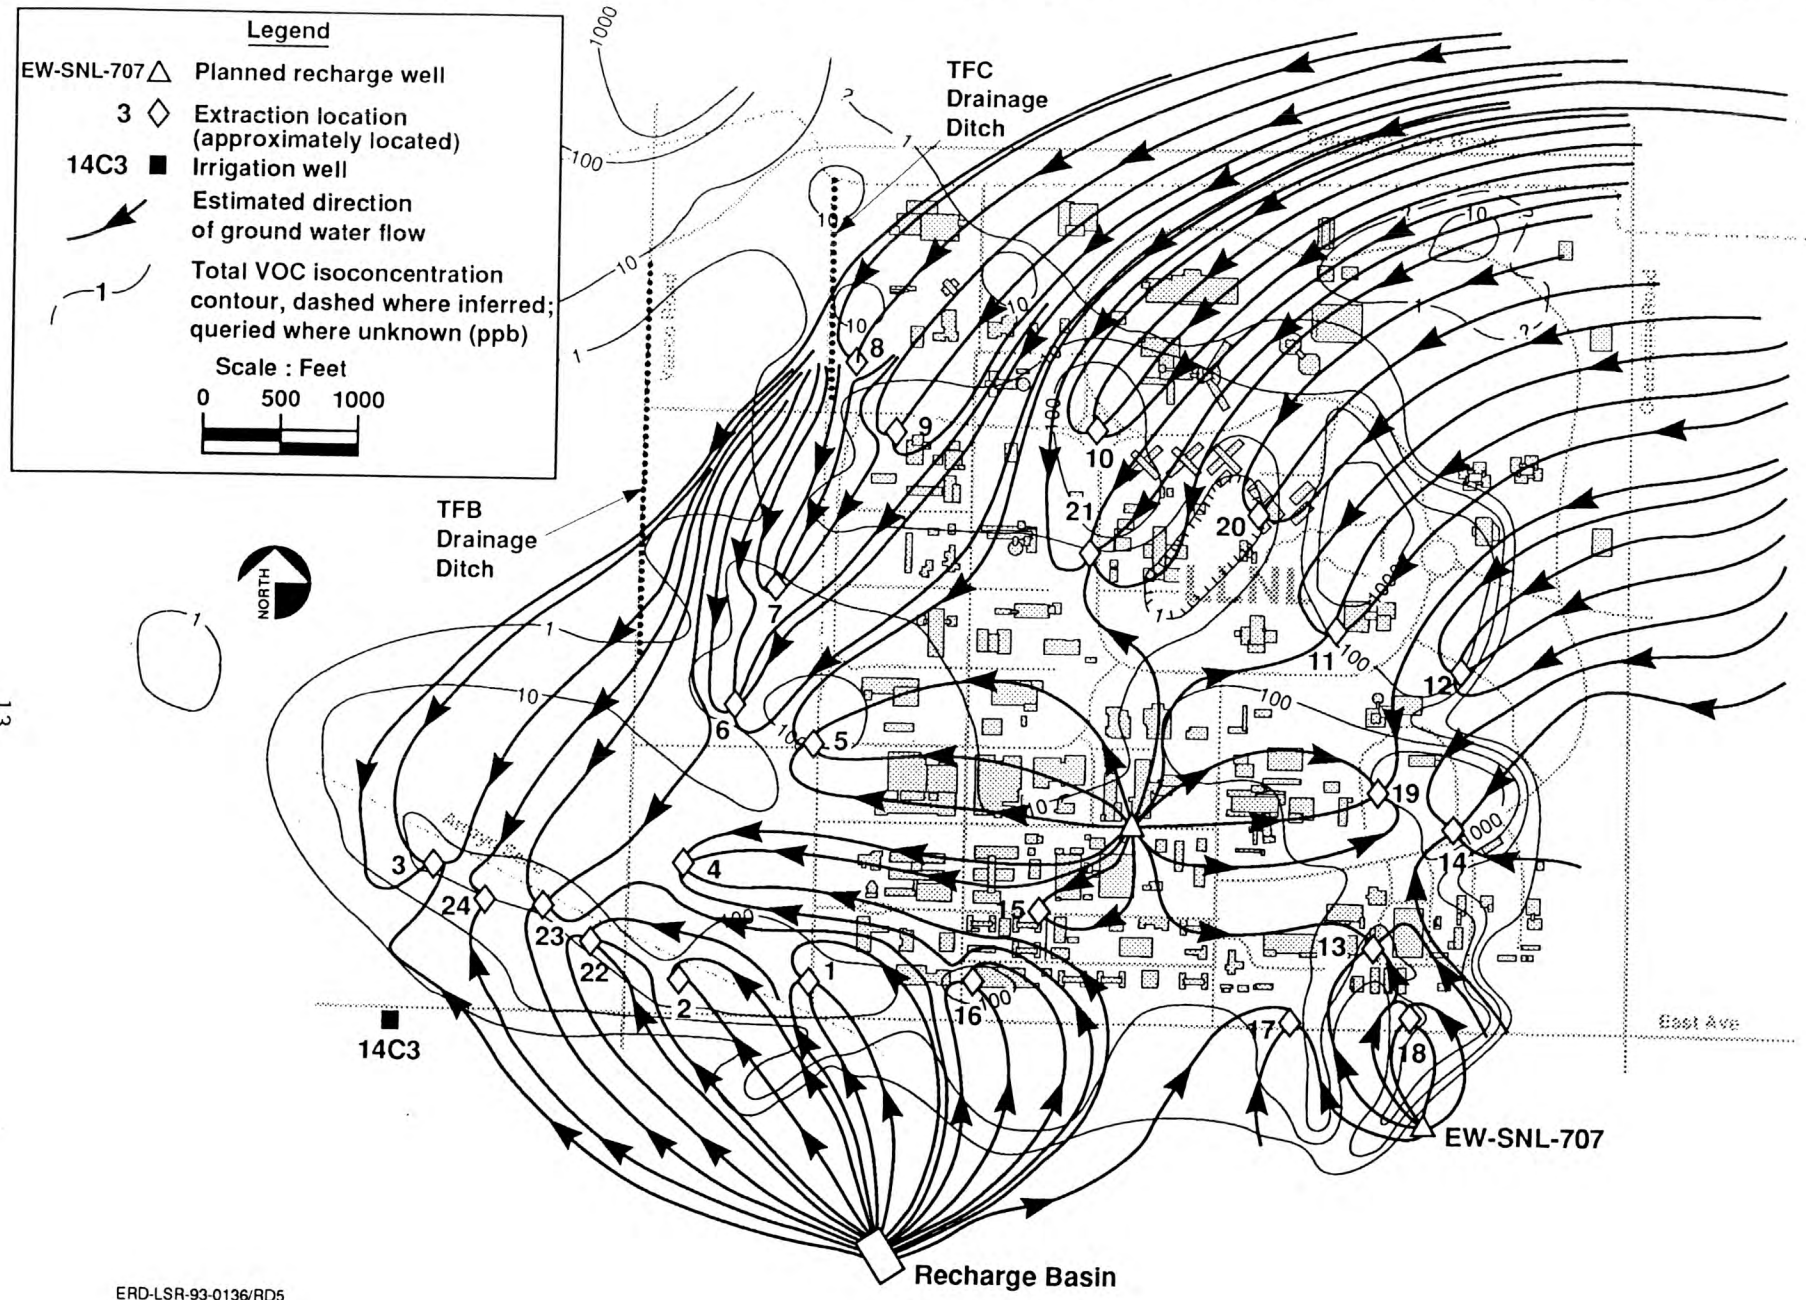

13

ERD-LSR-93-0136/RD5

Figure 7. Estimated hydraulic capture zones and recharge well locations.

Table 1. TFG-1 and TFG-2 extraction well specifications.

Well name	Extraction well name ^a	Well design ^b	Date completed	Borehole depth (ft)	Casing depth (ft)	Perforated interval (ft)	Sand-pack interval (ft)	Hydro-stratigraphic unit ^c	Estimated maximum long-term steady state yield (gpm) ^d	Pump type ^e	Pump intake depth (ft)	Activation priority ^f
<i>TFG-1 Area</i>												
<i>Extraction location 16</i>												
TBI	EW-16-1	Single	-	(130)	(127)	(90-127)	(88-127)	First	(5-10)	-	124	1
TBI	EW-16-1/2	Multiple	-	(170)	(160)	(125-160)	(122-160)	First & second	(5-15)	-	143	4
MW-560	EW-16-4	Single	07-Feb-89	263.0	206.5	201-206.5	199-208	Fourth	2-5	16S10-10	201	5
<i>TFG-2 Area</i>												
<i>Extraction location 15</i>												
TBI	EW-15-1A	Single	-	(125)	(120)	(95-120)	(93-120)	First	(2-5)	-	117	3
TBI	EW-15-1B	Single	-	(160)	(155)	(120-155)	(116-155)	First	(20-25)	-	(140)	2

Notes:

TBI = To be installed.

Estimates are shown in parentheses.

- ^a Extraction well name indicates location, as shown in Figure 2 (i.e., EW-15-1A is at extraction location 15), and the hydrostratigraphic unit monitored (i.e., EW-15-1A is screened in the first unit). When multiple extraction wells are screened in the same hydrostratigraphic unit, a letter follows the unit designation (i.e., EW-15-1A, EW-15-1B, etc.). Figure 4 shows planned extraction well locations.
- ^b The two extraction well designs are:
 Single = a well screened and sand-packed in only one water-bearing zone.
 Multiple = a fully screened and sand-packed well in multiple water-bearing zones.
 Additional information regarding these well designs and their applications is presented in the RAIP (Dresen *et al.*, 1993).
- ^c Numbered consecutively downward from ground surface at each extraction location. A hydrostratigraphic unit is defined as sediments grouped together on the basis of hydraulic properties, geologic, geophysical, and/or chemical data.
- ^d Estimated yield based on pumping test results. Actual long-term pumping rates will generally be lower. Where an extraction well is not yet installed, estimates of sustainable flow rates are shown in parentheses. These are based on the flow rates from nearby wells screened in similar zones and/or the thickness and estimated permeability of sediments in the area.
- ^e Grundfos stainless steel submersible pump currently installed. Nominal pump flow rate is 14 gpm at 250-ft head.
- ^f Activation priority is the estimated order in which extraction wells will be connected to the treatment facility. Activation priority is based on whether the well currently exists, engineering design and cost, and the known or anticipated VOC concentration in ground water at the extraction locations.

Existing monitor well MW-560, about 100 ft east of Building 212, may be converted to extraction well EW-16-4 to remove ground water from the fourth hydrostratigraphic unit where 0.8 ppb carbon tetrachloride (slightly above the 0.5 ppb MCL) has been reported. The carbon tetrachloride appears to be localized and has not significantly increased since installation of MW-560 in 1989. No other detectable VOCs have been observed in the fourth hydrostratigraphic unit in TFG Area wells. We plan to continue monitoring MW-560 carbon tetrachloride concentrations for one to two years after the shallower wells are pumping to determine whether the fourth hydrostratigraphic unit is affected. If the concentration of carbon tetrachloride does not decrease after this monitoring period, DOE/LLNL and the regulatory agencies will then discuss any necessary remedial options. If VOCs fall below MCLs, we will not pump EW-16-4 or install the piezometers.

Well MW-253, located south of East Avenue on DOE property administered by Sandia National Laboratories (Fig. 4), is screened in Unit 2 and contained 16 ppb TCE in September 1993. This exceeds the 5 ppb MCL for TCE. The origin of this TCE is unknown at this time. However, potentiometric maps for Units 1 and 2 show that ground water flow is northwestward from this well toward the Livermore Site, making it unlikely that the source of this TCE is from the TFG-1 Area. We plan to monitor drawdown in MW-253 and in proposed piezometer P-16-2 to determine whether pumping EW-16-1/2 will affect MW-253.

Two new extraction wells are planned for the TFG-2 Area (Fig. 4). Because VOCs above the detection limit are confined to Unit 1 at extraction location 15, both planned wells will be completed in this unit. Extraction wells EW-15-1A and EW-15-1B will be located adjacent to each other about 100 ft west of the Building 321 (B-321) Complex (Fig. 4), where VOCs consisting of primarily TCE and PCE are present. Extraction well EW-15-1A will be screened in lower permeability sediments in the upper part of Unit 1, and EW-15-1B will be screened in three higher permeability sand and gravel zones in the lower part of Unit 1. We plan to screen these two intervals in separate wells because of the possibility that VOCs with greater than an order of magnitude difference in concentration will be found in the two intervals, and to enable greater control over the extraction rates from the two intervals (the less transmissive upper interval should yield less water than the lower more transmissive interval at a given drawdown from a single extraction well). If sampling of the first pilot borehole indicates that VOCs are within an order of magnitude in the two intervals, then the well will be screened over the entire interval, eliminating the necessity of a second extraction well.

In the RAIP (Dresen *et al.*, 1993), the influent flow rate for TFG was estimated at 40 gpm. The more detailed analyses conducted for this RD report indicate that sustainable extraction flow rates may be higher as a result of installing more extraction wells than originally estimated. In addition, properly designed extraction wells are more efficient and may have longer screened intervals than most of the existing monitor wells. Therefore, flow rates higher than those observed from hydraulic tests conducted on the existing monitor wells may be expected, especially in the early phases of pumping. Table 1 shows the estimated maximum sustainable yields from each TFG-1 and TFG-2 extraction well based on the most recent hydraulic and hydrogeologic data. Because no long-term pumping data exist for either area, the estimates in Table 1 probably represent upper bounds for steady-state yields. These upper bounds are shown on Table 1 so that pumps with adequate capacity can be installed. The estimated maximum long-term steady-state yields of TFG-1 and TFG-2 Area wells in Table 1 total 60 gpm. In most cases,

as long-term ground water extraction progresses, flow rates will decline as shallow sediments dewater, distant hydraulic boundaries are encountered, pumping of other wells in the vicinity begins, and/or local gradients decrease. Based on data from extraction well EW-415 in southwestern LLNL, the long-term total yield of TFG-1 and TFG-2 extraction wells may be about 30 to 40 gpm. As discussed in Section 3.1.1, the two skid-mounted treatment facilities will be designed to treat an initial flow of 30 gpm each, with the flexibility to expand to accommodate larger flows, if needed.

Pumping at extraction location 16 will begin with well EW-16-1, and pumping at extraction location 15 will begin with well EW-15-1B (Table 1). The other planned extraction wells will be added as funding permits. Extraction flow rate and ground water elevation and chemistry data will be collected to determine if the planned extraction scenario is capturing the 100 ppb total VOC contour at extraction location 15 (Fig. 4). If actual TFG-2 flow rates are substantially lower and result in incomplete capture of the 100 ppb contour, additional extraction wells may be considered. Water levels will be monitored in MW-253 during pumping of EW-16-1/2. If no hydraulic response occurs at MW-253, additional extraction wells located to the south may be needed. The locations of any new wells would be based on field water level data and recalibrated modeling results, and subject to regulatory agency review.

2.2.2. Piezometer Location and Design

Piezometers near the extraction wells will be monitored to determine the extent of hydraulic capture and identify potential areas of little or no ground water flow. The TFG-1 and TFG-2 Area piezometer configuration is designed to monitor the cumulative drawdown for each hydrostratigraphic unit, rather than the drawdown achieved by individual extraction wells. Thus, some piezometers will monitor multiple extraction wells.

TFG-1 and TFG-2 Area piezometer locations (Fig. 4) are based primarily on information from available hydraulic test data. In areas where low sustainable yields are anticipated, we plan to locate the additional proposed piezometers closer to the extraction wells, commonly within about 100 ft. Whenever possible, existing monitor wells were incorporated into the piezometer network. Up to 16 piezometers (5 existing and 11 new) are planned in the TFG Area. Preliminary design specifications for the new piezometers, along with the design specifications of the existing piezometers, are presented in Table 2. The ground water chemistry monitoring plan for the TFG Area is presented in Section 4.2.2.

3. Remedial Design

TFG-1 and TFG-2 will be ground water treatment facilities located in the south-central portion of the Livermore Site (Fig. 2). The principal compounds of concern in the TFG Area are TCE, PCE, chloroform, carbon tetrachloride, 1,1-DCE, Freon 113, 1,1,1-trichloroethane (1,1,1-TCA), 1,2-DCE, and possibly chromium (see Table 3 in Section 3.1.1). TCE, PCE, 1,1-DCE, and carbon tetrachloride exceed their respective MCLs. TFG-1 and TFG-2 will be identical skid-mounted treatment facilities. TFG-1 and TFG-2 will consist of commercially available air strippers to treat VOCs and, if needed, a commercially available ion-exchange unit, or a hexavalent chromium reduction unit. The air stripper effluent vapor stream will pass through granular activated carbon (GAC) to remove any residual VOCs. The treated ground

Table 2. TFG-1 and TFG-2 piezometer specifications.

Well name	Piezometer name ^a	Date completed	Borehole depth (ft)	Casing depth (ft)	Perforated interval ^b (ft)	Sand-pack interval (ft)	Approximate flow rate (gpm)	Activation priority ^c
<i>TFG-1 Area</i>								
<i>Extraction location 16</i>								
MW-464	P-16-1A	30-Sep-88	253.0	104.5	96-104.5	89-105	2	1
TBI	P-16-1B	-	(170)	(140)	(130-140)	(128-140)	(5)	13
TBI	P-16-1C	-	(130)	(105)	(100-105)	(98-105)	(2)	6
MW-111	P-16-1D	02-May-85	122.0	117.0	97-117	94-117	1	2
TBI	P-16-1E	-	(170)	(140)	(130-140)	(128-140)	(5)	7
TW-11A	P-16-1/2	16-Mar-84	163.0	160.0	133-160	121-163	6	3
TBI	P-16-2	-	(140)	(130)	(120-130)	(118-130)	(2)	8
TBI	P-16-4A ^d	-	(220)	(210)	(200-210)	(198-210)	(2)	16
TBI	P-16-4B ^d	-	(220)	(210)	(200-210)	(198-210)	(2)	14
TBI	P-16-4C ^d	-	(210)	(205)	(195-205)	(193-205)	(2)	15
<i>TFG-2 Area</i>								
<i>Extraction location 15</i>								
MW-307	P-15-1A	15-Dec-86	214.0	102.0	93-102	89-102	<1	4
MW-551	P-15-1B	18-Oct-88	308.0	155.5	151-155.5	148-155	20	5
TBI	P-15-1C	-	(125)	(120)	(110-120)	(108-120)	(1)	12
TBI	P-15-1D	-	(160)	(130)	(120-130)	(118-130)	(15)	10
TBI	P-15-1E	-	(125)	(120)	(110-120)	(108-120)	(1)	11
TBI	P-15-1F	-	(160)	(130)	(120-130)	(118-130)	(15)	9

Notes:

TBI = To be installed.

Estimates are shown in parentheses.

^a Piezometer names indicate their location as shown in Figure 2 (i.e., P-16-1A is at extraction location 16) and the hydrostratigraphic unit monitored (i.e., P-16-1A is screened in the first unit). Letters following the unit designation indicate that multiple piezometers are screened in that unit (i.e., P-16-1A, P-16-1B, etc.). Figure 4 shows planned piezometer locations.

^b The perforated interval listed for piezometers not yet installed is the perforated interval of the extraction well they are designed to monitor. These estimates are shown in parentheses. The actual perforated interval will be based on the hydrostratigraphy and chemistry encountered during drilling.

^c Piezometer activation is prioritized according to the activation of the associated extraction well(s).

^d These piezometers will be installed only if long-term pumping is necessary at EW-16-4.

water will be discharged to the storm sewer and will meet the discharge requirements specified in RWQCB Waste Discharge Requirement (WDR) Order No. 91-091 [National Pollutant Discharge Elimination System (NPDES) Permit No. CA 0029289] for discharge to the storm sewer (Appendix B). Alternatively, the discharge may be sent to the Recharge Basin under WDR Order No. 88-075 (Appendix B) if approved by the RWQCB. The treated water may also be used for onsite irrigation or in the LLNL cooling towers.

3.1. Specifications, Design, Treatability Tests, Controls, and Safeguards

The specifications, design, treatability tests, controls, and safeguards for TFG-1 and TFG-2 and associated piping are described in Sections 3.1.1 through 3.1.3.

3.1.1. Specifications and Design

TFG-1 and TFG-2 are each designed to treat 30 gpm of ground water at the expected influent concentrations, although the air stripper is capable of treating flows up to 45 gpm. As cleanup progresses and VOC concentrations decrease, the system can then treat greater flows. LLNL engineers will evaluate each treatment system during operation to determine the optimal flow rate by monitoring VOC concentrations versus air/water flow ratio. Initially, TFG-1 and TFG-2 will operate during working hours, until 24-h/day operation is logistically feasible. VOCs and possibly chromium are the constituents to be remediated at TFG-1 and TFG-2. Design influent concentrations and effluent discharge requirements are shown in Table 3. The design VOC influent concentrations are based on recent data (April 1994) from wells in the newly defined extraction locations, and differ slightly from the estimated total VOC influent concentrations in the RAIP (Dresen *et al.*, 1993) and FS (Isherwood *et al.*, 1990). Average influent concentrations were determined by calculating the mass removal rates for individual constituents from each well, and dividing the cumulative mass removal rate from all wells by the combined estimated influent flow rate. Sitewide total chromium and hexavalent chromium data indicate that virtually all of the total chromium, which may be naturally occurring in the LLNL vicinity, is hexavalent.

The process equipment at TFG-1 and TFG-2 will be designed to prevent inorganic ground water constituents from causing excessive system component degradation. The materials used are not affected by the low VOC concentrations or inorganic ground water constituents. Scaling can generally be controlled by routine cleaning. If necessary, acid, carbon dioxide, sequestering agents, or other methods will be used to control scaling. Table 4 presents average inorganic chemistry data, collected since 1988, for TFG-1 and TFG-2.

RWQCB WDR Order Nos. 91-091 and 88-075 (Appendix B) limit effluent concentrations to 5 ppb total VOCs (Table 3). Effluent concentrations for hexavalent chromium are limited to 11 and 500 ppb in WDR Order Nos. 91-091 and 88-075, respectively (Table 3). Bay Area Air Quality Management District's (BAAQMD) Best Available Control Technology (BACT) guidelines (BAAQMD, 1992) are met if VOC emissions to the atmosphere are less than 6 parts per million on a volume per volume basis ($\text{ppm}_{\text{v/v}}$). BAAQMD issued an "Authority to Construct" for TFG-1 and TFG-2 on March 17, 1994.

Table 3. TFG-1 and TFG-2 design influent concentrations (as of April 1994).

Constituent	Concentration (ppb)			
	TFG-1 average influent	TFG-2 average influent	WDR Order No. 91-091 effluent discharge requirements	WDR Order No. 88-075 effluent discharge requirements
PCE	13	22	4	5 ^a
TCE	38	17	5 ^a	5 ^a
1,1-DCE	11	1	5 ^a	5 ^a
1,2-DCE (total)	<1	2	5 ^a	5 ^a
1,1,1-TCA	3	<1	5 ^a	5 ^a
Carbon tetrachloride	12	1	5 ^a	5 ^a
Chloroform	15	4	5 ^a	5 ^a
Freon 113	7	3	5 ^a	5 ^a
Total VOCs	99	50	5 ^b	5 ^b
Total chromium	21	9	50	1,700
Hexavalent chromium	— ^c	<10	11	500

^a There are no individual discharge limits for these VOCs, but they are included in WDR Order Nos. 91-091 and 88-075 under the 5 ppb total VOC discharge limit.

^b Total VOC discharge limit as specified in WDR Order Nos. 91-091 and 88-075.

^c Hexavalent chromium data are not available.

Table 4. TFG-1 and TFG-2 inorganic ground water chemistry influent concentrations since 1988.

Constituent/parameter	Average influent concentration (ppm)	
	TFG-1	TFG-2
pH	7.6 (pH units)	7.6 (pH units)
Sodium	68	73
Calcium	57	68
Magnesium	24	30
Bicarbonate	320	407
Chloride	39	66
Nitrate	34	19
Sulfate	43	31
Potassium	2	2
Carbonate	<0.6	<0.6
Total dissolved solids	497	519
Iron	<0.05	<0.04
Manganese	<0.05	<0.04

The specifications and design for TFG-1 and TFG-2 are discussed below. The equipment specifications are presented in Table 5. Location plans and a P&ID are presented as Plates 1 and 2*, respectively.

Table 5. TFG-1 and TFG-2 equipment specifications.

Equipment	Specifications
TFG-1/TFG-2 Building	Cargo-type shipping container, 19.5- × 7.8- × 7.8-ft inside dimensions
Stainless steel extraction well pumps	Grundfos model numbers 5S05-9, 10S05-9, 16S10-10, 25S20-11, or equivalent. Well MW-560 has a Grundfos 16S10-10, 1 horsepower (hp) pump capable of 14 gallons per minute (gpm) at 250-ft head. A Grundfos 5S05-9, 0.5-hp pump, is capable of 4 gpm at 200-ft head; Grundfos 10S05-9, 0.5-hp pump, is capable of 8 gpm at 200-ft head; and Grundfos 25S20-11, 2-hp pump, is capable of 20 gpm at 250-ft head
Influent pipeline from extraction wells to TFG-1/TFG-2	Schedule 80 polyvinyl chloride, 1- to 3-in. inside diameter, doubly contained pipe where visual access is not possible
Leak detection system for doubly contained underground piping to extraction wells that cannot be visually inspected (if needed)	As required, Trace Tek 300 Longline system, Raychem Corporation, or equivalent
Particulate filter canister	Cuno Model No. 12 DC3, stainless steel, 230-gpm maximum, or equivalent, 150 psi maximum operating pressure at 200°F
Particulate filter cartridges	Cellulose cartridges or equivalent nominal 5-micron filter
Air stripper	Shallow-tray Model No. 2331, 45 gpm maximum flow rate, 300 cubic feet per minute (cfm) maximum at 18-in. water column, inlet screen and damper, 316L stainless steel demister or equivalent. Supply blower is an American Fan Co., A. F. Model VP-1-06-18.5A, 5 hp, 3,500 revolutions per minute (rpm), 3 phase, 208 volts alternating current, totally closed fan-cooled motor or equivalent
Stripper sump level control sensor (if needed)	MTS magnetic level sensor or equivalent
Discharge pump and motor	Bell and Gossett pump Series 15120-11/2 BC, 3-5 hp, 1,750 rpm, 208 volts alternating current, 60 hertz, 3-phase motor with 5 to 45 gpm at 100-ft total dynamic head, or equivalent
Variable speed control unit (if needed)	Yokogawa single loop PID controller, or equivalent, to control flow from 5 to 50 gpm
Variable frequency drive (if needed)	Baldor series 15 variable frequency drive inverter or equivalent
Vapor phase GAC	Carbtrol Model No. G3S (steel), 140 lb carbon, 4.5 in. water at 450 cfm, or equivalent, 4-in. inlet/outlet connections
Ion-exchange canister (if needed)	Purolite A-600, or equivalent ion-exchange resin, or equivalent technology
pH adjustment and monitor (if needed)	Acid or carbon dioxide system, or equivalent method
Programmable logic controller	486 personal computer with Paragon control software and OPTO-22 I/O, or equivalent
Water flow meters	Krohne Magmeter Model No. IFM1080K with wafer process connections, 24 volts direct current power supply and transmitter, flow range as appropriate for the individual extraction well
Submersible pressure transducers	Model PS9000, or equivalent, 4- to 20-milliamp output, pressure range as appropriate for the individual extraction well

* Plates 1 and 2 are located in a pocket inside the back cover of this report.

TFG-1 and TFG-2 will be enclosed in insulated cargo-type shipping containers. The shipping container will comply with Uniform Building Code (UBC) requirements and/or DOE general design criteria 6430.1A, whichever is more stringent. The foundation for the shipping container will consist of either asphaltic concrete paving, or 6 in. of base rock, or grading of the existing surface to support the full weight of the shipping container. For maintenance access, there will be a roll-up door along the end of the shipping container and a standard doorway on one side.

From the wellheads, ground water will be pumped to TFG-1 and TFG-2 through 1- to 3-in. inside-diameter polyvinyl chloride pipe. Influent piping that cannot be visually monitored will be instrumented with a leak detection system in double-contained pipe. This system will be a Trace Tek 300 Long Line System, manufactured by Raychem Corporation, or equivalent, that is monitored and alarmed at TFG-1 and TFG-2. This system will detect aqueous fluids at any point along the cable's length, alarm the system, and indicate the distance from the treatment facility to the leak. Ground water will then enter a five-micron filtration system to remove suspended particles from the ground water. From the filtration system, ground water will flow to the air stripper. The aeration process will reduce VOCs in the water to concentrations less than or equal to the discharge limit of 5 ppb. The air stripper will be a commercially available Shallow-tray Model No. 2331, or equivalent.

The supply air for aeration will come from a single blower. The air stripper is available with only one size blower that is expected to have an output of approximately 300 cubic feet per minute (cfm) with a pressure of 18 in. water column. The blower is a component of the air stripper package.

Once removed from the water, the VOCs will be exhausted from the air stripper and pass through a single GAC canister, where the VOCs will be adsorbed to the carbon. The GAC will adsorb volatilized VOCs such that no VOCs will be emitted to the atmosphere above the 6 ppm_{v/v} BAAQMD limit. The GAC canister contains 140 lbs of carbon with a 4.5-in. pressure drop at 450 cfm flow. Effluent VOC concentrations from the GAC will be measured by an organic vapor analyzer photoionization detector (PID) or flame ionization detector (FID). GAC will be replaced as needed to remain in compliance with the 6 ppm_{v/v} BAAQMD limit. The GAC will be delivered to the LLNL Hazardous Waste Management Division (HWMD) for regeneration or offsite disposal at a Resource Conservation and Recovery Act (RCRA)-permitted facility.

The sump of the air stripper will contain the level controls for the discharge pump (Plate 2). The level control system will consist of high and low level switches that alternate turning the discharge pump on and off, respectively. If needed for pH control, an alternate level control system will consist of a level-sensing device in the sump which, in a closed-loop feedback system, controls the speed of the stripping tank discharge pump to keep the water level in the tank constant. The water will then be pumped through an ion-exchange canister or chromium reduction unit, if necessary, and then to an approved discharge location.

Should chromium treatment become necessary, a commercially purchased ion-exchange unit with Purolite A-600 or equivalent anion-exchange resin, or a chromium reduction unit or

equivalent technology, will be added after the air stripper unit. The ion-exchange canister will be regenerated at another onsite facility as needed.

Treated water pH will be monitored monthly to determine if it exceeds the WDR Order No. 91-091 discharge limit range of 6.5–8.5. If pH adjustment is necessary, carbon dioxide, acid injection, or another method will be used.

3.1.2. Treatability Tests

To assist in the design of the skid-mounted treatment facilities, treatability tests were conducted with ground water from wells MW-464 (TFG Area) and MW-361 (TFD Area). Water from MW-464 was tested to design TFG-1 and TFG-2. Water from MW-361 was used to provide data for designing skid-mounted facilities that may be used anywhere at LLNL. Separate tests treated about 1,000 gal of ground water from these wells using a single shallow-tray air stripper. Six air-to-water ratios were used in batch tests to evaluate the air stripper performance. Test results are shown in Tables 6 and 7.

Table 6. Air stripper treatability test results for MW-464^a.

Air/water flow ratio (cfm/gpm)	Water flow rate (gpm)	TCE	PCE	Chloroform	Carbon tetrachloride
		<-----Concentration (ppb)----->			
0	—	23 ^b	9.3 ^b	20 ^b	9.3 ^b
5.75	45	<0.4	<0.4	<0.4	<0.4

^a Analyses performed by LLNL's onsite laboratory.

^b Concentrations at a zero air/water flow ratio represent the highest influent concentration reported from all the batch tests using water from this well.

Table 7. Air stripper treatability test results for MW-361^a.

Air/water flow ratio (cfm/gpm)	Water flow rate (gpm)	TCE	PCE	1,2-DCA	1,1-DCE	cis-1,2-DCE
		<-----Concentration (ppb)----->				
0	—	1,552 ^b	323 ^b	59 ^b	75 ^b	5.3 ^b
5.59	45	14	0.6	17	<0.4	<0.4
9.67	30	1.4	<0.4	3.2	<0.4	<0.4
15.5	20	<0.4	<0.4	<0.4	<0.4	<0.4

^a Analyses performed by LLNL's onsite laboratory.

^b Concentrations at a zero air/water flow ratio represent the highest influent concentration reported from all the batch tests using water from this well.

The results of the treatability test using ground water from well MW-464 were used to design TFG-1 and TFG-2. TCE, PCE, carbon tetrachloride, and chloroform concentrations were plotted as a function of the total blower air injected in cubic feet per minute of air per gallon per minute of water (ft³/gal or cfm/gpm). The results were used to determine the required air/water ratio for treating these constituents to concentrations below the 0.5 ppb detection limit (Fig. 8).

TCE was chosen to determine the air/water ratio because it occurs in the highest concentration in the TFG Area. The analytic detection limit of 0.5 ppb was used as the design criterion to provide a safety factor of ten relative to the 5 ppb discharge limit. The treatability test results indicate that a ratio of about 6 cfm/gpm is sufficient to reduce TCE concentrations below the detection limit of 0.5 ppb (Fig. 8). At an average influent flow rate of 30 gpm, the required air flow rate is 30 gpm multiplied by 6 cfm/gpm, or 180 cfm.

The results of the treatability test using ground water from well MW-361 (TFD Area) were used to determine the minimum skid-mounted system design capable of treating ground water containing VOCs throughout the Livermore Site. TCE, 1,2-dichloroethane (1,2-DCA), and PCE concentrations were plotted as a function of the total blower air injected in ft³/gal or cfm/gpm. The results were used to determine the required air/water ratio for reducing these constituents to concentrations below the 0.5 ppb detection limit (Fig. 9).

TCE and 1,2-DCA were used to determine the air/water ratio in Figure 9. TCE is the most widespread contaminant of concern at the Livermore Site and has the highest reported concentrations (Thorpe *et al.*, 1990). The analytic detection limit of 0.5 ppb was used as the design criterion to provide a safety factor of ten relative to the 5 ppb discharge limit. The treatability test results indicate that a ratio of about 15 cfm/gpm is required to reduce TCE and 1,2-DCA concentrations below the 0.5 ppb detection limit (Fig. 9). At an average influent flow rate of 20 gpm, the required air flow rate is 20 gpm multiplied by 15 cfm/gpm, or 300 cfm.


The results from the treatability tests indicate that by varying the ground water flow rate and air-to-water ratio, TFG-1 and TFG-2 will effectively remediate the low VOC concentrations in the TFG Area, as well as higher VOC concentrations at other locations at the Livermore Site based on data from MW-361.

3.1.3. Controls and Safeguards

TFG will be designed to be fail safe; i.e., the failure of any component, energy source (mechanical or electrical), or loss of control signal will cause the system to shut down safely. Commercial systems purchased for TFG-1 and TFG-2 will be provided with built-in safety interlocks, which will be verified independently by LLNL. TFG-1 and TFG-2 will be equipped with an interlock control system (Plate 2). If one of the components listed below malfunctions, the entire system, including the associated extraction well pumps, will automatically shut down. The operator will be notified of a shutdown by a visual alarm. The operator must determine and correct the problem before the system can be manually restarted.


A system shutdown involves de-energizing the following equipment:

- Well pumps.
- Blower.
- Discharge pump.
- Ion-exchange unit, if necessary.
- Chemical injection pumps or carbon dioxide injection, if scale control and/or pH control are operating.

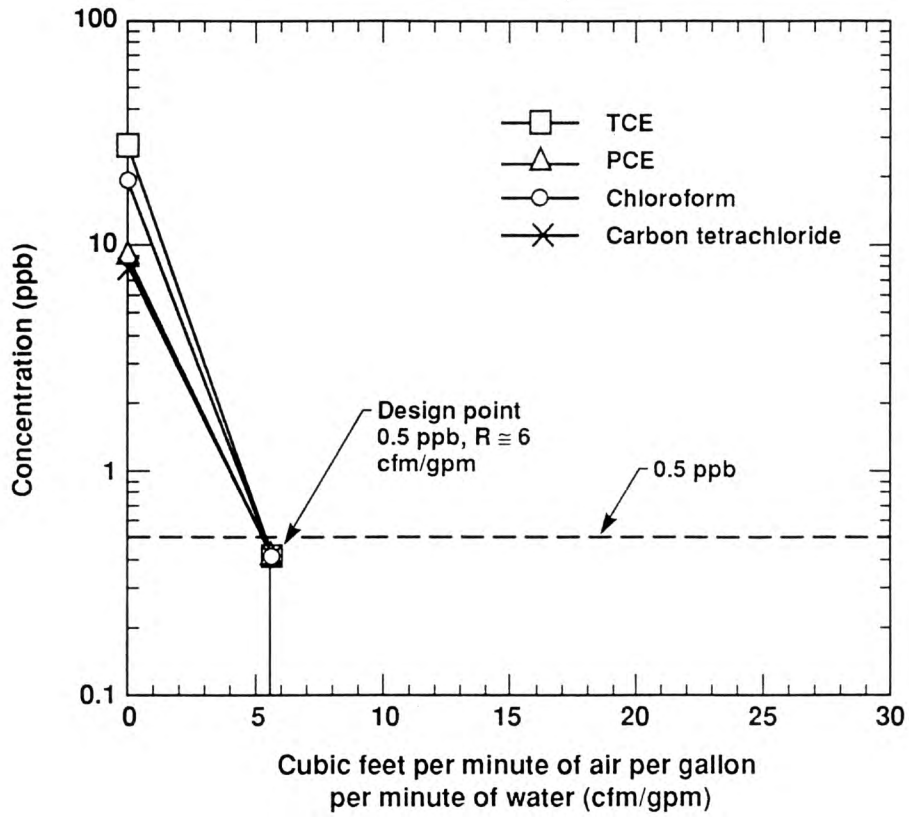

RD5 Fig 08

Figure 8. TFG-1 and TFG-2 airflow design graph using ground water from MW-464.

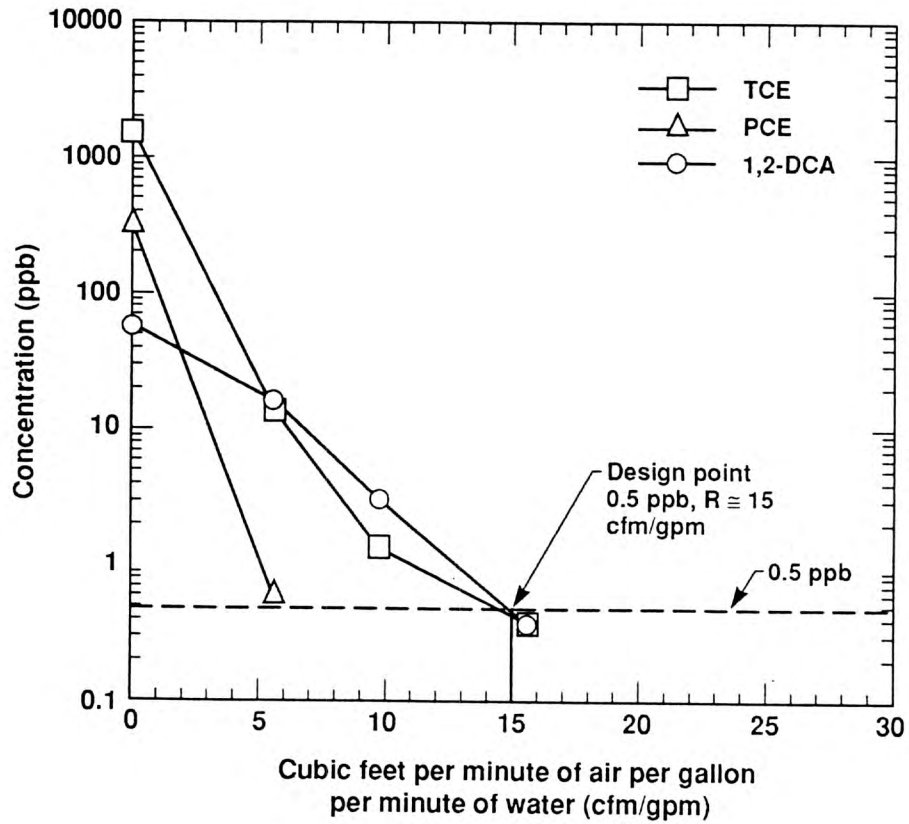

RD5 Fig 09

Figure 9. General skid-mounted facility airflow design graph using ground water from MW-361.

A system shutdown would be initiated by the following interlocks:

- Low water level in the wells or low flow rate through the facility.
- Low air pressure through the air stripper.
- High air pressure through the air stripper.
- High water flow rate through the facility.
- pH out-of-range, as sensed by final effluent pH monitor (if needed).
- Loss of power to control and instrumentation.
- Leak detected within inaccessible pipelines, if installed.
- High water level in air stripper sump.

In addition, all aboveground pipelines will be visually monitored for leaks on a daily basis. Underground pipelines will be doubly contained with a leak detection system installed inside the outer pipe.

3.2. Discharge of Treated Ground Water

Ground water treated at TFG-1 and TFG-2 will be discharged to a storm drain. If acceptable to the RWQCB, the treated water may be discharged under the existing permit to the LLNL Recharge Basin located south of East Avenue. The treated water may also be used for onsite irrigation or in LLNL cooling towers to help reduce the amount of water imported to LLNL.

As discussed in Section 4.2.1, self-monitoring receiving water samples will be collected from the body of water receiving the discharge. Analyses of receiving water samples will be conducted according to the specifications in WDR Order Nos. 91-091 or 88-075 (Appendix B).

3.3. Construction and Startup Schedules and Cost Estimates

3.3.1. Schedules

Technology evaluations and conceptual designs for TFG-1 and TFG-2 are being conducted by ERD. Following completion of the conceptual design, LLNL Plant Engineering will complete the final design that will be used for construction. Construction of TFG-1 will begin in December 1995 (Table 8) and the facility is scheduled to be operational by April 18, 1996; construction of TFG-2 will begin March 1999 (Table 9) and the facility is scheduled to be operational by August 2, 1999 (Revised Table 5 in Dresen *et al.*, 1993).

Table 8. TFG-1 design and construction schedule.

Item	Start	End
TFG-1 design	5/95	9/95
TFG-1 construction	12/95	3/96
TFG-1 activation	3/96	4/18/96

Table 9. TFG-2 design and construction schedule.

Item	Start	End
TFG-2 design	8/98	12/98
TFG-2 construction	3/99	7/99
TFG-2 activation	7/99	8/2/99

3.3.2. Cost Estimates

The estimated costs for design, construction, and O&M of TFG-1 and TFG-2 are shown in Table 10. The cost associated with TFG-1 and TFG-2 skid construction in Table 10 includes site preparation, design and construction for the initial influent and effluent pipelines, facility power, and power to the wellheads.

The cost associated with the air stripping equipment includes the air stripper, blowers, in-line water filters, effluent GAC, air stripping tank discharge pump and control, and if needed, the pH adjustment metering pump and control.

The cost of the ion-exchange units, if needed, are included in Table 10. The estimated cost includes the commercially purchased ion-exchange unit, which includes all pumps, piping, tanks, and control hardware.

4. Remedial Action Workplan

The Remedial Action Workplan for TFG-1 and TFG-2 includes QA/QC plans and HASPs for construction, operation, and maintenance. Included also are monitoring and reporting programs, requirements for onsite storage and offsite shipment of hazardous waste, and procedures for facility and well closure. As discussed in the RAIP (Dresen *et al.*, 1993), DOE/LLNL have updated the Community Relations Plan (CRP) for the post-ROD period. The Revised CRP was issued in July 1993 (Anderson *et al.*, 1993).

4.1. Quality Assurance/Quality Control and Health and Safety Plans

The QA/QC Plan and the HASP for construction are applicable to all treatment facilities and were presented as Appendices B and C of RD1, respectively (Boegel *et al.*, 1993).

The QA/QC Plans for O&M of TFG-1 and TFG-2 are presented in Appendix C. These plans describe the organizational structure, responsibilities, and authority for O&M QA/QC, and the objectives, quality goals, and QA levels for O&M of TFG-1 and TFG-2. Appendix D contains the HASPs for O&M of TFG-1 and TFG-2. These plans present (1) hazard analyses and control measures and training requirements for TFG-1 and TFG-2 O&M, and (2) emergency safety procedures.

4.2. Monitoring and Reporting

The following sections discuss planned monitoring and reporting for TFG-1 and TFG-2. The programs include self-monitoring required by the RWQCB, ground water quality sampling,

Table 10. TFG-1 and TFG-2 cost summary.

Item	Cost	Annual O&M ^a	53-year cleanup O&M ^a
TFG-1 skid (including design, construction, and process equipment)	\$268,116	—	—
Site preparation (including piping, power, and wellhead construction)	235,942	—	—
Ion-exchange units (if needed)	26,812	—	—
Activation cost	42,899	—	—
12% MPC ^b	68,852	—	—
<i>Subtotal</i>	642,621	—	—
TFG Operations & Maintenance:			
Labor:			
ERD personnel ^c	—	\$287,635	\$9,060,496
HWM ^d	—	6,435	341,055
Plant support	—	32,174	1,705,222
<i>Subtotal</i>	—	326,244	11,106,773
Materials:			
Extraction wells	—	2,574	136,422
Ion-exchange resin (if needed)	—	3,754	198,962
Pumps	—	257	13,621
Filters	—	3,861	204,633
Carbon housing	—	1,609	85,277
Blower	—	257	13,621
Holding tanks	—	5,148	272,844
pH metering (if needed)	—	5,791	306,923
Miscellaneous piping	—	1,287	68,211
Miscellaneous electronics	—	643	34,079
Sample analyses	—	25,739	1,364,167
HWM ^d	—	142,337	7,543,861
12% MPC ^b	—	6,110	323,851
<i>Subtotal</i>	—	199,367	10,566,472
16% G&A/LDRD ^e charge	102,819	84,098	3,467,726
<i>TFG-1 Cost^a</i>	\$745,440	\$609,709	\$25,140,971
<i>TFG-2 Cost^f</i>	\$815,295	\$683,206	\$28,171,525
Total Cost	\$1,560,735	\$1,292,915	\$53,312,496

^a Estimated TFG-1 cost is in Fiscal Year 1996 dollars.

^b Material Procurement Charge.

^c ERD personnel labor estimates include hydrogeologist, chemist, engineer, technician, and analyst time to meet the requirements in the ROD and milestones in the RAIP. The 53-year cleanup cost reflects time for these staffs to maintain and improve treatment systems, effectively manage the wellfield as conditions change over the life of the cleanup, and evaluate and potentially implement new cleanup technologies as they are developed in the future. The estimated cost for ERD personnel is based on a constant level of effort for the first 5 years of the cleanup, about 83% of that effort for years 6 through 10, about 67% of that effort for years 11 through 15, and half the initial effort for years 16 through 53.

^d LLNL Hazardous Waste Management.

^e General and Administrative/Laboratory Directed Research and Development cost.

^f Estimated TFG-2 cost is in Fiscal Year 1999 dollars and is adjusted from TFG-1 cost to include inflation and variations in piping to the extraction wells.

capture zone monitoring, preliminary criteria for determining when remediation is complete, and requirements for system closeout.

QA/QC procedures for collection, analysis, and documentation of influent and effluent ground water samples are included in the LLNL Quality Assurance Project Plan (Rice, 1989), which was prepared according to EPA guidance and was approved by EPA. In addition, the procedures for collection, analysis, and documentation of water samples are described in LLNL Standard Operating Procedures (SOPs) (Rice *et al.*, 1990) Nos.: 2.6, Sampling for Volatile Organic Compounds; 4.1, General Instructions for Field Personnel; 4.2, Sample Control and Documentation; 4.3, Sample Containers and Preservation; 4.4, Guide to Handling, Packaging, and Shipping of Samples; 4.6, QA/QC Requirements for Data Generated by Analytical Laboratories; and 4.8, Calibration and Maintenance of Field Instruments Used in Measuring Parameters of Surface and Ground Water and Soils. The procedures for sample collection at TFG-1 and TFG-2 are presented in Appendix E.


A Draft Compliance Monitoring Plan is scheduled for issuance by August 30, 1995, which will describe the data types and interpretive methods to be used for the duration of the cleanup. Until then, DOE/LLNL will prepare ground water contour and capture zone maps, and report flow, concentrations, and mass removal for each operating extraction well on a quarterly basis. This information will be included in the corresponding *LLNL Livermore Site Ground Water Project Monthly Progress Report* until the Compliance Monitoring Plan is final. At that time, reporting frequency and mechanism may change.

4.2.1. Treatment Facility Self-Monitoring Programs

The TFG-1 and TFG-2 self-monitoring programs will satisfy the requirements of RWQCB WDR Order No. 91-091 (NPDES Permit No. CA 0029289) for discharge to the storm sewer, or if acceptable to the RWQCB, WDR Order No. 88-075 for discharge to the Recharge Basin (Appendix B). Water samples will be collected at TFG-1 and TFG-2 sampling stations (Fig. 10) prior to discharge to the storm sewer, according to the schedule presented in Table 11. Water discharged to the Recharge Basin would be sampled according to the schedule presented in Table 12; Recharge Basin sample locations are shown on Figure 11. Results of TFG-1 and TFG-2 self-monitoring activities will be reported in the *LLNL Livermore Site Ground Water Project Monthly Progress Reports*.

TFG-1 and TFG-2 influent samples, TFG1-I007-1 and TFG2-I007-2, respectively, will be collected immediately prior to treatment. TFG-1 and TFG-2 effluent samples TFG1-E007-1 and TFG2-E007-2, respectively, will be collected following treatment and prior to discharge (Fig. 10). Receiving water samples will be collected from the body of water receiving the discharge.

A PID or FID will be used to determine if any residual compounds of concern remain in the air effluent stream at both TFG-1 and TFG-2 per BAAQMD requirements. The PID uses ultraviolet light to ionize a vapor sample and measure the organic constituents within the vapor. The PIDs used at LLNL are organic vapor meters equipped with 10.0-electron volt lamps and detect double- and triple-bonded molecules. The FID uses the same principle as the photoionization detector, but a flame is used to ionize the vapor sample. LLNL uses Foxboro/Century organic vapor analyzers equipped with FIDs. These instruments can detect

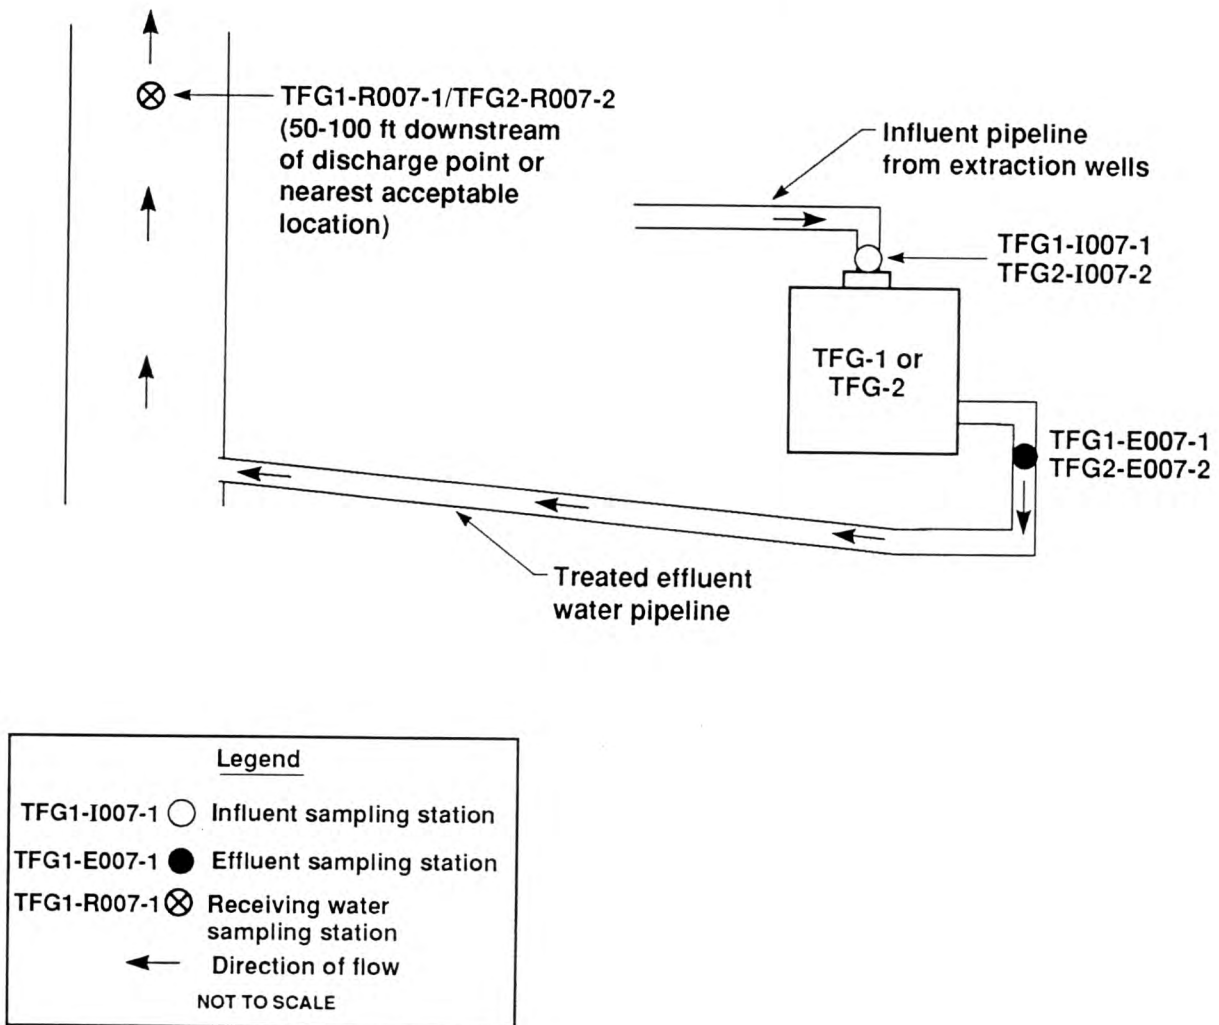

RD5 Fig 10

Figure 10. Schematic diagram of TFG-1 and TFG-2 NPDES self-monitoring program sampling stations.

Table 11. WDR Order No. 91-091 self-monitoring sampling schedule.

Sample location ^a	Influent ^a		Effluent ^a		Receiving water ^a		Land observations ^b
	TFG1-I007-1	TFG2-I007-2	TFG1-E007-1	TFG2-E007-2	TFG1-R007-1	TFG2-R007-2	
Frequency	Analysis						
Daily	Flow rate		Flow rate		Flow rate		—
Weekly	—		EPA 601 ^c		—		Perform
			Hexavalent chromium ^d				
Monthly	EPA 601 ^c pH		Temperature pH		EPA 601 ^c Temperature pH		Complete report
Quarterly	Chlorides		Chlorides		Chlorides		
			Fish toxicity ^e				
			Turbidity ^f				
Semiannually	Metals ^g		Metals ^g		Metals ^g		—
					Fish toxicity ^e		
					Turbidity ^f		
Annually	EPA 624 ^{h,i} EPA 625 ^k		EPA 624 ^{h,i} EPA 625 ^k		EPA 602 ^j EPA 625 ^k		—
			Gross alpha and beta particles, and tritium		Gross alpha and beta particles, and tritium		

RWQCB specifications:

- Sampling of receiving water should be coincident with influent and effluent water sampling.
- If any instantaneous maximum limit is exceeded, the sampling frequency shall be increased to daily until two samples collected on consecutive days comply with the instantaneous maximum.

^a Sample locations are shown in Figure 10.

^b As required by RWQCB NPDES Permit No. CA 0029289, WDR Order No. 91-091.

^c EPA 601 = EPA Method 601; analysis for volatile halocarbons by gas chromatography.

^d Weekly monitoring for hexavalent chromium will be conducted for the first three months of initial operation. At that point, the performance of the treatment systems will be reviewed, and the monitoring schedule will be re-evaluated.

^e Fish toxicity, survival rate for 96 hours in undiluted waste.

^f Jackson turbidity units.

^g Priority Pollutant Metals:

antimony	chromium (total)	mercury	silver
arsenic	copper	nickel	thallium
beryllium	lead	selenium	zinc
cadmium			

PLUS: boron, chromium (VI), iron, manganese, and cyanide.

^h When schedule calls for coincident EPA Method 601 and 624 analyses, only EPA 624 is conducted.

ⁱ EPA 624 = EPA Method 624; analysis for volatile organic compounds by gas chromatography/mass spectrometry.

^j EPA 602 = EPA Method 602; analysis for volatile aromatic hydrocarbons by gas chromatography.

^k EPA 625 = EPA Method 625; analysis for semivolatile organic compounds by gas chromatography/mass spectrometry.

Table 12. WDR Order No. 88-075 self-monitoring sampling schedule.

Sample location ^a	Influent ^a TFG1-I007-1 TFG2-I007-2	Effluent ^a TFG1-E007-1 TFG2-E007-2	Recharge Basin ^a TFA-C1E/C1W and TFA-C2E/C2W	Land observations ^b
Frequency ^b	Analysis			
Daily	Flow rate	Flow rate	—	—
Weekly	—	EPA 601 ^c	—	Perform
Monthly	EPA 601 ^c pH	Temperature pH	—	Complete report
Quarterly	Chlorides	Chlorides Fish toxicity ^d Turbidity ^e	Chlorides EPA 601 ^c	—
Semiannually	Metals ^f	Metals ^f	Metals ^f Gross alpha and beta particles, tritium Fish toxicity ^d	—
Annually	EPA 624 ^{g,h} EPA 625 ^j	EPA 624 ^{g,h} EPA 625 ^j Gross alpha and beta particles, tritium	EPA 602 ⁱ EPA 625 ^j	—

RWQCB specifications:

- Sampling of TFA-C1E/C1W and TFA-C2E/C2W should be coincident with TFG1-I007-1/TFG2-I007-2 and TFG1-E007-1/TFG2-E007-2 sampling.
- If any instantaneous maximum limit is exceeded, the sampling frequency will be increased to daily until two samples collected on consecutive days comply with the instantaneous maximum.

^a Sample locations shown in Figures 10 and 11.

^b As required by RWQCB WDR Order No. 88-075.

^c EPA 601 = EPA Method 601; analysis for volatile halocarbons by gas chromatography.

^d Fish toxicity, survival rate for 96 hours in undiluted waste.

^e Jackson turbidity units.

^f Priority Pollutant Metals:

antimony	chromium (total)	mercury	silver
arsenic	copper	nickel	thallium
beryllium	lead	selenium	zinc
cadmium			


PLUS: boron, chromium (VI), iron, manganese, and cyanide.

^g When schedule calls for coincident EPA Method 601 and 624 analyses, only EPA 624 is conducted.

^h EPA 624 = EPA Method 624; analysis for volatile organic compounds by gas chromatography/mass spectrometry.

ⁱ EPA 602 = EPA Method 602; analysis for volatile aromatic hydrocarbons by gas chromatography.

^j EPA 625 = EPA Method 625; analysis for semivolatile organic compounds by gas chromatography/mass spectrometry.

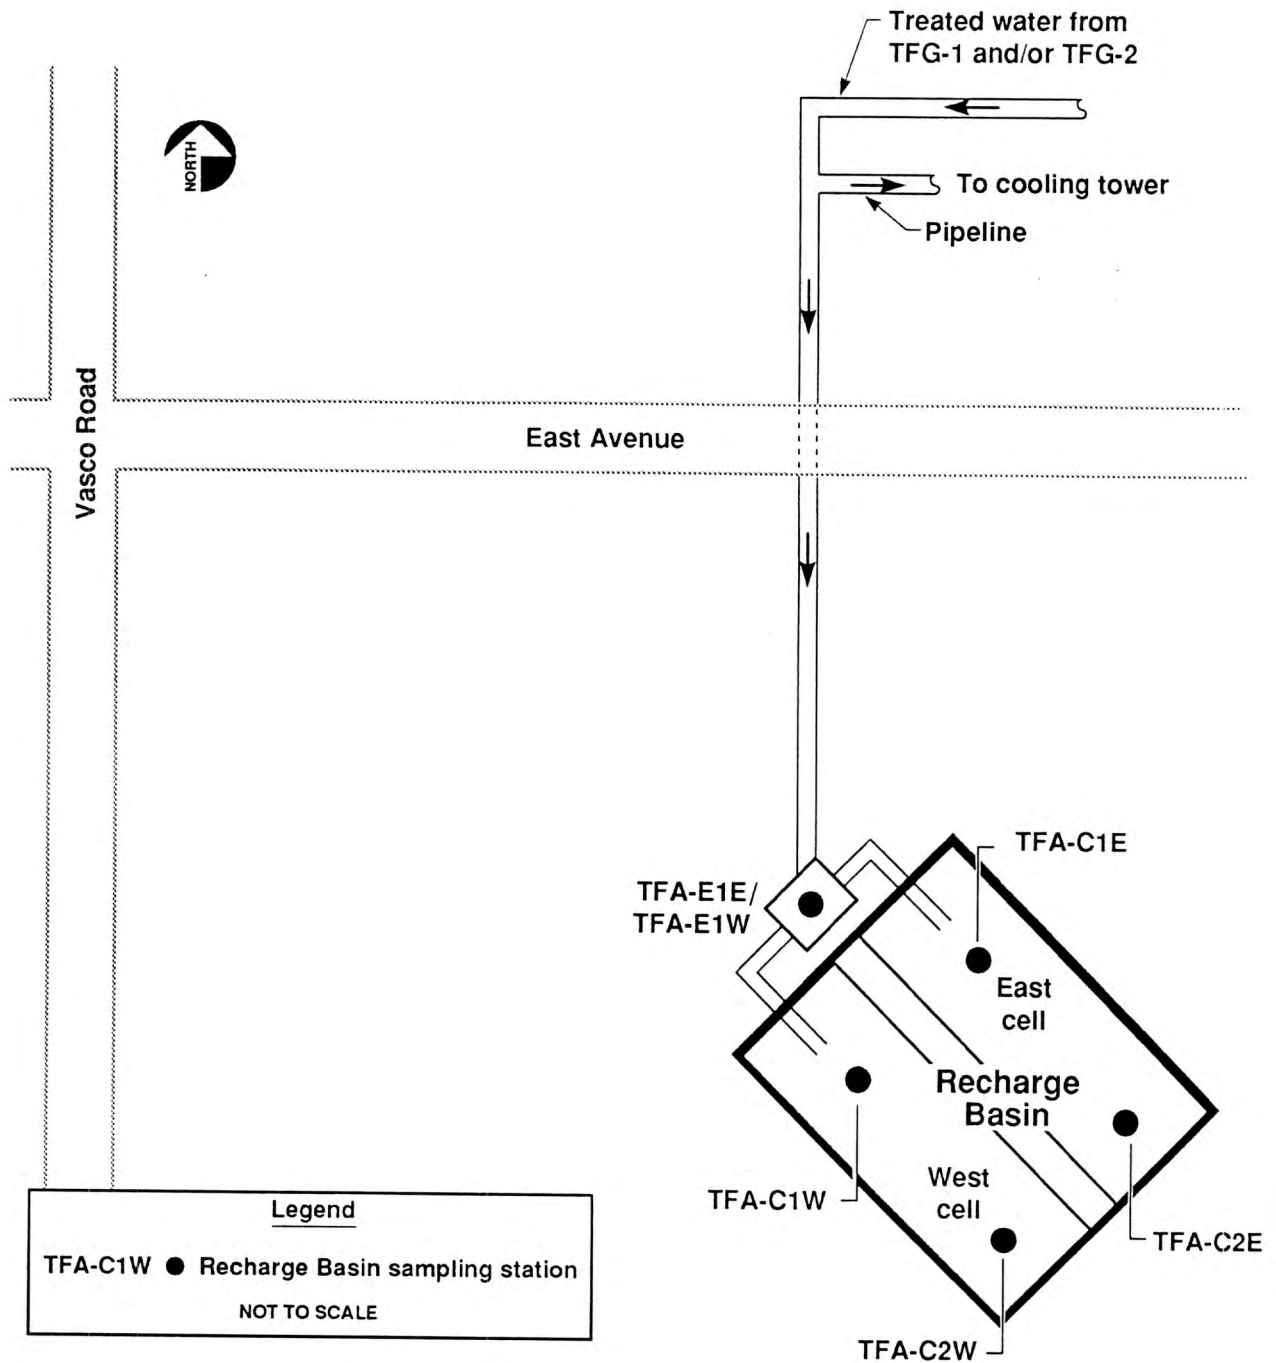

RD5 Fig 11

Figure 11. Locations of Recharge Basin self-monitoring program sampling stations.

compounds within a concentration range of 1 to 100,000 ppm_{v/v}. The detection limit for these instruments is about 1 to 2 ppm_{v/v}, sufficiently low to ensure compliance with the 6 ppm_{v/v} air discharge limits.

4.2.2. Ground Water Monitoring Sampling Schedule

Ground water samples will be collected from existing monitor wells and piezometers in the vicinity of TFG-1 and TFG-2, according to the schedule shown in Table 13. Ground water samples will also be collected quarterly for six consecutive quarters from new monitor wells and piezometers to monitor the progress of the cleanup. The subsequent sampling schedule may be changed quarterly according to the procedures detailed in McConachie (1993), as the distribution of contaminants in ground water changes.

Analytical results of monthly self-monitoring influent water samples collected at TFG-1 and TFG-2 will be used to evaluate remediation effectiveness and calculate VOC removal rates. The TFG-1 and TFG-2 influent samples will be analyzed for VOCs, semivolatiles, chlorides, and metals, according to the schedules presented in Tables 11 and 12.

Water levels in all monitor wells and piezometers will continue to be monitored on a monthly basis either manually or using pressure transducers and data loggers. Depth-to-water and pumping rates in extraction wells will be measured using pressure transducers and mechanical or electronic flow meters. The data will be automatically recorded using data loggers. These data will be used to estimate actual hydraulic capture zones and areas of little or no ground water movement. Based on hydraulic data, pumping locations and rates may be varied, and/or new extraction wells may be installed, to ensure complete hydraulic capture of the VOC plumes and the most expeditious remediation that funding allows.

Prior to issuing the Compliance Monitoring Plan, treatment system monitoring, chemical analytic results, and ground water elevation contour and capture zone maps will be presented on a quarterly basis in the corresponding *LLNL Livermore Site Ground Water Project Monthly Progress Reports*. Once the Compliance Monitoring Plan is final, reporting frequency and mechanism may change.

4.2.3. Extraction Well Pumping Strategy

Current simulations of long-term pumping and contaminant transport suggest that at least 50 years of sustained ground water pumping may be required to achieve remediation goals. Modeling results are summarized in Tompson (1990), Tompson *et al.* (1991), and Tompson *et al.* (in preparation). Extraction wells will initially be pumped at the maximum sustainable flow rates to achieve both rapid mass removal and the largest hydraulic capture zones possible. After steady state is achieved, monitoring data will be used to refine and update the ground water model. As these results and new data are interpreted, the wellfield configuration and pumping rates will likely be modified to optimize mass removal rates, maximize treatment and minimize dilution of contaminants, ensure hydraulic capture in all zones exceeding cleanup standards, and eliminate stagnation zones. Well condition will be periodically addressed by evaluating pumping rates, drawdown and water clarity. As required, extraction wells, monitor wells, and piezometers will be rehabilitated or replaced. These activities will be reported in the LLNL Monthly Progress Reports, as appropriate.

Table 13. Ground water sampling schedule for monitor wells and piezometers in the vicinity of TFG-1 and TFG-2 extraction wells.

Well name	Analyses	Sampling frequency	Planned months of sampling
MW-111	601	A	December
MW-146	601	A	September
MW-147	601, tritium	A	September
MW-148	601, tritium, Cr(VI)	A	September
MW-202 ^a	601	A	April
MW-253	601	Q	January, April, July, October
MW-307	601	S	January, July
MW-464	601	S	April, October
	Cr(VI)	A	October
MW-551	601	S	January, July
MW-560	601	A ^b	April
MW-618	601	A	June
TW-11	601	S	January, July
TW-11A	601	S	January, July

^a The well is currently dry.

^b If this well is used as an extraction well prior to issuing the Compliance Monitoring Plan, the sampling frequency will be increased to quarterly.

A = Annual.

S = Semiannual.

Q = Quarterly.

Cr(VI) = Hexavalent chromium.

601 = EPA Method 601 for halogenated VOCs.

Note: New piezometers and wells will be sampled quarterly for the first six consecutive quarters. Subsequent monitoring frequency will be based on VOC concentrations and the location within or relative to the plume.

Based on the results of LLNL pilot studies and data from other sites, the VOC concentrations in ground water are expected to decrease rapidly at first, then decrease very slowly or stabilize. Estimates of VOC removal over time at TFG-1 and TFG-2 are shown in Figures 12 and 13, respectively. The VOC removal rates were estimated using results from the two-dimensional, finite-element ground water flow and transport model CFEST (Tompson *et al.*, 1991; Tompson *et al.*, in preparation). The estimated volume of VOCs removed was calculated using a weighted average VOC density. Actual VOC removal rates will depend on the VOC concentrations in extracted ground water and long-term well yields.


Several methods may be used to maximize VOC removal rates, including cyclical pumping and reinjection of treated ground water, which may include the injection of heat, surfactants, microbes, or nutrients (Isherwood *et al.*, 1992). Laboratory and field studies may be conducted to evaluate the effectiveness of the methods used to enhance contaminant mobility and mass removal. Any method used to maximize mass removal rates would comply with State Water Resources Control Board Resolution No. 68-16, an ARAR for the Livermore Site, and would be implemented with regulatory approval.

In one approach, some LLNL extraction wells (i.e., those in former source areas with VOCs in the shallowest ground water) may be periodically shut off and the water levels allowed to recover. During the pump-off cycles, VOCs will desorb into the ground water from the sediments that were dewatered near the pumping wells. Cycling the pumps may increase VOC removal rates near former source areas, where most of the VOCs occur in the shallower water-bearing sediments. Different pump-on and pump-off cycles may be evaluated to determine the optimum periods of pumping and nonpumping to maximize VOC mass removal rates.

In another approach, reinjection of treated ground water may be used to increase the rate of flushing in regions of high VOC concentrations and to mitigate excessive dewatering that may result from ground water extraction. Reinjection of treated water in selected locations will enhance desorption of contaminants and increase the flushing rate in regions of slow ground water flow. The reinjection process may be enhanced by other means to increase the cleanup rate. If the water is heated prior to reinjection, VOCs will have a greater tendency to desorb from the sediments into the ground water than if the water is not heated. Similar benefits may arise if the reinjected water contains surfactants, which are compounds that increase the tendency for VOCs to dissolve in ground water. Such surfactants may be manufactured or microbially produced. If these or other methods are evaluated and shown to be beneficial and cost-effective, they will be implemented with regulatory agency approval. As discussed in the RAIP, all injection well locations will be within the capture area of an extraction well because the reinjected water may contain up to 5 ppb total VOCs.


4.3. Requirements for Onsite Storage and Offsite Shipment of Hazardous Waste

Particulate filters and GAC containing sorbed VOCs will be shipped offsite for regeneration or disposal, and will be managed as hazardous waste, if appropriate. GAC will be replaced as needed to remain in compliance with the BAAQMD air discharge limit of 6 ppm_{v/v}. LLNL can temporarily store hazardous waste onsite for up to 90 days. Shipment and disposal are in accordance with Department of Transportation (DOT) 49 Code of Federal Regulations (CFR)

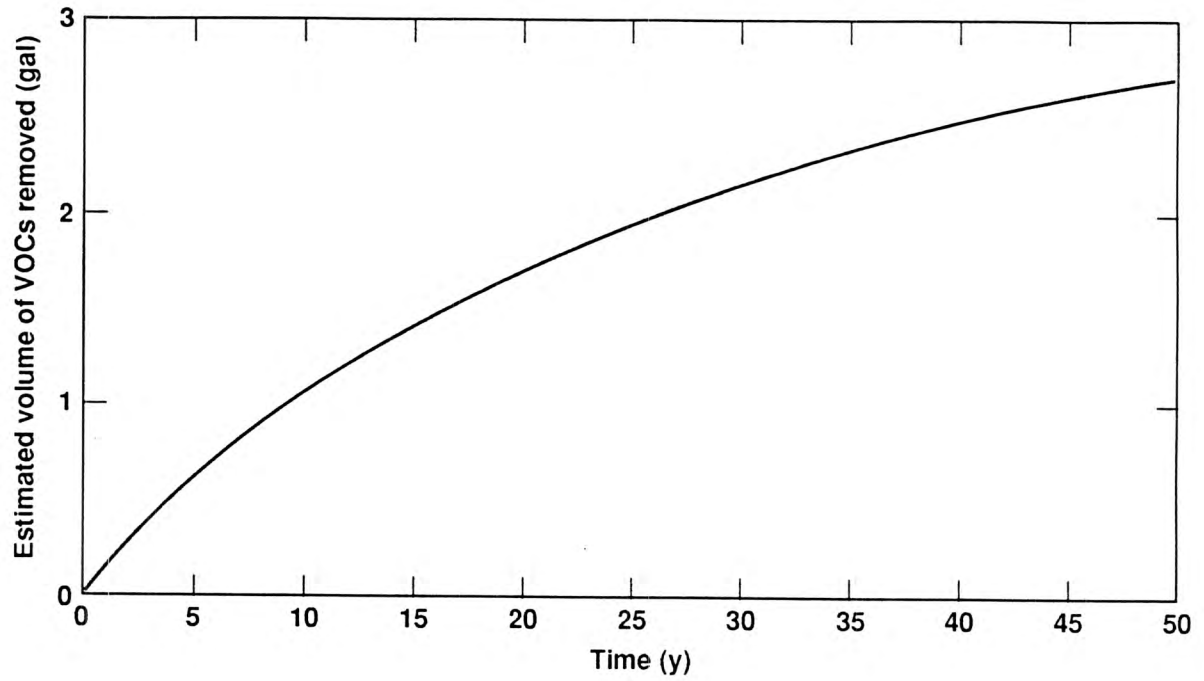

RD5 Fig 12

Figure 12. Cumulative volume of VOCs that may be removed from ground water by TFG-1 over time.

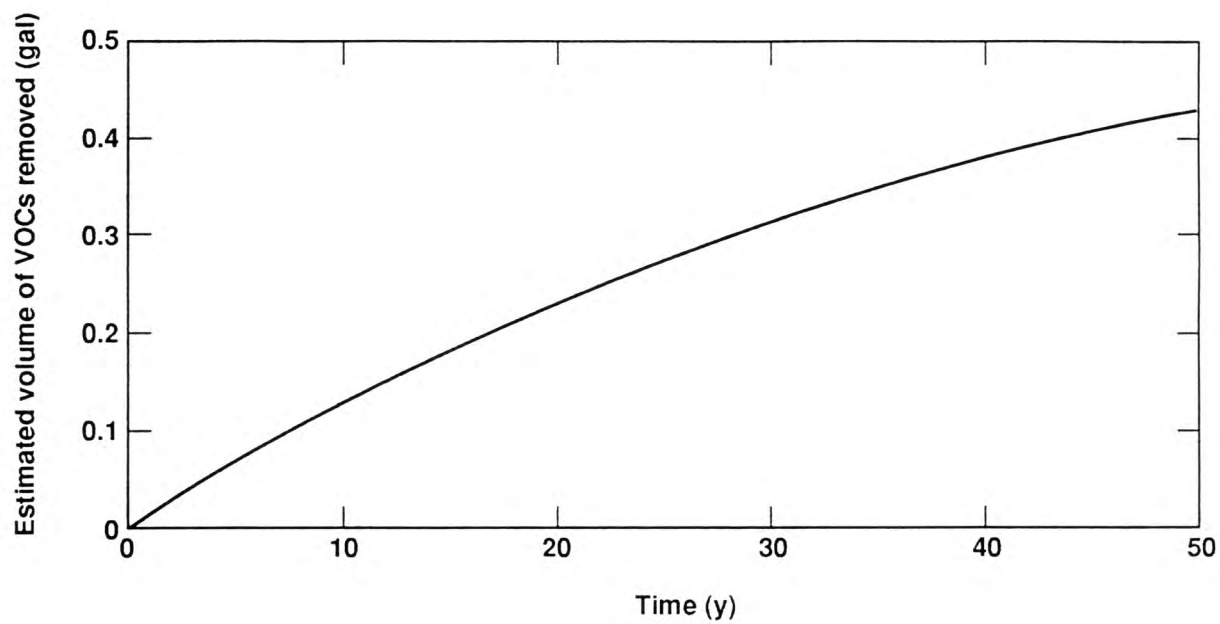

RD5 Fig 13

Figure 13. Cumulative volume of VOCs that may be removed from ground water by TFG-2 over time.

and EPA 40 CFR, respectively. Additionally, waste shipments are made according to California Code of Regulations, Title 22 requirements. The spent GAC will be packaged and labeled for shipment by LLNL's HWMD. HWMD operates under interim status and has submitted a RCRA Part B permit application to the DTSC. (California is a fully RCRA-authorized State.) Once packaged, the GAC will be shipped to one of several RCRA-permitted facilities for regeneration or disposal.

4.4. Requirements for Closeout

Decisions regarding when extraction should cease at specific wells and when a particular treatment facility and its influent extraction wells should be decommissioned will be discussed in the forthcoming Compliance Monitoring Plan. As specified in the ROD, sitewide cleanup will be complete when ground water samples from the plume demonstrate that negotiated ARARs are achieved.

VOC concentrations may rise in wells after extraction ceases due to slow desorption from fine-grained sediments. Therefore, contaminant concentrations will be monitored quarterly for 2 years after pumping ceases. If concentrations rise above cleanup levels, extraction will resume at the appropriate wells until cleanup levels are again achieved. Several pumping cycle iterations may be required to achieve the remediation standards. Cleanup will be considered complete when contaminant concentrations remain below the remediation standards for 2 years. Cleanup completion will be determined in conjunction with the regulatory agencies.

After concurrence with the regulatory agencies that cleanup is complete, most of the LLNL extraction wells and piezometers will be sealed and abandoned. All wells screened in more than one water-bearing zone will be sealed to prevent potential vertical migration of compounds of concern. Wells will be sealed by pressure grouting using a grout mixture of 98% Portland cement and 2% bentonite powder by weight, as described in LLNL SOP 1.7 (Rice *et al.*, 1990). Cement grout should extend to a depth of 2 to 3 ft below grade. Wellhead abandonment will include removal of any protective covers, instruments, concrete pads, etc., and the upper 2 to 3 ft will be filled with low-permeability soil to restore grade. A minimal monitoring network, consisting of perhaps 10 to 20% of the existing wells, will remain in place for general ground water quality monitoring. Most of these monitor wells will be located at former downgradient plume margins, site boundaries, and in former source areas.

After remediation is complete, TFG-1 and TFG-2 and their influent and discharge piping will be decontaminated, dismantled, and salvaged, or used at other locations at the Livermore Site. The portions of the process equipment and piping that contact ground water will not contain hazardous VOC concentrations because the equipment will have been thoroughly flushed with ground water containing VOC concentrations below MCLs. Any wash water containing hazardous materials will be collected, sampled, and disposed at one of several RCRA-permitted facilities. GAC with sorbed VOCs will be disposed according to the specifications described in Section 4.3 "Requirements for Onsite Storage and Offsite Shipment of Hazardous Waste."

5. References

5.1. References Cited

- Anderson, K., B. Heffner, and J. Ziagos (1993), *Revised Community Relations Plan for the Lawrence Livermore National Laboratory Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCAR-10249 rev 1).
- Bay Area Air Quality Management District (BAAQMD) (1992), *BACT Workbook, Guidelines for Best Available Control Technology*, San Francisco, Calif.
- Berg, L. L., M. D. Dresen, E. N. Folsom, J. K. Macdonald, R. O. Devany, R. W. Bainer, R. G. Blake, and J. P. Ziagos (Eds.) (1994), *Remedial Design Report No. 3 for Treatment Facilities D and E, Lawrence Livermore National Laboratory, Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-113880).
- Boegel, A. J., M. D. Dresen, E. Folsom, P. Thiry, and J. P. Ziagos (Eds.) (1993), *Remedial Design Report No. 1 for Treatment Facilities A and B, Lawrence Livermore National Laboratory Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-110576).
- Dresen, M. D., J. P. Ziagos, A. J. Boegel, and E. M. Nichols (Eds.) (1993), *Remedial Action Implementation Plan for the LLNL Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-110532) (page 43 revised September 2, 1993; Table 5 revised July 20, 1994).
- Dresen, M. D., W. F. Isherwood, and J. P. Ziagos (Eds.) (1991), *Proposed Remedial Action Plan for the Lawrence Livermore National Laboratory, Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-105577).
- Gill, M. (1993), Remedial Project Manager, U.S. Environmental Protection Agency; letter to John Ziagos, Environmental Restoration Section Leader, Lawrence Livermore National Laboratory, transmitting an outline of the RD/RA draft primary document contents, dated January 12, 1993. Outline was unofficially distributed by J. Chesnutt, Remedial Project Manager, U.S. Environmental Protection Agency, in December 1991.
- Gupta, S. K., C. R. Cole, C. T. Kincaid, and A. M. Monti (1987), *Coupled Fluid, Energy, and Solute Transport (CFEST) Model: Formulation and User's Manual*, Office of Nuclear Waste Isolation, Battelle Memorial Institute, Columbus, Ohio (BMI/ONWI-660).
- Isherwood, W. F., J. P. Ziagos, D. Rice, E. M. Nichols, and P. Krauter (1992), "Enhancing Aquifer Cleanup with Reinjection," *Proceedings of the Petroleum Hydrocarbons and Organic Chemicals in Ground Water*, November 4-6 Conference, National Ground Water Association, Houston, Tex. (UCRL-JC-110235).
- Isherwood, W. F., C. H. Hall, and M. D. Dresen (Eds.) (1990), *CERCLA Feasibility Study for the LLNL Livermore Site*, LLNL, Livermore, Calif. (UCRL-AR-104040) (Including Errata of October 1991).
- McConachie, W. A. (1993), Division Leader, LLNL Environmental Restoration Division; letter to M. Gill of U.S. Environmental Protection Agency, B. Cook of the Department of Toxic

- Substances Control, and S. Ritchie of the Regional Water Quality Control Board, describing the sampling schedule for the LLNL Livermore Site monitor wells, dated February 10, 1993.
- McEdwards, D. G. (1986), *CAPTURE: A Program for Generating Ground Water Flow Lines for Extraction Wells and Trenches in Uniform Ground Water Flow*, Data Services, Petaluma, Calif.
- Rice, D., P. Daley, and T. Carlsen (Eds.) (1990), *Environmental Restoration Program Standard Operating Procedures (SOPs)*, Lawrence Livermore National Laboratory, Livermore, Calif. (M-245 rev 1.4).
- Rice, D. W. (1989), *Quality Assurance Project Plan, LLNL Ground Water Project*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCAR-10219 rev 1).
- Thorpe, R. K., W. F. Isherwood, M. D., Dresen, and C. P. Webster-Scholten (Eds.) (1990), *CERCLA Remedial Investigation Report for the LLNL Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCAR-10299 vols 1-5).
- Tompson, A. F. B., E. M. Nichols, and P. F. McKereghan (Eds.), *Preliminary Simulations of Contaminant Migration in Ground Water at the Lawrence Livermore National Laboratory*, Lawrence Livermore National Laboratory, Livermore, Calif. (in preparation).
- Tompson, A. F. B., E. M. Nichols, P. F. McKereghan, and M. C. Small (1991), *Summary of Preliminary Ground Water Simulations in the Livermore Regional Modeling Study: CFEST Finite Element Code*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-107049).
- Tompson, A. F. B. (1990), *Flow and Transport Within the Saturated Zone Beneath Lawrence Livermore National Laboratory: Modeling Considerations for Heterogenous Media*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCID-21828).
- U.S. Department of Energy (DOE) (1992), *Record of Decision for the Lawrence Livermore National Laboratory, Livermore Site*, Lawrence Livermore National Laboratory, Livermore, Calif. (UCRL-AR-109105).
- U.S. Environmental Protection Agency (EPA) (1990), *Guidance on EPA Oversight of Remedial Designs and Remedial Actions Performed by Potentially Responsible Parties*, Interim Final; EPA/540/G-90/001.
- U.S. Environmental Protection Agency (EPA) (1989), *Interim Final Guidance on Preparing Superfund Decision Documents: The Proposed Plan, The Record of Decision, Explanation of Significant Difference, and The Record of Decision Amendment*; Office of Solid Waste and Emergency Response (OSWER) Directive 9335.3-02.

5.2. References for LLNL Facilities Standards, Specifications, and Guide Documents

5.2.1. General

Designs, construction drawings, and specifications will conform to and comply with the applicable requirements of the latest adopted edition of the references listed herein, which will be considered minimum requirements.

5.2.2. Regulations

U.S. Department of Energy (DOE)

DOE 5480.7A Fire Protection Program

DOE 6430.1A General Design Criteria

Code of Federal Regulations (CFR)

10 CFR 435 Energy Conservation Standards

29 CFR 1910 Occupational Safety and Health Standards (OSHA)

29 CFR 1910.7 Definitions and Requirements for a Nationally Recognized Testing Laboratory (NRTL)

47 CFR 15 Telecommunication (FCC Rules, Part 15)

State of California Department of Labor (DOL)

DOL Labor Code Division 5—Safety in Employment
Chapter 9—Miscellaneous Labor Provisions

California Code of Regulations (CCR)

CCR Title 8 Industrial Relations; Chapter 4, Subchapter 6

CCR Title 20 Public Utilities; Chapter 53—Energy
Conservation in New Building Construction

University of California, Lawrence Livermore National Laboratory (UCRL)

UCRL 15910 Design and Evaluation Guidelines for Department of Energy
Facilities Subjected to Natural Phenomena Hazards

UCRL 15714 Suspended Ceiling System Survey and Seismic Bracing
Recommendations

5.2.3. Codes

American Concrete Institute (ACI)

ACI 318 Building Code Requirements for Reinforced Concrete

American Institute of Steel Construction (AISC)

AISC Steel Construction Manual (Allowable Stress Design)

American National Standards Institute (ANSI)

ANSI A58.1 Building Code Requirements for Minimum Design Loads for
Buildings and Other Structures

American Welding Society (AWS)

AWS D 1.1 Structural Welding Code—Steel

International Conference of Building Officials (ICBO)

ICBO UBC Uniform Building Code

ICBO UMC Uniform Mechanical Code

ICBO UPC Uniform Plumbing Code

National Fire Protection Association (NFPA)

NFPA 70 National Electrical Code

NFPA 90A Installation of Air Conditioning and Ventilating Conditioning
Systems

5.2.4. Standards

American Concrete Institute (ACI)

ACI 347 Recommended Practice for Concrete Form Work

American Society for Testing and Materials (ASTM)

American Water Works Association (AWWA)

Construction Specifications Institute (CSI)

National Electric Manufacturers Association (NEMA)

Sheet Metal and Air Conditioning Contractors National Association, Inc. (SMACCNA)

5.2.5. LLNL Manuals and Reports

M-010 LLNL Health and Safety Manual

LLNL Site Development and Facilities Utilization Plan

LLNL Landscape Master Plan and Design Guidelines

6. Acronyms and Abbreviations

1,2-DCA	1,2-dichloroethane	CM	Construction Manager
1,1-DCE	1,1-dichloroethylene	CPR	cardiopulmonary resuscitation
1,2-DCE	1,2-dichloroethylene	CRP	Community Relations Plan
1,1,1-TCA	1,1,1-trichloroethane	Cr(VI)	hexavalent chromium
ACI	American Concrete Institute	CSI	Construction Specifications Institute
AISC	American Institute of Steel Construction	CTET	carbon tetrachloride
amsl	above mean sea level	DOE	U.S. Department of Energy
ANSI	American National Standards Institute	DOL	U.S. Department of Labor
ARAR	Applicable or Relevant and Appropriate Requirement	DOT	U.S. Department of Transportation
ASME	American Society of Mechanical Engineers	DTSC	California Department of Toxic Substances Control
ASTM	American Society for Testing and Materials	EE	Electronic Engineering
AWS	American Welding Society	EPA	U.S. Environmental Protection Agency
AWWA	American Water Works Association	ERD	Environmental Restoration Division
B-212	Building 212	ES&H	Environmental Safety & Health
B-321	Building 321	F113	trichlorotrifluoroethane
BAAQMD	Bay Area Air Quality Management District	FFA	Federal Facility Agreement
BACT	Best Available Control Technology	FID	flame ionization detector
CCR	California Code of Regulations	Freon 113	trichlorotrifluoroethane
CERCLA	Comprehensive Environmental Response, Compensation, and Liability Act	FS	Feasibility Study
CF	chloroform	GAC	granular activated carbon
CFEST	Coupled Fluid Energy and Solute Transport	gal	gallon(s)
cfm	cubic feet per minute	gpm	gallons per minute
CFR	Code of Federal Regulations	G&A/LDRD	General and Administrative/Laboratory Directed Research and Development
CI	Construction Inspector	HASP	Health and Safety Plan
		HCl	hydrochloric acid
		hp	horsepower
		hr	hour

HWM	Hazardous Waste Management	PID	photoionization detector
HWMD	Hazardous Waste Management Division	PO	purchase order
ICBO	International Conference of Building Officials	ppb	parts per billion
LLNL	Lawrence Livermore National Laboratory	ppm	parts per million
LSRSL	Livermore Site Restoration Section Leader	psi	pounds per square inch
MCL	Maximum Contaminant Level	QA	quality assurance
ME	Mechanical Engineering	QAM	Quality Assurance Manager
M&I	materials and items	QC	quality control
MPC	Material Procurement Charge	RAIP	Remedial Action Implementation Plan
M&TE	measuring and test equipment	RCRA	Resource Conservation and Recovery Act
NaCl	sodium chloride	RD	Remedial Design
NEMA	National Electric Manufacturers Association	RE	Remediation Engineer
NEPA	National Environmental Policy Act	RI	Remedial Investigation
NFPA	National Fire Protection Association	ROD	Record of Decision
NPDES	National Pollution Discharge Elimination System	rpm	revolutions per minute
NQA	National Quality Assurance	RWQCB	California Regional Water Quality Control Board
NRTL	Nationally Recognized Testing Laboratory	SARA	Superfund Amendments and Reauthorization Act
O&M	operations and maintenance	SMACCNA	Sheet Metal and Air Conditioning Contractors National Association, Inc.
OSHA	Occupational Safety and Health Administration	SOP	Standard Operating Procedure
OSWER	U.S. EPA Office of Solid Waste and Emergency Response	TBI	to be installed
OTL	Operations Team Leader	TCE	trichloroethylene
PCE	perchloroethylene	TD	total depth
PEPE	Plant Engineering Project Engineer	TFD	Treatment Facility D
PEPM	Plant Engineering Project Manager	TFE	Treatment Facility E
P&ID	piping and instrument diagram	TFG	Treatment Facility G
		TFG-1	Treatment Facility G-1
		TFG-2	Treatment Facility G-2
		UBC	Uniform Building Code
		UCRL	University of California Radiation Laboratory
		VOC	volatile organic compound
		v/v	volume per volume basis
		WDR	Waste Discharge Requirement

7. Acknowledgments

The technical editors and contributors would like to recognize the contributions to this report of the following people:

W. McConachie, Environmental Restoration Division Leader, provided overall direction and technical guidance.

J. Hoffman of Weiss Associates reviewed the hydrostratigraphic cross sections.

M. Meamber of KMI/TID, K. Heyward of LLNL/TID, and J. Orloff of LLNL prepared the graphics.

H. Sherman of LLNL/TID provided editorial support.

B. Justin and B. Staley of LLNL/TID provided publication services.

N. Prentice and L. daRosa of LLNL provided clerical support.

S. Chamberlain of LLNL provided Appendix A.

K. Rauhut of LLNL provided legal support.

UCRL-AR-116583

Appendix A
Soil and Ground Water
Analytical Results

**This page was left blank so the following
table could be shown on facing pages**

Table A-1. Soil analyses (mg/kg) for volatile organic compounds from the TFG

Borehole	Depth	PCE	TCE	1,1	Total	1,1,1	1,1	1,2
Date	(ft)			DCE	1,2	TCA	DCA	DCA
					DCE			
B-146 (MW-146)								
27-JUN-85	81.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
02-JUL-85	88.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
02-JUL-85	107.0	0.0025	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
08-JUL-85	120.5	0.001	0.002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
09-JUL-85	141.0	<0.0002	<0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002
10-JUL-85	157.5	<0.0002	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-85	181.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-85	193.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-85	199.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-85	217.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-147 (MW-147)								
23-JUL-85	80.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
24-JUL-85	108.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
24-JUL-85	117.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
25-JUL-85	129.0	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002	<0.002
B-148 (MW-148)								
02-AUG-85	84.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-AUG-85	109.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
06-AUG-85	129.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
06-AUG-85	133.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
06-AUG-85	146.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-202 (MW-202)								
28-OCT-85	120.2	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
28-OCT-85	128.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
29-OCT-85	154.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
29-OCT-85	182.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-223 (MW-223)								
11-AUG-86*	96.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-AUG-86*	96.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-AUG-86*	96.0	-	-	-	-	-	-	-
11-AUG-86*	96.0	-	-	-	-	-	-	-
11-AUG-86	105.6	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-AUG-86	105.6	-	-	-	-	-	-	-
11-AUG-86	113.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-AUG-86	113.0	-	-	-	-	-	-	-
12-AUG-86	133.4	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-AUG-86	133.4	-	-	-	-	-	-	-
12-AUG-86	148.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-AUG-86	148.5	-	-	-	-	-	-	-
13-AUG-86	161.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
13-AUG-86	161.8	-	-	-	-	-	-	-
13-AUG-86	181.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
13-AUG-86	181.3	-	-	-	-	-	-	-
B-252 (MW-252)								
10-OCT-85	96.5	0.0022	0.0004	0.0025	<0.0002	0.0007	0.013	<0.0002
14-OCT-85	131.7	<0.0002	0.0004	0.0004	<0.0002	<0.0002	0.0003	<0.0002
15-OCT-85	151.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
15-OCT-85	162.7	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-253 (MW-253)								
28-OCT-85	95.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
28-OCT-85	107.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
29-OCT-85	127.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
29-OCT-85	135.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
29-OCT-85	159.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-OCT-85	168.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-307 (MW-307)								
10-DEC-86	81.5	0.0019	0.0065	0.0008	<0.0002	<0.0002	<0.0002	<0.0002
10-DEC-86	93.4	0.0022	0.021	0.001	<0.0002	<0.0002	<0.0002	<0.0002
10-DEC-86	102.0	0.0003	0.0054	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
10-DEC-86	111.0	0.0003	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002

Area, recorded by September 15, 1994.

Carbon tetra- chloride	Chloro- form	Freon 113	Benzene	Toluene	Xylenes	Borehole Depth (ft)
						B-146 (MW-146)
<0.0002	<0.0002	-	-	-	-	81.5
<0.0002	<0.0002	-	-	-	-	88.5
<0.0002	<0.0002	-	-	-	-	107.0
<0.0002	<0.0002	-	-	-	-	120.5
0.0003	<0.0002	-	-	-	-	141.0
<0.0002	<0.0002	-	-	-	-	157.5
<0.0002	<0.0002	-	-	-	-	181.0
<0.0002	<0.0002	-	-	-	-	193.0
<0.0002	<0.0002	-	-	-	-	199.0
<0.0002	<0.0002	-	-	-	-	217.0
						B-147 (MW-147)
<0.0002	<0.0002	-	-	-	-	80.5
<0.0002	<0.0002	-	-	-	-	108.5
<0.0002	<0.0002	-	-	-	-	117.0
<0.002	<0.002	-	-	-	-	129.0
						B-148 (MW-148)
<0.0002	<0.0002	-	-	-	-	84.5
<0.0002	<0.0002	-	-	-	-	109.0
<0.0002	<0.0002	-	-	-	-	129.0
<0.0002	<0.0002	-	-	-	-	133.0
<0.0002	<0.0002	-	-	-	-	146.5
						B-202 (MW-202)
<0.0002	<0.0002	-	-	-	-	120.2
<0.0002	<0.0002	-	-	-	-	128.0
<0.0002	<0.0002	-	-	-	-	154.5
<0.0002	<0.0002	-	-	-	-	182.8
						B-223 (MW-223)
0.0009	<0.0002	<0.0002	-	-	-	96.0
0.0003	<0.0002	<0.0002	-	-	-	96.0
-	-	-	<0.0002	<0.0002	<0.0002	96.0
-	-	-	<0.0002	<0.0002	<0.0002	96.0
<0.0002	0.0004	<0.0002	-	-	-	105.6
-	-	-	<0.0002	<0.0002	<0.0002	105.6
<0.0002	0.0022	<0.0002	-	-	-	113.0
-	-	-	<0.0002	<0.0002	<0.0002	113.0
<0.0002	<0.0002	<0.0002	-	-	-	133.4
-	-	-	<0.0002	<0.0002	<0.0002	133.4
0.0004	<0.0002	<0.0002	-	-	-	148.3
-	-	-	<0.0002	<0.0002	<0.0002	148.5
<0.0002	0.0005	-	-	-	-	161.8
-	-	-	<0.0002	<0.0002	<0.0002	161.8
<0.0002	0.0002	-	-	-	-	181.3
-	-	-	<0.0002	<0.0002	<0.0002	181.3
						B-252 (MW-252)
<0.0002	<0.0002	-	-	-	-	96.5
<0.0002	<0.0002	-	-	-	-	131.7
<0.0002	<0.0002	-	-	-	-	151.3
<0.0002	<0.0002	-	-	-	-	162.7
						B-253 (MW-253)
<0.0002	<0.0002	-	-	-	-	95.0
<0.0002	<0.0002	-	-	-	-	107.3
<0.0002	<0.0002	-	-	-	-	127.0
<0.0002	<0.0002	-	-	-	-	135.3
<0.0002	<0.0002	-	-	-	-	159.3
<0.0002	<0.0002	-	-	-	-	168.3
						B-307 (MW-307)
0.0003	0.0002	<0.0002	-	-	-	81.5
0.0004	0.0005	<0.0002	-	-	-	93.4
<0.0002	<0.0002	<0.0002	-	-	-	102.0
<0.0002	0.0006	<0.0002	-	-	-	111.0

Table A-1. Soil analyses (mg/kg) for volatile organic compounds from the TFG

Borehole	Depth	PCE	TCE	1,1 DCE	Total 1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
B-307 (continued)								
11-DEC-86	127.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-DEC-86	127.5	-	-	-	-	-	-	-
11-DEC-86	136.1	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-DEC-86	136.1	-	-	-	-	-	-	-
12-DEC-86	151.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-DEC-86	151.8	-	-	-	-	-	-	-
15-DEC-86	195.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
15-DEC-86	195.0	-	-	-	-	-	-	-
B-464 (MW-464)								
20-SEP-88*	10.5	0.0003	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
20-SEP-88*	24.0	0.0025	0.0016	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
21-SEP-88*	48.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
21-SEP-88*	48.5	-	-	-	-	-	-	-
21-SEP-88*	72.5	0.0003	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
21-SEP-88*	85.8	0.003	0.0047	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
21-SEP-88	96.5	0.01	0.02	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
22-SEP-88	114.8	0.0082	0.012	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
22-SEP-88	114.8	-	-	-	-	-	-	-
22-SEP-88	137.0	<0.0002	0.004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
22-SEP-88	137.0	-	-	-	-	-	-	-
23-SEP-88	146.5	<0.0002	0.0009	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
23-SEP-88	159.8	<0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
23-SEP-88	184.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
26-SEP-88	214.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
26-SEP-88	233.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-551 (MW-551)								
04-OCT-88*	7.8	0.004	0.0041	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
04-OCT-88*	15.0	0.0029	0.0021	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
04-OCT-88*	19.5	0.03	0.044	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-OCT-88*	28.5	0.0069	0.0094	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-OCT-88*	40.0	0.0024	0.0036	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-OCT-88*	56.1	0.0025	0.0039	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-OCT-88*	66.8	0.0023	0.0028	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
05-OCT-88*	77.0	0.0021	0.003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
06-OCT-88*	81.5	0.0093	0.0054	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
06-OCT-88	109.5	0.0012	0.014	0.0003	<0.0002	<0.0002	0.0007	0.0003
07-OCT-88	122.3	<0.0002	0.02	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
07-OCT-88	137.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
07-OCT-88	153.0	<0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
10-OCT-88	191.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
10-OCT-88	201.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
10-OCT-88	222.5	-	-	-	-	-	-	-
10-OCT-88	222.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-OCT-88	236.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-OCT-88	269.1	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-OCT-88	289.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-OCT-88	298.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-560 (MW-560)								
26-JAN-89*	0.1	-	-	-	-	-	-	-
26-JAN-89*	8.5	0.0005	0.0017	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
26-JAN-89*	8.8	-	-	-	-	-	-	-
26-JAN-89*	22.0	0.0004	0.0008	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
26-JAN-89*	22.3	-	-	-	-	-	-	-
30-JAN-89*	80.8	-	-	-	-	-	-	-
30-JAN-89*	81.0	<0.0002	0.0005	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89*	92.3	<0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89	93.5	<0.0002	0.0005	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89	93.8	-	-	-	-	-	-	-
30-JAN-89	104.5	0.0006	0.0052	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89	105.0	-	-	-	-	-	-	-
30-JAN-89	120.0	0.0009	0.0078	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89	120.3	-	-	-	-	-	-	-
30-JAN-89	128.5	<0.0002	0.0069	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
30-JAN-89	128.8	-	-	-	-	-	-	-
31-JAN-89	135.5	0.0021	0.02	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
31-JAN-89	140.0	<0.0002	0.0036	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
31-JAN-89	157.3	<0.0002	0.0017	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
31-JAN-89	171.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002

Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Borehole Depth (ft)
						(continued)
<0.0002	0.0019	<0.0002	-	-	-	B-307 127.5
-	-	-	0.0003	<0.0002	<0.0002	127.5
<0.0002	0.002	<0.0002	-	-	-	136.1
-	-	-	0.0002	<0.0002	<0.0002	136.1
<0.0002	0.0003	<0.0002	-	-	-	151.8
-	-	-	<0.0002	<0.0002	<0.0002	151.8
<0.0002	0.0006	<0.0002	-	-	-	195.0
-	-	-	<0.0002	<0.0002	<0.0002	195.0
						B-464 (MW-464)
<0.0002	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	10.5
<0.0002	0.0059	<0.0002	-	-	-	24.0
<0.0002	0.0004	<0.0002	-	-	-	48.5
-	-	-	<0.0002	<0.0002	<0.0002	48.5
<0.0002	0.0002	<0.0002	-	-	-	72.5
<0.0002	0.0006	<0.0002	-	-	-	85.8
0.0007	0.0002	0.0002	<0.0002	<0.0002	<0.0002	96.5
0.0011	0.0007	0.0007	-	-	-	114.8
-	-	-	<0.0002	<0.0002	<0.0002	114.8
<0.0002	0.0003	<0.0002	-	-	-	137.0
-	-	-	<0.0002	<0.0002	<0.0002	137.0
<0.0002	<0.0002	<0.0002	-	-	-	146.5
<0.0002	<0.0002	<0.0002	-	-	-	159.8
<0.0002	<0.0002	<0.0002	-	-	-	184.8
<0.0002	<0.0002	<0.0002	-	-	-	214.3
<0.0002	<0.0002	<0.0002	-	-	-	233.8
						B-551 (MW-551)
<0.0002	0.0002	<0.0002	0.0004	0.0005	0.0002	7.8
<0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	15.0
0.0016	0.0021	<0.0002	0.0007	0.0009	0.0003	19.5
<0.0002	<0.0002	<0.0002	0.0006	<0.0002	<0.0002	28.5
<0.0002	<0.0002	<0.0002	0.0009	<0.0002	<0.0002	40.0
<0.0002	<0.0002	<0.0002	0.0012	<0.0002	0.0003	56.1
<0.0002	0.0004	<0.0002	0.0012	0.0003	0.0002	66.8
<0.0002	0.0003	<0.0002	0.003	0.0003	0.0003	77.0
<0.0002	<0.0002	<0.0002	<0.0002	0.0053	0.001	81.5
<0.0002	<0.0002	<0.0002	0.0013	0.0015	<0.0002	109.5
<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	122.3
<0.0002	0.0003	<0.0002	-	-	-	137.3
<0.0002	0.0003	<0.0002	-	-	-	153.0
<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	191.3
<0.0002	0.0008	<0.0002	<0.0002	0.0002	0.0003	201.0
-	-	-	<0.0002	<0.0002	<0.0002	222.5
<0.0002	<0.0002	<0.0002	<0.0002	0.0002	0.0004	222.8
<0.0002	<0.0002	<0.0002	0.0012	<0.0002	<0.0002	236.3
<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	269.1
<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	289.0
<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	0.0002	298.3
						B-560 (MW-560)
-	-	-	0.016	0.031	0.022	0.1
0.0003	<0.0002	<0.0002	-	-	-	8.5
-	-	-	<0.0002	0.001	<0.0002	8.8
0.0005	<0.0002	<0.0002	-	-	-	22.0
-	-	-	0.0012	0.0054	<0.0002	22.3
-	-	-	0.0002	0.0004	0.0004	80.8
<0.0002	0.0002	<0.0002	-	-	-	81.0
<0.0002	<0.0002	<0.0002	0.0003	0.0017	<0.0002	92.3
<0.0002	<0.0002	<0.0002	-	-	-	93.5
-	-	-	0.0005	0.0034	<0.0002	93.8
<0.0002	0.0002	<0.0002	-	-	-	104.5
-	-	-	0.0003	0.0031	<0.0002	105.0
<0.0002	0.0011	<0.0002	-	-	-	120.0
-	-	-	0.0002	0.004	<0.0002	120.3
0.0008	0.0006	<0.0002	-	-	-	128.5
-	-	-	0.0003	0.0017	<0.0002	128.8
<0.0002	0.0008	<0.0002	0.0008	0.0052	0.0004	135.5
<0.0002	0.0004	<0.0002	0.0011	0.0031	<0.0002	140.0
<0.0002	0.0003	<0.0002	0.0003	0.0025	<0.0002	157.3
<0.0002	<0.0002	<0.0002	0.0003	0.0022	<0.0002	171.5

Table A-1. Soil analyses (mg/kg) for volatile organic compounds from the TFG

Borehole	Depth	PCE	TCE	1,1 DCE	Total 1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
Date	(ft)							
B-560 (continued)								
31-JAN-89	176.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
31-JAN-89	182.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
01-FEB-89	189.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
01-FEB-89	203.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
02-FEB-89	262.4	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
02-FEB-89	262.7	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
B-618 (MW-618)								
10-JUL-90*	5.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-90*	77.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-90*	80.5	<0.0002	<0.0002	<0.0002	0.0002	<0.0002	<0.0002	<0.0002
11-JUL-90	96.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-90	107.3	0.0007	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
11-JUL-90	115.0	0.005	0.0017	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	131.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	141.5	0.0014	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	145.3	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	152.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	156.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	157.5	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	159.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
12-JUL-90	203.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
13-JUL-90	221.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
13-JUL-90	231.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
13-JUL-90	259.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-JUL-90	290.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-JUL-90	297.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-JUL-90	320.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-JUL-90	326.5	<0.0002	<0.0002	<0.0002	0.0002	<0.0002	<0.0002	<0.0002
17-JUL-90	337.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-JUL-90	345.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
SAS-003								
07-FEB-89*	2.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
07-FEB-89*	5.3	0.012	0.0028	0.0002	0.0004	0.005	0.0006	<0.0002
07-FEB-89*	10.5	0.0076	0.0017	<0.0002	0.0003	0.0025	0.0003	<0.0002
07-FEB-89*	20.3	0.022	0.0065	0.0005	0.0015	0.0095	0.0012	<0.0002
07-FEB-89*	30.5	0.025	0.012	0.002	0.0022	0.013	0.0017	<0.0002
07-FEB-89*	40.3	0.0012	0.0005	<0.0002	<0.0002	0.0005	<0.0002	<0.0002
07-FEB-89*	50.0	0.0005	0.0002	<0.0002	<0.0002	0.0003	<0.0002	<0.0002
07-FEB-89*	60.3	0.0005	0.0002	<0.0002	<0.0002	0.0003	<0.0002	<0.0002
07-FEB-89*	70.3	0.0007	0.0002	<0.0002	<0.0002	0.0002	<0.0002	<0.0002
07-FEB-89	75.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
SIB-212-002								
16-MAY-89*	5.5	0.0048	0.0009	0.0002	<0.0002	0.0005	<0.0002	<0.0002
16-MAY-89*	10.8	0.0008	0.0012	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-MAY-89*	20.5	0.0037	0.0073	<0.0002	<0.0002	0.0005	<0.0002	<0.0002
16-MAY-89*	31.0	<0.0002	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-MAY-89*	40.8	0.0002	0.0003	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-MAY-89*	51.3	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-MAY-89*	61.3	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
16-MAY-89*	71.0	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	81.0	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	90.3	<0.0002	<0.0002	0.0004	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89	100.3	<0.0002	<0.0002	0.0004	<0.0002	<0.0002	<0.0002	<0.0002
SIB-212-004								
17-MAY-89*	5.5	0.0032	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	10.8	0.0004	0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	21.3	<0.0002	0.0005	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	30.8	0.001	0.026	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	41.3	<0.0002	0.0004	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	50.5	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	60.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
17-MAY-89*	70.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
18-MAY-89*	80.8	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
18-MAY-89*	90.8	<0.0002	0.0023	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002
18-MAY-89	96.1	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002	<0.0002

Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Borehole Depth (ft)
						(continued) B-560
<0.0002	<0.0002	<0.0002	0.0003	0.0019	<0.0002	176.3
<0.0002	<0.0002	<0.0002	<0.0002	0.0008	<0.0002	182.5
<0.0002	<0.0002	<0.0002	0.0005	0.0021	<0.0002	189.8
<0.0002	<0.0002	<0.0002	0.0004	0.0028	<0.0002	203.8
<0.0002	0.0002	<0.0002	0.0009	0.0029	<0.0002	262.4
<0.0002	<0.0002	<0.0002	0.0011	0.0034	<0.0002	262.7
						B-618 (MW-618)
<0.0002	<0.0002	<0.0002	<0.001	<0.002	<0.002	5.5
<0.0002	<0.0002	<0.0002	-	-	-	77.8
<0.0002	<0.0002	<0.0002	-	-	-	80.5
<0.0002	<0.0002	<0.0002	-	-	-	96.3
<0.0002	<0.0002	<0.0002	-	-	-	107.3
<0.0002	0.0008	<0.0002	-	-	-	115.0
<0.0002	<0.0002	<0.0002	-	-	-	131.5
<0.0002	<0.0002	<0.0002	-	-	-	141.5
<0.0002	<0.0002	<0.0002	-	-	-	145.3
<0.0002	<0.0002	<0.0002	-	-	-	152.0
<0.0002	<0.0002	<0.0002	-	-	-	156.0
<0.0002	0.0005	<0.0002	-	-	-	157.5
<0.0002	<0.0002	<0.0002	-	-	-	159.8
<0.0002	<0.0002	<0.0002	-	-	-	203.3
<0.0002	<0.0002	<0.0002	-	-	-	221.8
<0.0002	0.0003	<0.0002	-	-	-	231.0
<0.0002	0.0004	<0.0002	-	-	-	259.8
<0.0002	0.0012	<0.0002	-	-	-	290.3
<0.0002	<0.0002	<0.0002	-	-	-	297.5
<0.0002	<0.0002	<0.0002	-	-	-	320.5
<0.0002	0.0004	<0.0002	-	-	-	326.5
<0.0002	0.0026	<0.0002	-	-	-	337.0
<0.0002	0.0008	<0.0002	-	-	-	345.0
						SAS-003
<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	2.5
<0.0002	0.0085	<0.0002	0.0015	0.012	0.001	5.3
<0.0002	0.0061	<0.0002	0.0017	0.012	0.0006	10.5
<0.0002	0.012	<0.0002	0.0011	0.015	<0.0002	20.3
<0.0002	0.0043	<0.0002	0.0012	0.0022	<0.0002	30.5
<0.0002	0.0011	<0.0002	0.0011	0.0015	<0.0002	40.3
<0.0002	0.0002	<0.0002	0.0016	0.0075	<0.0002	50.0
<0.0002	0.0005	<0.0002	0.0024	0.0097	<0.0002	60.3
<0.0002	<0.0002	<0.0002	0.0023	0.01	<0.0002	70.3
<0.0002	0.0003	<0.0002	0.0005	0.0034	<0.0002	75.3
						SIB-212-002
<0.0002	<0.0002	0.0014	-	-	-	5.5
<0.0002	<0.0002	<0.0002	-	-	-	10.8
<0.0002	<0.0002	<0.0002	-	-	-	20.5
<0.0002	<0.0002	<0.0002	-	-	-	31.0
<0.0002	<0.0002	<0.0002	-	-	-	40.8
<0.0002	<0.0002	<0.0002	-	-	-	51.3
<0.0002	<0.0002	0.0003	-	-	-	61.3
<0.0002	<0.0002	0.0004	-	-	-	71.0
<0.0002	<0.0002	<0.0002	-	-	-	81.0
<0.0002	<0.0002	<0.0002	-	-	-	90.3
<0.0002	<0.0002	0.0002	-	-	-	100.3
						SIB-212-004
<0.0002	<0.0002	<0.0002	-	-	-	5.5
<0.0002	<0.0002	<0.0002	-	-	-	10.8
<0.0002	<0.0002	<0.0002	-	-	-	21.3
<0.0002	<0.0002	<0.0002	-	-	-	30.8
<0.0002	<0.0002	<0.0002	-	-	-	41.3
<0.0002	<0.0002	<0.0002	-	-	-	50.5
<0.0002	<0.0002	0.0003	-	-	-	60.8
<0.0002	<0.0002	<0.0002	-	-	-	70.8
<0.0002	<0.0002	0.0007	-	-	-	80.8
<0.0002	<0.0002	<0.0002	-	-	-	90.8
<0.0002	<0.0002	<0.0002	-	-	-	96.1

Table A-1. Soil analyses (mg/kg) for volatile organic compounds from the TFG

Borehole	Depth			1,1	Total	1,1,1	1,1	1,2
Date	(ft)	PCE	TCE	DCE	1,2 DCE	TCA	DCA	DCA

Area, recorded by September 15, 1994.

Carbon tetra- chloride	Chloro- form	Freon 113	Benzene	Toluene	Xylenes	Borehole Depth (ft)
------------------------------	-----------------	--------------	---------	---------	---------	---------------------------

Notes:

- Indicates no analysis performed for this compound.
- * Indicates this is an unsaturated soil sample.

**This page was left blank so the following
table could be shown on facing pages**

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location		Total						
Date	Type	PCE	TCE	1,1 DCE	1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
MW-111								
05-SEP-85	RTN	2.6	6.4	7	<0.5	47	<0.5	<0.5
25-NOV-85	RTN	2.4	7.2	5.4	<0.5	47	<0.5	<0.5
25-NOV-85	RTN	2.4	7	7	<0.5	89	<0.5	<0.5
24-FEB-86	RTN	6	14	19	<0.5	120	<0.5	<0.5
24-FEB-86	RTN	5	12	15	<0.5	93	<0.5	<0.5
19-MAY-86	RTN	3.2	7.4	16	<0.5	70	<0.5	<0.5
19-MAY-86	RTN	3.4	8	19	<0.5	78	<0.5	<0.5
07-AUG-86	RTN	2.1	10	29	<0.5	85	<0.5	<0.5
29-OCT-86	RTN	2.6	9.6	14	<0.5	120	<0.5	<0.5
09-MAR-87	RTN	2.1	7.6	26	<0.5	54	<0.5	<0.5
09-MAR-87	RTN	2.2	7.1	30	<0.4	67	<0.44	<0.31
23-APR-87	RTN	1.5	7.9	21	<1	65	<1	<1
16-NOV-87	RTN	3.9	16	65	<1	210	<1	<1
25-APR-88	RTN	4.5	15	4.8	<0.4	6.7	<0.4	<0.3
25-APR-88	RTN	5.4	15	6.3	<0.5	7.1	<0.5	<0.5
04-NOV-88	RTN	4.7	17	19	<0.5	20	<0.5	<0.5
11-MAY-89	RTN	2.9	11	16	<0.5	14	<0.5	<0.5
01-DEC-89	RTN	7.9	21	34	<0.5	22	<0.5	<0.5
06-FEB-90	RTN	4.3	15	21	<0.5	13	<0.5	<0.5
07-MAY-90	RTN	4	14	22	<0.5	14	<0.5	<0.5
09-OCT-90	RTN	4.9	19	14	<0.5	10	<0.5	<0.5
21-FEB-91	RTN	5	16	24	<0.5	9.5	<0.5	<0.5
14-MAY-91	RTN	6.9	23	21	<0.5	8.1	<0.5	<0.5
29-JUL-91	RTN	7.1	21	12	<0.5	4.7	<0.5	<0.5
31-OCT-91	RTN	6.9	29	12	<0.5	3.7	<0.5	<0.5
27-MAY-92	RTN	10	32	8.1	<0.5	3	<0.5	<0.5
26-OCT-92	RTN	8.1	23	2.4	<0.5	<0.5	<0.5	<0.5
15-APR-93	RTN	4.4	12	5.1	<0.5	1.3	<0.5	<0.5
22-NOV-93	RTN	4.4	13	15	<0.5	3.2	<0.5	<0.5
20-APR-94	RTN	5	13	8.9	<0.5	1.3	<0.5	<0.5
26-MAY-94	RTN	4.6	13	14	<0.5	2.1	<0.5	<0.5
MW-146								
11-SEP-85	RTN	5	17	2	<1	<1	<1	<1
11-SEP-85	RTN	4	17	1	<1	<1	<1	<1
27-NOV-85	RTN	4.8	14	4	<0.5	<0.5	<0.5	<0.5
11-MAR-86	RTN	5.2	17	3.7	<0.5	<0.5	<0.5	<0.5
05-JUN-86	RTN	5.3	12	4.8	<0.5	<0.5	<0.5	<0.5
03-SEP-86	RTN	2.9	18	4.6	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	1.7	6.6	0.9	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	1.6	6.8	0.9	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	1.8	1.6	<0.28	<0.4	<0.45	<0.44	<0.31
12-MAR-87	RTN	2.1	8.7	3.4	<0.5	<0.5	<0.5	<0.5
12-MAR-87	RTN	3.6	6.1	3.6	2.3	<0.45	<0.44	<0.31
20-MAY-87	RTN	2.1	6.2	6.1	<0.5	<0.5	<0.5	<0.5
19-NOV-87	RTN	2.7	10	1.5	<0.5	<0.5	<0.5	<0.5
10-MAY-88	RTN	2.4	7.1	1.4	<0.5	<0.5	<0.5	<0.5
21-NOV-88	RTN	3	9.7	0.7	<0.5	<0.5	<0.5	<0.5
18-MAY-89	RTN	3.5	12	<0.5	<0.5	<0.5	<0.5	<0.5
18-MAY-89	RTN	2	7.9	<0.5	<0.5	<0.5	<0.5	<0.5
09-AUG-89	RTN	4	14	<0.5	<0.5	<0.5	<0.5	<0.5
30-NOV-89	RTN	3.5	11	0.6	<0.5	<0.5	<0.5	<0.5
27-FEB-90	RTN	3.7	9.7	<0.5	<0.5	<0.5	<0.5	<0.5
05-JUN-90	RTN	3	12	<0.5	<0.5	<0.5	<0.5	<0.5
24-AUG-90	RTN	2.3	8.9	<0.5	<0.5	<0.5	<0.5	<0.5
29-NOV-90	RTN	2.7	10	<0.5	<0.5	<0.5	<0.5	0.5
27-FEB-91	RTN	3.5	12	1	<0.5	<0.5	<0.5	<0.5
22-MAY-91	RTN	5.9	21	1	<0.5	<0.5	<0.5	0.5
08-AUG-91	RTN	4.6	17	0.9	<0.5	<0.5	<0.5	0.8
08-AUG-91	DUP	4.8	19	0.7	<0.5	<0.5	<0.5	0.9
20-NOV-91	RTN	7	25	1.5	<0.5	<0.5	<0.5	1.9
20-NOV-91	DUP	7.6	28	1.8	<0.5	<0.5	<0.5	1.6
11-JUN-92	RTN	4.3	18	<0.5	<0.5	<0.5	<0.5	0.5
11-JUN-92	DUP	4.4	17	<0.5	<0.5	<0.5	<0.5	<0.5
20-SEP-93	RTN	9.3	11	1	1.2	<0.5	<0.5	<0.5
MW-147								
11-SEP-85	RTN	<1	<1	<1	<1	<1	<1	<1
11-SEP-85	RTN	<1	<1	<1	<1	<1	<1	<1
27-NOV-85	RTN	<0.5	1.3	1.1	<0.5	2.5	<0.5	<0.5
11-MAR-86	RTN	<0.5	3.8	0.7	<0.5	<0.5	<0.5	<0.5
05-JUN-86	RTN	<0.5	2.7	3.5	<0.5	1.7	<0.5	<0.5

TFG Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Location
						MW-111
<0.5	3.2	-	-	-	-	
<0.5	<0.5	57	-	-	-	
<0.5	<0.5	56	-	-	-	
<0.5	<0.5	35	-	-	-	
<0.5	<0.5	29	-	-	-	
<0.5	1.5	33	-	-	-	
<0.5	1.7	39	-	-	-	
<0.5	<0.5	62	-	-	-	
<0.5	1.7	47	-	-	-	
<0.5	1.6	41	-	-	-	
<0.55	1.5	37	-	-	-	
<1	1.6	33	-	-	-	
<1	5	50	-	-	-	
3.6	9.9	25	-	-	-	
3.7	10	33	-	-	-	
5.3	5.3	38	-	-	-	
3	2.9	21	-	-	-	
4.6	5.9	31	-	-	-	
4.1	3	18	-	-	-	
4.2	3.3	14	-	-	-	
5.6	3.5	10	-	-	-	
6	5	22	<0.5	<0.5	<0.5	
9.4	5.4	26	-	-	-	
10	5.3	22	-	-	-	
12	5.6	9.7	-	-	-	
17	9.7	12	-	-	-	
9.3	9	8.9	-	-	-	
5.4	5	6.6	-	-	-	
4.7	4.8	10	-	-	-	
3.9	5.3	13	-	-	-	
3.9	5	12	-	-	-	
						MW-146
<1	10	-	<1	<1	-	
<1	9	-	<1	<1	-	
1.7	20	<0.5	-	-	-	
<0.5	22	-	-	-	-	
0.7	14	<0.5	-	-	-	
1.2	13	<0.5	-	-	-	
<0.5	8.2	<0.5	-	-	-	
<0.5	8.2	<0.5	-	-	-	
<0.55	6.6	<0.62	-	-	-	
0.6	9.5	<0.5	-	-	-	
2.3	8.9	<0.62	-	-	-	
0.9	13	<0.5	-	-	-	
<0.5	13	3.4	-	-	-	
<0.5	11	<0.5	-	-	-	
<0.5	12	<0.5	-	-	-	
<0.5	7.6	<0.5	-	-	-	
<0.5	5.7	<0.5	-	-	-	
<0.5	17	<0.5	-	-	-	
<0.5	8.7	<0.5	-	-	-	
<0.5	7.7	<0.5	-	-	-	
<0.5	10	<0.5	-	-	-	
<0.5	8.3	<0.5	-	-	-	
0.8	9.1	<0.5	-	-	-	
<0.5	9	<0.5	<0.5	<0.5	<0.5	
<0.5	13	<0.5	-	-	-	
<0.5	8.6	<0.5	-	-	-	
<0.5	8.9	<0.5	-	-	-	
0.5	8.2	<0.5	-	-	-	
0.5	10	<0.5	-	-	-	
<0.5	4.1	<0.5	-	-	-	
<0.5	4.1	<0.5	-	-	-	
<0.5	4.9	<0.5	-	-	-	
						MW-147
<1	3	-	<1	<1	-	
<1	3	-	<1	<1	-	
<0.5	2.3	<0.5	-	-	-	
<0.5	<0.5	-	-	-	-	
<0.5	0.8	5.3	-	-	-	

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location					Total			
Date	Type	PCE	TCE	1,1 DCE	1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
MW-147 (continued)								
03-SEP-86	RTN	<0.5	1.5	0.6	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	<0.5	0.9	<0.5	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	<0.5	0.5	<0.5	<0.5	<0.5	<0.5	<0.5
14-NOV-86	RTN	0.74	<0.34	<0.28	<0.4	<0.45	<0.44	<0.31
12-MAR-87	RTN	<0.5	2	1	<0.5	<0.5	<0.5	<0.5
12-MAR-87	RTN	<0.54	2.5	0.74	0.9	1.7	<0.44	<0.31
20-MAY-87	RTN	<0.5	1.5	3.6	<0.5	<0.5	<0.5	<0.5
19-NOV-87	RTN	<0.5	2.4	1.7	<0.5	0.7	<0.5	<0.5
10-MAY-88	RTN	1	3	1.5	<0.5	<0.5	<0.5	<0.5
05-DEC-88	RTN	0.8	2.5	0.9	<0.5	<0.5	<0.5	<0.5
18-MAY-89	RTN	<0.5	3	2.6	<0.5	<0.5	<0.5	<0.5
01-DEC-89	RTN	1.2	4.7	2.4	<0.5	<0.5	<0.5	<0.5
05-JUN-90	RTN	2.8	4.9	3	<0.5	<0.5	<0.5	<0.5
29-NOV-90	RTN	<0.5	3.3	1.9	<0.5	<0.5	<0.5	0.8
27-FEB-91	RTN	0.5	3.5	2	<0.5	<0.5	<0.5	1
22-MAY-91	RTN	0.5	5.6	3.6	<0.5	<0.5	<0.5	1.4
20-NOV-91	RTN	<0.5	2.5	<0.5	<0.5	<0.5	<0.5	2.6
27-AUG-92	RTN	0.7	6.6	4.5	<0.5	<0.5	<0.5	2.3
MW-148								
11-SEP-85	RTN	<1	<1	<1	<1	<1	<1	<1
27-NOV-85	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05-JUN-86	RTN	13	7.7	3.6	1.7	2.1	2.1	<0.5
03-SEP-86	RTN	16	12	0.6	0.9	<0.5	<0.5	<0.5
14-NOV-86	RTN	23	9.4	0.8	0.8	0.6	<0.5	<0.5
11-MAR-87	RTN	22	14	1	2	<0.5	<0.5	<0.5
20-MAY-87	RTN	23	19	0.6	1.6	<0.5	<0.5	<0.5
26-AUG-87	RTN	16	18	0.5	0.9	<0.5	<0.5	<0.5
19-NOV-87	RTN	17	17	0.7	1	0.5	<0.5	<0.5
23-MAR-88	RTN	6.2	7.9	<0.2	<0.4	<0.5	<0.4	<0.3
23-MAR-88	RTN	18	15	0.8	1.1	<0.5	<0.5	<0.5
02-JUN-88	RTN	16	15	0.6	0.9	<0.5	<0.5	<0.5
02-JUN-88	RTN	8.3	9.6	0.5	8.1	<0.5	<0.4	<0.3
12-AUG-88	RTN	11	10	<0.5	0.5	<0.5	<0.5	<0.5
05-DEC-88	RTN	7.4	6.7	<0.5	0.6	<0.5	<0.5	<0.5
17-MAR-89	RTN	9.6	10	<0.5	<0.5	<0.5	<0.5	<0.5
18-MAY-89	RTN	7.2	6.4	<0.5	<0.5	<0.5	<0.5	<0.5
01-DEC-89	RTN	4.7	3.5	<0.5	<0.5	<0.5	<0.5	<0.5
05-JUN-90	RTN	3.1	1.8	<0.5	<0.5	<0.5	<0.5	<0.5
29-NOV-90	RTN	1.4	1	<0.5	<0.5	<0.5	<0.5	<0.5
22-MAY-91	RTN	3.4	3	<0.5	<0.5	<0.5	<0.5	<0.5
22-MAY-91	DUP	2	1.7	<0.2	<0.4	<0.5	<0.4	<0.3
11-OCT-91	RTN	1.7	1.9	<0.5	<0.5	<0.5	<0.5	<0.5
11-JUN-92	RTN	1.2	1.5	<0.5	<0.5	<0.5	<0.5	<0.5
11-JUN-92	DUP	1.3	1.5	<0.5	<0.5	<0.5	<0.5	<0.5
31-AUG-93	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-202								
05-DEC-85	RTN	<1	<1	<1	<1	<1	<1	<1
18-JUN-86	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
23-APR-87	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
11-MAY-88	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
15-MAY-89	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
25-MAY-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
10-APR-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
10-APR-91	DUP	<0.5	<0.3	<0.2	<0.4	<0.5	<0.4	<0.3
MW-223								
27-AUG-86	RTN	<1	<1	<1	<1	<1	<1	<1
03-NOV-86	RTN	<0.5	0.5	<0.5	<0.5	<0.5	<0.5	<0.5
14-MAY-87	RTN	<1	<1	<1	<1	<1	<1	<1
13-AUG-87	RTN	<1	<1	<1	<1	<1	<1	<1
12-NOV-87	RTN	<1	<1	<1	<1	<1	<1	<1
03-FEB-88	RTN	<1	<1	<1	<1	<1	<1	<1
10-MAY-88	RTN	<1	<1	<1	<1	<1	<1	<1
03-AUG-88	RTN	<1	<1	<1	<1	<1	<1	<1
03-NOV-88	RTN	<1	<1	<1	<1	<1	<1	<1
07-FEB-89	RTN	<1	<1	<1	<1	<1	<1	<1
07-FEB-89	RTN	<1	<1	<1	<1	<1	<1	<1
11-MAY-89	RTN	<1	<1	<1	<1	<1	<1	<1
16-NOV-89	RTN	<1	<1	<1	<1	<1	<1	<1

TFG Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Location
(continued)						MW-147
<0.5	0.6	2.9	-	-	-	
<0.5	<0.5	2.7	-	-	-	
<0.5	<0.5	3.4	-	-	-	
<0.55	<0.49	3.5	-	-	-	
<0.5	1.1	3.9	-	-	-	
<0.55	2.4	5.3	-	-	-	
<0.5	1.1	2.4	-	-	-	
<0.5	1.7	5.5	-	-	-	
<0.5	1.4	3.7	-	-	-	
<0.5	1.1	4.4	-	-	-	
<0.5	0.8	<0.5	-	-	-	
<0.5	1.3	4.1	-	-	-	
<0.5	0.9	2.8	-	-	-	
<0.5	0.9	3.3	-	-	-	
<0.5	1	6	<0.5	<0.5	<0.5	
<0.5	1.6	9.2	-	-	-	
<0.5	0.6	<0.5	-	-	-	
<0.5	3.5	11	-	-	-	
						MW-148
<1	28	-	<1	<1	-	
<0.5	<0.5	<1	-	-	-	
<0.5	33	<0.5	-	-	-	
<0.5	18	<0.5	-	-	-	
0.5	23	<0.5	-	-	-	
<0.5	8	<0.5	-	-	-	
<0.5	9.9	<0.5	-	-	-	
<0.5	14	<0.5	-	-	-	
0.5	21	<0.5	-	-	-	
<0.6	74	<0.6	-	-	-	
<0.5	13	<0.5	-	-	-	
<0.5	12	<0.5	-	-	-	
<0.6	<0.5	<0.6	-	-	-	
<0.5	13	<0.5	-	-	-	
<0.5	10	<0.5	-	-	-	
<0.5	6.9	1.3	-	-	-	
<0.5	6.6	0.9	-	-	-	
<0.5	3.6	<0.5	-	-	-	
<0.5	2.2	<0.5	-	-	-	
<0.5	1	<0.5	-	-	-	
<0.5	1.9	<0.5	-	-	-	
<0.6	1.4	<0.6	-	-	-	
<0.5	0.6	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	0.5	<0.5	-	-	-	
						MW-202
<1	2	-	<1	<1	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	0.9	<0.5	-	-	-	
<0.5	0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.6	<0.5	<0.6	-	-	-	
						MW-223
<1	<1	-	<1	<1	-	
<0.5	0.8	2.4	-	-	-	
<1	4	-	<1	<1	-	
<1	4	-	<1	<1	-	
<1	6	-	<1	<1	-	
<1	6	-	<1	<1	-	
<1	7	-	<1	<1	<1	
<1	8	-	<1	<1	<1	
<1	10	-	<1	<1	<1	
<1	9	-	<1	<1	<1	
<1	9	-	<1	<1	<1	
<1	11	<1	<1	<1	<1	
<1	10	<1	<1	<1	<1	

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location		Total						
Date	Type	PCE	TCE	1,1 DCE	1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
MW-223 (continued)								
10-MAY-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
29-OCT-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
14-MAY-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
31-JUL-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
24-OCT-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
10-AUG-92	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
27-AUG-93	RTN	<1	<0.5	<1	<1	<1	<1	<1
MW-252								
27-NOV-85	RTN	4	3	4	<1	25	<1	<1
11-MAR-86	RTN	4.8	5.5	6.3	<0.5	53	<0.5	<0.5
05-JUN-86	RTN	7.7	6.6	11	<0.5	50	<0.5	<0.5
03-SEP-86	RTN	5.9	4.8	4.9	<0.5	29	<0.5	<0.5
14-NOV-86	RTN	1.8	2.5	2.2	<0.5	14	<0.5	<0.5
11-MAR-87	RTN	4.2	4.1	8.4	<0.5	30	<0.5	<0.5
20-MAY-87	RTN	3.7	4.3	14	<0.5	46	<0.5	<0.5
19-NOV-87	RTN	5.1	10	26	<0.5	38	<0.5	<0.5
11-MAY-88	RTN	5.3	11	7.9	<0.5	12	<0.5	<0.5
21-NOV-88	RTN	5.9	11	6.1	0.5	6.9	<0.5	<0.5
18-MAY-89	RTN	5.1	10	13	<0.5	14	<0.5	<0.5
01-SEP-89	RTN	6.4	14	17	<0.5	16	<0.5	<0.5
30-NOV-89	RTN	5.8	15	20	<0.5	9.9	<0.5	<0.5
27-FEB-90	RTN	6.8	16	15	<0.5	12	<0.5	<0.5
05-JUN-90	RTN	8	20	16	<0.5	12	<0.5	<0.5
30-NOV-90	RTN	8.2	21	14	<0.5	9.3	<0.5	<0.5
30-NOV-90	DUP	8.1	20	14	<0.5	9.6	<0.5	<0.5
19-MAR-91	RTN	9.5	28	18	<0.5	8.3	<0.5	<0.5
22-MAY-91	RTN	12	32	16	<0.5	8.2	<0.5	<0.5
08-AUG-91	RTN	12	32	14	<0.5	6.4	<0.5	<0.5
20-NOV-91	RTN	13	34	10	<0.5	5.5	<0.5	<0.5
24-MAR-92	RTN	15	39	13	<0.5	4.9	<0.5	<0.5
27-AUG-92	RTN	12	32	6.5	0.74	2.4	<0.5	<0.5
29-MAR-93	RTN	11	30	13	0.56	4	<0.5	<0.5
21-JUN-94	RTN	5.7	14	15	<0.5	2.8	<0.5	<0.5
MW-253								
05-DEC-85	RTN	<1	<1	<1	<1	<1	<1	<1
16-JUN-86	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
20-AUG-86	RTN	<0.5	0.7	<0.5	<0.5	<0.5	<0.5	<0.5
04-NOV-86	RTN	<0.5	0.6	<0.5	<0.5	<0.5	<0.5	<0.5
21-JUL-87	RTN	<0.5	2	<0.5	<0.5	<0.5	<0.5	<0.5
10-AUG-87	RTN	<0.54	1.1	<0.28	<0.4	<0.45	<0.44	<0.31
10-AUG-87	RTN	<0.5	4.1	<0.5	<0.5	<0.5	<0.5	<0.5
18-NOV-87	RTN	<0.5	3.1	<0.5	<0.5	<0.5	<0.5	<0.5
11-FEB-88	RTN	<0.5	2.8	<0.5	<0.5	<0.5	<0.5	<0.5
28-APR-88	RTN	<0.5	4.6	<0.5	<0.5	<0.5	<0.5	<0.5
20-JUL-88	RTN	<0.5	6.5	<0.5	<0.5	<0.5	<0.5	<0.5
08-NOV-88	RTN	<0.5	8.3	<0.5	<0.5	<0.5	<0.5	<0.5
17-FEB-89	RTN	<0.5	13	<0.5	<0.5	<0.5	<0.5	<0.5
11-MAY-89	RTN	<0.5	9.4	<0.5	<0.5	<0.5	<0.5	<0.5
15-AUG-89	RTN	<0.5	22	<0.5	<0.5	<0.5	<0.5	<0.5
02-NOV-89	RTN	<0.5	23	<0.5	<0.5	<0.5	<0.5	<0.5
08-FEB-90	RTN	<0.5	20	<0.5	<0.5	<0.5	<0.5	<0.5
16-MAY-90	RTN	<0.5	25	<0.5	<0.5	<0.5	<0.5	<0.5
14-AUG-90	RTN	<0.5	23	<0.5	<0.5	<0.5	<0.5	<0.5
14-AUG-90	DUP	<0.5	23	<0.5	<0.5	<0.5	<0.5	<0.5
01-NOV-90	RTN	<0.5	31	<0.5	<0.5	<0.5	<0.5	<0.5
21-FEB-91	RTN	<0.5	21	<0.5	<0.5	<0.5	<0.5	<0.5
30-JUL-91	RTN	<0.5	27	<0.5	<0.5	<0.5	<0.5	<0.5
30-JUL-91	DUP	<0.5	28	<0.5	<0.5	<0.5	<0.5	<0.5
26-AUG-92	RTN	<0.5	38	<0.5	<0.5	<0.5	<0.5	<0.5
13-SEP-93	RTN	<0.5	14	<0.5	<0.5	<0.5	<0.5	<0.5
13-SEP-93	RTN	<0.5	16	<0.5	<0.5	<0.5	<0.5	<0.5
26-JUL-94	RTN	<0.5	12	<0.5	<0.5	<0.5	<0.5	<0.5
MW-307								
11-MAR-87	RTN	12	150	5	<1	<1	<1	<1
21-MAY-87	RTN	12	160	5.6	<1	<1	<1	<1
26-AUG-87	RTN	17	200	7	<1	<1	<1	<1
20-NOV-87	RTN	1.5	130	6.3	<1	<1	<1	<1
02-JUN-88	RTN	17	180	8	<2	<2	<2	<2

TFG Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Location
(continued)						MW-223
<0.5	13	1.1	<0.5	<0.5	<0.5	
<0.5	10	0.7	<0.5	<0.5	<0.5	
<0.5	12	<0.5	<0.5	<0.5	<0.5	
0.8	15	<0.5	<0.5	<0.5	<0.5	
0.8	14	0.7	<0.5	<0.5	<0.5	
0.79	15	0.51	<0.5	<0.5	<0.5	
<1	1	1	<1	<1	<2	
						MW-252
<1	2	40	<1	<1	-	
<0.5	<0.5	51	-	-	-	
<0.5	2.8	51	-	-	-	
<0.5	1.8	32	-	-	-	
<0.5	1.8	12	-	-	-	
1.2	3.7	26	-	-	-	
<0.5	4.5	19	-	-	-	
3.5	9.5	32	-	-	-	
4.7	17	20	-	-	-	
4.5	25	20	-	-	-	
5.7	18	14	-	-	-	
6.2	16	13	-	-	-	
4.2	14	14	-	-	-	
5.5	9.5	8.4	-	-	-	
6.5	13	6.3	-	-	-	
5.6	14	8.8	-	-	-	
5.8	14	8.8	-	-	-	
8.1	17	<0.5	-	-	-	
11	21	14	-	-	-	
10	22	9.6	-	-	-	
15	22	8.2	-	-	-	
18	26	13	-	-	-	
16	24	10	-	-	-	
14	18	8.8	-	-	-	
4.7	12	6.1	-	-	-	
						MW-253
<1	1	-	<1	<1	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	1.1	3	-	-	-	
<0.5	1	1.5	-	-	-	
<0.5	0.7	1.7	-	-	-	
<0.55	0.5	2.2	-	-	-	
<0.5	1.3	2.1	-	-	-	
<0.5	1.5	1.9	-	-	-	
<0.5	0.6	1.9	-	-	-	
<0.5	1.3	2.2	-	-	-	
<0.5	1.6	3.2	-	-	-	
<0.5	1.7	2.9	-	-	-	
<0.5	1.3	2	-	-	-	
<0.5	1.1	1.5	-	-	-	
<0.5	2.2	2.4	-	-	-	
<0.5	1.1	<0.5	-	-	-	
<0.5	0.9	0.8	-	-	-	
<0.5	1.7	3.2	-	-	-	
<0.5	1.1	<0.5	-	-	-	
<0.5	1.1	<0.5	-	-	-	
<0.5	1.6	1.3	-	-	-	
<0.5	2.5	2	<0.5	<0.5	<0.5	
<0.5	2.4	1.2	-	-	-	
<0.5	2.6	1.3	-	-	-	
<0.5	3.5	2.5	-	-	-	
<0.5	2.3	<0.5	-	-	-	
<0.5	3	-	-	-	-	
<0.5	1.3	0.66	-	-	-	
						MW-307
2	3	-	2	<1	-	
2.6	2.4	<1	-	-	-	
2	4	-	<1	<1	-	
2.2	3.7	<1	-	-	-	
<2	4	-	<2	<2	<2	

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location		PCE	TCE	1,1 DCE	Total		1,1,1 TCA	1,1 DCA	1,2 DCA
Date	Type				1,2 DCE	1,2 DCE			
MW-307 (continued)									
02-JUN-88	RTN	11	140	10	<1	<1	<1	<1	<1
05-DEC-88	RTN	15	180	6	<1	<1	<1	<1	<1
31-MAY-89	RTN	15	140	6	<1	<1	<1	<1	<1
01-DEC-89	DUP	26	190	4	<1	<1	<1	<1	<1
01-DEC-89	DUP	25	190	4	<1	<1	<1	<1	<1
05-JUN-90	RTN	14	150	3.9	<0.5	0.6	0.6	<0.5	<0.5
30-NOV-90	RTN	26	160	3	<0.5	<0.5	<0.5	<0.5	<0.5
30-NOV-90	DUP	27	140	3	<0.5	<0.5	<0.5	<0.5	<0.5
22-MAY-91	RTN	28	120	<1	<1	<1	<1	<1	<1
22-MAY-91	DUP	27	110	<3	<3	<3	<3	<3	<3
20-NOV-91	RTN	29	120	2	<1	<1	<1	<1	<1
24-MAR-92	RTN	50	140	3	<1	<1	<1	<1	<1
11-JUN-92	RTN	34	100	<1	<1	<1	<1	<1	<1
27-AUG-92	RTN	40	150	2.6	<1	1.7	<1	<1	<1
20-NOV-92	RTN	48	110	2.3	<1	<1	<1	<1	<1
29-MAR-93	RTN	59	110	3.7	1.7	<1	<1	<1	<1
21-JUN-94	RTN	41	79	3.6	1.2	<0.5	<0.5	<0.5	<0.5
MW-464									
02-NOV-88	RTN	19	53	<1	<1	<1	<1	<1	<1
17-MAR-89	RTN	21	61	<0.5	0.5	0.6	<0.5	<0.5	<0.5
18-MAY-89	RTN	20	56	0.6	0.5	0.7	0.5	<0.5	<0.5
09-AUG-89	RTN	14	42	0.3	0.7	1.1	0.8	<0.3	<0.3
09-AUG-89	RTN	27	64	<0.5	0.5	0.7	0.8	<0.5	<0.5
01-DEC-89	RTN	24	50	<0.5	0.8	<0.5	1	<0.5	<0.5
27-FEB-90	RTN	24	52	<0.5	<0.5	1	<0.5	<0.5	<0.5
06-JUN-90	RTN	32	72	<0.5	<0.5	0.7	<0.5	<0.5	<0.5
06-JUN-90	DUP	29	66	<0.5	<0.5	0.6	<0.5	<0.5	<0.5
24-AUG-90	RTN	20	42	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
29-NOV-90	RTN	26	63	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
27-FEB-91	RTN	25	69	0.5	1	0.5	1	<0.5	<0.5
22-MAY-91	RTN	39	92	<0.5	1.5	<0.5	0.7	<0.5	<0.5
08-AUG-91	RTN	31	78	<0.5	1	<0.5	<0.5	<0.5	<0.5
20-NOV-91	RTN	36	83	<0.5	1.1	<0.5	<0.5	<0.5	<0.5
20-NOV-91	DUP	36	84	<0.5	1.2	<0.5	<0.5	<0.5	<0.5
24-MAR-92	RTN	42	110	<0.5	1.6	0.8	<0.5	<0.5	<0.5
27-AUG-92	RTN	28	79	<0.5	1.9	<0.5	0.88	<0.5	<0.5
29-MAR-93	RTN	21	41	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
20-SEP-93	RTN	12	35	0.8	<0.5	<0.5	<0.5	<0.5	<0.5
17-FEB-94	RTN	16	46	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-551									
01-NOV-88	RTN	<1	1	<1	<1	<1	<1	<1	<1
17-MAR-89	RTN	0.5	2.2	<0.5	0.7	<0.5	<0.5	<0.5	<0.5
31-MAY-89	RTN	1.4	3.1	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
10-AUG-89	RTN	1.9	4.7	<0.5	0.7	<0.5	<0.5	<0.5	<0.5
01-DEC-89	RTN	2.4	3.7	<0.5	0.8	<0.5	<0.5	<0.5	<0.5
27-FEB-90	RTN	3.6	4.4	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05-JUN-90	RTN	10	9.8	<0.5	1.4	<0.5	<0.5	<0.5	<0.5
05-JUN-90	DUP	8.4	7.7	<0.5	1.5	<0.5	<0.5	<0.5	<0.5
30-NOV-90	RTN	12	7.6	<0.5	1.7	<0.5	<0.5	<0.5	<0.5
27-FEB-91	RTN	14	8	0.5	2	<0.5	<0.5	<0.5	<0.5
22-MAY-91	RTN	26	15	0.8	3.4	<0.5	<0.5	<0.5	<0.5
08-AUG-91	RTN	21	12	0.8	2	<0.5	<0.5	<0.5	<0.5
20-NOV-91	RTN	28	16	0.6	2.8	<0.5	<0.5	<0.5	<0.5
24-MAR-92	RTN	37	21	0.6	2.6	<0.5	<0.5	<0.5	<0.5
27-AUG-92	RTN	38	19	<0.5	3	<0.5	<0.5	<0.5	<0.5
29-MAR-93	RTN	29	15	1.2	2.4	<0.5	<0.5	<0.5	<0.5
31-AUG-93	RTN	16	7.7	<0.5	1.6	<0.5	<0.5	<0.5	<0.5
21-JUN-94	RTN	23	10	0.6	2.1	<0.5	<0.5	<0.5	<0.5
MW-560									
07-MAR-89	RTN	<1	<1	<1	<1	<1	<1	<1	<1
08-MAR-89	RTN	-	-	-	-	-	-	-	-
11-MAY-89	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
18-AUG-89	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
30-NOV-89	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
06-FEB-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
07-MAY-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
19-JUL-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
09-OCT-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5

TFG Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Location
(continued)						MW-307
<1	4	<1	<1	<1	<2	
1	4	-	<1	<1	<1	
1	4	<1	<1	<1	<1	
<1	5	<1	<1	<1	<1	
<1	5	<1	<1	<1	<1	
1	5.2	<0.5	<0.5	<0.5	<0.5	
1	4.5	1	<0.5	0.8	<0.5	
1	5	1	<0.5	<0.5	<0.5	
<1	4	<1	<1	<1	<1	
<3	4	<3	<2	<2	<3	
<1	4	<1	<1	<1	<1	
2	5	<1	-	-	-	
<1	1	<1	-	-	-	
1.2	4.6	<1	-	-	-	
1	3.6	<1	-	-	-	
1.2	3.1	<2	-	-	-	
0.6	2.6	0.6	-	-	-	
8	20	20	<1	<1	<1	MW-464
12	10	12	-	-	-	
15	11	9.6	-	-	-	
10	8.4	<0.6	-	-	-	
17	16	14	-	-	-	
11	17	10	-	-	-	
12	20	8.6	-	-	-	
19	31	7.7	-	-	-	
17	28	7.2	-	-	-	
9.8	17	5.7	-	-	-	
11	18	6.2	-	-	-	
7	14	8.5	<0.5	<0.5	<0.5	
8.7	<0.5	12	-	-	-	
6.6	12	5	-	-	-	
6.7	22	8.5	-	-	-	
7.3	22	9.2	-	-	-	
12	22	8.1	-	-	-	
10	20	<0.5	-	-	-	
5.8	68	<1	-	-	-	
8.3	15	1.8	-	-	-	
7.5	10	2	-	-	-	
<1	10	1	<1	<1	<1	MW-551
0.9	9.2	2	-	-	-	
1.3	5	<0.5	-	-	-	
1.4	12	0.6	-	-	-	
0.9	7	0.6	-	-	-	
0.7	6.8	<0.5	-	-	-	
0.9	14	<0.5	-	-	-	
0.8	9.9	<0.5	-	-	-	
0.7	7.6	0.9	-	-	-	
1	6.5	2.5	<0.5	<0.5	<0.5	
1	11	2.1	-	-	-	
<0.5	6.7	1	-	-	-	
1.3	7.5	1.2	-	-	-	
1.5	10	3.1	-	-	-	
1.4	8.5	4.7	-	-	-	
1.4	7.7	2.5	-	-	-	
1	4.9	2.3	-	-	-	
0.7	5.4	2.7	-	-	-	
1	<1	-	<1	<1	<1	MW-560
-	-	-	<0.5	<0.5	<0.5	
0.6	<0.5	<0.5	-	-	-	
1.8	<0.5	<0.5	-	-	-	
1.6	<0.5	<0.5	-	-	-	
1	<0.5	<0.5	-	-	-	
1.6	<0.5	<0.5	-	-	-	
1.5	<0.5	<0.5	<0.5	<0.5	<0.5	
1.2	<0.5	<0.5	-	-	-	

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location						Total			
Date	Type	PCE	TCE	1,1 DCE	1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA	
MW-560 (continued)									
21-FEB-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
14-MAY-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
29-JUL-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
31-OCT-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
27-MAY-92	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
15-APR-93	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
20-APR-94	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
MW-618									
31-JUL-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
31-JUL-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
29-NOV-90	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
19-MAR-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
22-MAY-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
08-AUG-91	RTN	<0.5	2.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
20-NOV-91	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
11-JUN-92	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
20-NOV-92	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
18-JUN-93	RTN	<0.5	<0.3	<0.2	<0.4	<0.5	<0.4	<0.3	<0.3
21-JUN-94	RTN	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
TW-11									
22-APR-83	RTN	13	120	<5	<5	<5	<5	<5	<5
07-JUN-83	RTN	10	66	<1	<1	<1	<1	<1	<1
14-DEC-83	RTN	19	120	<1	<1	5	<1	<1	<1
29-MAR-84	RTN	13	68	5	<1	56	<1	<1	<1
27-NOV-84	RTN	11	72	<1	1	19	<1	<1	<1
27-NOV-84	RTN	12	70	<1	1	19	<1	<1	<1
21-FEB-85	RTN	15	72	<0.5	<0.5	17	<0.5	<0.5	<0.5
21-JUN-85	RTN	8.6	32	2.5	<0.5	9.7	<0.5	<0.5	<0.5
21-JUN-85	RTN	8	25	2.1	<0.5	7.4	<0.5	<0.5	<0.5
05-SEP-85	RTN	12	76	8.5	<0.5	39	<0.5	<0.5	<0.5
04-DEC-85	RTN	16	76	12	<0.5	100	<0.5	<0.5	<0.5
24-FEB-86	RTN	16	130	14	<0.5	55	<0.5	<0.5	<0.5
20-MAY-86	RTN	14	77	11	<0.5	27	1.8	<0.5	<0.5
09-SEP-86	RTN	14	110	9.3	<0.5	26	<0.5	<0.5	<0.5
02-DEC-86	RTN	12	110	7.8	<1	22	<1	<1	<1
29-JAN-87	RTN	<0.54	1.8	<0.28	<0.4	1	<0.44	<0.31	<0.31
29-JAN-87	RTN	16	91	11	<0.5	13	<0.5	<0.5	<0.5
01-JUN-87	RTN	17	150	11	<1	17	<1	<1	<1
01-DEC-87	RTN	12	170	12	<1	20	<1	<1	<1
27-MAY-88	RTN	9.6	91	8.3	<0.5	9.9	<0.5	<0.5	<0.5
03-NOV-88	RTN	8.4	86	6.6	<1	5.3	<1	<1	<1
03-NOV-88	RTN	5.3	60	5	<0.4	4.7	<0.4	<0.3	<0.3
11-MAY-89	RTN	6.9	64	4.3	<0.5	2.7	<0.5	<0.5	<0.5
30-NOV-89	RTN	6	37	2.9	<0.5	1.5	<0.5	<0.5	<0.5
07-MAY-90	RTN	3.9	35	1.8	<0.5	1	<0.5	<0.5	<0.5
09-OCT-90	RTN	3.1	34	<0.5	<0.5	0.5	<0.5	<0.5	<0.5
30-MAY-91	RTN	2.6	32	0.6	<0.5	<0.5	<0.5	<0.5	<0.5
27-MAY-92	RTN	<0.5	25	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
15-APR-93	RTN	1	14	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
TW-11A									
29-MAR-84	RTN	<1	10	<1	<1	<1	<1	<1	<1
16-MAY-84	RTN	<1	27	<1	<1	<1	<1	<1	<1
20-NOV-84	RTN	<1	13	<1	<1	<1	<1	<1	<1
14-FEB-85	RTN	<0.5	15	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
18-JUN-85	RTN	<0.5	11	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
05-SEP-85	RTN	<0.5	15	<0.5	<0.5	2.2	<0.5	<0.5	<0.5
04-DEC-85	RTN	<0.5	16	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
01-MAY-86	RTN	<0.5	11	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
09-SEP-86	RTN	<0.5	9.9	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
01-DEC-86	RTN	<0.5	11	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
04-DEC-86	RTN	<0.5	18	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
04-MAR-87	RTN	1.9	11	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
02-JUN-87	RTN	<0.5	18	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
01-DEC-87	RTN	<0.5	11	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
27-MAY-88	RTN	<0.5	8.4	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
29-NOV-88	RTN	<0.5	7	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5
11-MAY-89	RTN	<0.5	4.8	<0.2	<0.4	<0.5	<0.4	<0.3	<0.3
11-MAY-89	RTN	<0.5	6	<0.5	<0.5	<0.5	<0.5	<0.5	<0.5

TFG Area, recorded by September 15, 1994.

Carbon tetra-chloride	Chloro-form	Freon 113	Benzene	Toluene	Xylenes	Location
					(continued)	MW-560
1.5	<0.5	<0.5	<0.5	<0.5	<0.5	
0.6	<0.5	<0.5	-	-	-	
1	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
2.1	<0.5	<0.5	-	-	-	
1.6	<0.5	<1	-	-	-	
0.8	<0.5	<0.5	-	-	-	
						MW-618
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	<0.5	<0.5	<0.5	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
<0.6	<0.5	<0.6	-	-	-	
<0.5	<0.5	<0.5	-	-	-	
						TW-11
<5	36	-	<5	<5	-	
<1	28	-	<1	<1	-	
<1	30	-	<1	<1	-	
<1	35	-	<1	6	-	
<1	29	-	<1	<1	-	
<1	30	-	<1	<1	-	
<0.5	18	-	-	-	-	
<0.5	6.7	-	-	-	-	
<0.5	12	-	-	-	-	
3.1	30	-	<0.5	<0.5	<1	
<0.5	58	<0.5	-	-	-	
<0.5	43	-	-	-	-	
<0.5	32	<0.5	-	-	-	
<0.5	28	<0.5	-	-	-	
<1	28	<1	-	-	-	
<0.55	<0.49	<0.62	-	-	-	
<0.5	13	<0.5	-	-	-	
<1	25	<1	-	-	-	
<1	29	<1	-	-	-	
<0.5	22	<0.5	-	-	-	
<1	19	<1	-	-	-	
<0.6	13	<0.6	-	-	-	
0.6	11	1.5	-	-	-	
<0.5	8.1	<0.5	-	-	-	
<0.5	5.2	<0.5	-	-	-	
<0.5	4.4	<0.5	-	-	-	
<0.5	3.9	<0.5	-	-	-	
<0.5	0.5	<0.5	-	-	-	
0.61	2.1	<1	-	-	-	
						TW-11A
<1	8	-	<1	4	-	
<1	13	-	<1	<1	-	
<1	9	-	<1	<1	-	
<0.5	6.6	-	-	-	-	
<0.5	<0.5	-	-	-	-	
1.5	10	-	<0.5	<0.5	<1	
2.2	11	<0.5	-	-	-	
1.2	5	<0.5	-	-	-	
1.8	6.5	<0.5	-	-	-	
1.8	8.2	<0.5	-	-	-	
<0.5	13	-	-	-	-	
2.2	8.3	<0.5	-	-	-	
3.4	11	<0.5	-	-	-	
3.2	11	1.6	-	-	-	
1.5	10	<0.5	-	-	-	
2	12	<0.5	-	-	-	
1.9	8.5	<0.6	-	-	-	
1.2	8.2	<0.5	-	-	-	

Table A-2. Ground water analyses (ug/L) for volatile organic compounds in the

Location					Total			
Date	Type	PCE	TCE	1,1 DCE	1,2 DCE	1,1,1 TCA	1,1 DCA	1,2 DCA
TW-11A (continued)								
30-NOV-89	DUP	0.5	6.7	<0.5	<0.5	0.5	<0.5	<0.5
30-NOV-89	DUP	<0.5	6.6	<0.5	<0.5	<0.5	<0.5	<0.5
09-OCT-90	RTN	<0.5	8.5	<0.5	<0.5	<0.5	<0.5	<0.5
30-MAY-91	RTN	<0.5	12	<0.5	<0.5	<0.5	<0.5	<0.5
31-OCT-91	RTN	<0.5	9.1	<0.5	<0.5	<0.5	<0.5	<0.5
27-MAY-92	RTN	<0.5	7.7	<0.5	<0.5	<0.5	<0.5	<0.5
26-OCT-92	RTN	<0.5	9.1	<0.5	<0.5	<0.5	<0.5	<0.5
15-APR-93	RTN	<0.5	4.2	<0.5	<0.5	<0.5	<0.5	<0.5
06-DEC-93	RTN	<0.5	3.9	<0.5	<0.5	<0.5	<0.5	<0.5

TFG Area, recorded by September 15, 1994.

Carbon tetra- chloride	Chloro- form	Freon 113	Benzene	Toluene	Xylenes	Location
						(continued) TW-11A
1.7	12	<0.5	-	-	-	
1.5	12	<0.5	-	-	-	
1.9	12	<0.5	-	-	-	
2.1	13	<0.5	-	-	-	
1.9	12	<0.5	-	-	-	
2.4	9.9	<0.5	-	-	-	
2.8	10	<0.5	-	-	-	
1.7	7.7	<1	-	-	-	
<0.5	6.3	<0.5	-	-	-	

Appendix B

**Waste Discharge Requirement Order
Nos. 91-091 and 88-075**

Order No. 88-075

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION

ORDER NO. 88-075

WASTE DISCHARGE REQUIREMENTS FOR:

U. S. DEPARTMENT OF ENERGY,
and
LAWRENCE LIVERMORE NATIONAL LABORATORY
LIVERMORE
ALAMEDA COUNTY

The California Regional Water Quality Control Board, San Francisco Bay Region, hereinafter called the Board, finds that:

1. Lawrence Livermore National Laboratories (LLNL), operates a research facility under contractual agreements with the U. S. Department of Energy (DOE). Discharge is proposed to be made under this Order onto adjoining DOE real property. Lawrence Livermore National Laboratory and the U. S. Department of Energy are hereinafter both referred to as dischargers. For the purposes of this Order, DOE will be responsible for compliance in the event that LLNL fails to comply with the requirements of this Order.
2. The dischargers propose to discharge extracted and treated ground water to land as part of a pilot study extraction test. The pilot test and proposed discharge are described in the dischargers' technical report entitled "Proposal for Pilot Ground Water Extraction and Treatment West of LLNL", submitted December 24, 1987, and in the application for NPDES Permit No. CA0029289, dated August 3, 1987.
3. The pilot study extraction test is intended to develop design criteria for preparation of proposed remedial alternatives under the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA, 1980) and the Superfund Amendments and Reauthorization Act (SARA, 1986). This pilot study will include the construction and testing of three treatment systems, each receiving influent from one to three extraction wells, and is proposed to occur through May 1, 1990. Two of the treatment systems will discharge treated waste ground water to existing surface drainage systems and are covered under NPDES Permit No. CA0029289. The third treatment system (Treatment System A) will discharge treated waste ground water to the ground at locations not covered under the NPDES permit.

4. This Order will allow discharge of treated waste ground water from Treatment System A to be discharged: to a percolation pond (on adjoining DOE property) located approximately 4000 feet southeast of LLNL's southwest site boundary corner by pipeline from Treatment System A; to land south of LLNL's property boundary (adjoining DOE property) by general areal irrigation; or to LLNL site property grounds vegetation by irrigation. One or a combination of these proposed discharge methods will be used by LLNL to dispose of extracted and treated ground water. Treatment System A will receive influent from two or three new extraction wells for a total flow of up to 144,000 gallons per day.
5. Soil and ground water beneath the LLNL site, and offsite to the southwest, have been found to be polluted halogenated organic compounds, primarily solvents such as trichloroethylene and tetrachloroethylene, and petroleum hydrocarbons. Suspected releases have occurred from onsite landfills, storage facility spillage, underground tank and pipeline leakage, and past discharges to the site storm drain system.
6. Hydrogeologic investigation of the site and offsite soil and ground water pollution continues, under CERCLA/SARA regulations, in order to determine the full extent of pollution and the extent and migration characteristics of existing contaminant plumes.
7. Proposed treatment of polluted ground water extracted as part of the pilot extraction test study will be by air stripping prior to discharge to the ground defined in Finding 4. Treatment of the extracted ground water will meet the effluent limitations as set forth in this Order.
8. The Regional Board adopted a revised Water Quality Control Plan for the San Francisco Bay Region (Basin Plan) on December 17, 1986. The Basin Plan contains water quality objectives and discharge prohibitions for the Livermore-Amador valley and all of its subbasins.
9. The existing and potential beneficial uses for surface waters in the Livermore-Amador ground water basin including Arroyo Mocho, Arroyo Seco, Arroyo Las Positas, Arroyo de la Laguna and their tributaries are:
 - a. contact and non-contact water recreation,
 - b. wildlife habitat,
 - c. ground water recharge, and
 - d. fish migration and spawning.

10. The existing and potential beneficial uses of the ground waters underlying the Livermore-Amador ground water basin and its subbasins are:
 - a. municipal and domestic supply;
 - b. industrial supply,
 - c. industrial service supply, and
 - d. agricultural supply.
11. The LLNL site is located in the eastern portion of the Livermore-Amador ground water basin, in the Spring and Mocho I subbasins. This part of the Livermore-Amador ground water basin is documented as a ground water recharge area in the Basin Plan and in technical reports submitted by the dischargers. One goal of these Waste Discharge Requirements is to restore extracted and treated waste ground water to the Spring and Mocho I ground water aquifers. The effluent limits of this Order are not expected to adversely impact the ground water in the Spring and Mocho I subbasins.
12. The project constitutes a minor modification to land and such activity is thereby exempt from the provisions of the California Environmental Quality Act in accordance with Section 15304, Title 14, of the California Administrative Code.
13. The dischargers and interested persons have been notified of the Board's intent to issue waste discharge requirements for the proposed discharge and have been provided with the opportunity for a public hearing and to submit their written comments and recommendations.
14. The Board, at a properly-noticed public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED, pursuant to the provisions of Division 7 of the California Water Code and regulations adopted thereunder, that the dischargers shall comply with the following:

A. PROHIBITIONS

1. The treatment, storage and discharge of treated waste ground water shall not create a nuisance as defined in Section 13050(m) of the California Water Code.
2. There shall be no bypass or overflow of untreated or inadequately treated waste ground water to waters of the State from the dischargers' wastewater collection, treatment or distribution facilities.

3. No waste ground water shall be allowed to escape from the designated disposal areas as either surface flow or as airborne spray.
4. The discharge of waste other than treated waste ground water, as defined in this Order, is prohibited.
5. The discharge of waste ground water to disposal areas other than those stipulated in this Order is prohibited.
6. For treated waste ground water discharged to a percolation pond:
 - a. A minimum of 2 feet of freeboard shall be maintained in the pond at all times to prevent the threat of overflow.
 - b. The pond shall be adequately protected from erosion and washout which may result from a rainfall event having a predicted frequency of once in 100 years.
7. For treated waste ground water discharged to the land by irrigation:
 - a. No waste ground water shall be applied to the irrigation area during prolonged periods of rainfall or when soils are saturated.
8. For treated waste ground water discharged to LLNL site vegetation by irrigation:
 - a. The public shall be effectively excluded from the irrigation disposal area by irrigation at night or early morning when wind velocity is minimal.
 - b. The public shall be notified of the use of treated waste ground water through use of warning signs or similar to comply with this requirement.
 - c. No waste ground water shall be applied to the irrigation areas during prolonged periods of rainfall or when soils are saturated.
9. Discharge of waste ground water in any of the disposal areas shall cease immediately when any prohibition or specification is violated.

B. Discharge Specifications

1. The discharge of waste ground water shall not degrade the quality of any ground water suitable for domestic use or cause an increase in any quality parameter that would make ground water unsuitable for irrigation use.
2. The waste ground water shall at all times meet the following quality limits prior to disposal:

<u>Constituent</u>	<u>Units</u>	<u>Instantaneous Maximum</u>
<u>Metals</u>		
Antimony	mg/l	1.46
Arsenic	ug/l	500
Beryllium	ug/l	0.68
Boron	mg/l	7
Cadmium	ug/l	100
Chromium +3	mg/l	1700
Chromium +6	ug/l	500
Copper	mg/l	2
Iron	mg/l	3
Lead	ug/l	500
Manganese	ug/l	500
Mercury	ug/l	20
Nickel	ug/l	134
Selenium	ug/l	100
Silver	ug/l	500
Thallium	ug/l	130
Zinc	mg/l	20

Volatile Organic Compounds

Total Volatile Organic Compounds	ug/l	5
----------------------------------	------	---

Total Volatile Organic Compounds include, but are not limited to:

Benzene, Bromoform, Carbon Tetrachloride, Chlorobenzene, Chlorodibromomethane, Chloroethane, Chloroform, 1,1-Dichloroethane, 1,2-Dichloroethane, 1,1-Dichloroethylene, 1,2-Dichloropropane, Ethyl Benzene, Tetrachloroethylene, Toluene, trans-1,2-Dichloroethylene, 1,1,1-Trichloroethane, 1,1,2-Trichloroethane, Trichloroethylene, Trichlorofluoromethane, Xylene(s), Vinyl Chloride

Acid Extractable Organic Compounds

2,4-Dimethylphenol	ug/l	400
Phenol	ug/l	5
2,4,6-Trichlorophenol	ug/l	5

Base/Neutral Extractable Organic Compounds


1,4-Dichlorobenzene	ug/l	5
Napthalene	ug/l	620
Phenanthrene	ug/l	5
Pyrene	ug/l	5

C. Provisions

1. The dischargers shall comply with all sections of this Order immediately upon adoption.
2. The dischargers shall comply with a Self-Monitoring Program as ordered by the Executive Officer.
3. The dischargers shall permit the Board or its authorized representatives in accordance with California Water Code Section 13267(c):
 - a. Entry upon premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order;
 - b. Access at reasonable times to any records that must be kept under the conditions of this Order;
 - c. Inspection at reasonable times of any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
 - d. To sample and monitor at reasonable times for the purpose of assuring compliance with this Order.
4. The dischargers shall maintain in good working order and operate, as efficiently as possible, any facility or control system installed or as modified to achieve compliance with this Order.
5. A contingency plan shall be developed outlining the actions to be taken in the event effluent quality fails to meet required standards. The plan must be submitted for review, to the satisfaction of the Executive Officer, prior to the startup of any disposal activity.

6. In the event of any change in control or ownership of land or treatment facilities presently owned or controlled by the dischargers, the dischargers shall notify the succeeding owner or operator of the existence of this Order by a letter, a copy of which shall be forwarded to this Board.
7. The dischargers shall file with the Board a report of waste discharge at least 120 days before making any material change in the character, location or volume of the discharge.
8. The Board will review this Order periodically and may revise the requirements when necessary.

I, Roger B. James, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, San Francisco Bay Region, on May 18, 1988.


for ROGER B. JAMES
Executive Officer

Attachments:

- A. Site Map
- B. Self-Monitoring Program

File No. 2199.9026 (MDK)

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION

SELF-MONITORING PROGRAM

FOR

U. S. Department of Energy

and

Lawrence Livermore National Laboratory

Livermore, Alameda County

ORDER NO. 88-075

U. S. DEPARTMENT OF ENERGY
and
LAWRENCE LIVERMORE NATIONAL LABORATORY

I. GENERAL

Reporting responsibilities of waste dischargers are specified in Sections 13225(a), 13267(b), 13268, and 13387(b) of the California Water Code and this Regional Board's Resolution No. 73-16.

The principal purposes of a monitoring program by a waste discharger, also referred to as a self-monitoring program, are:

1. To document compliance with waste discharge requirements and prohibitions established by the Regional Board.
2. To facilitate self-policing by the waste dischargers in the prevention and abatement of pollution arising from discharge of waste ground water.

II. SAMPLING AND ANALYTICAL METHODS

Sample collection, storage, and analyses shall be performed according to the 40 CFR 136 or other methods approved and specified by the Executive Officer of this Regional Board.

Water and waste analyses shall be performed by a laboratory approved for these analyses by the State Department of Health Services (DHS) or a laboratory waived by the Executive Officer from obtaining a certification for these analyses by the DHS. The director of the laboratory whose name appears on the certification or his/her laboratory supervisor who is directly responsible for analytical work performed shall supervise all analytical work including appropriate quality assurance/quality control procedures in his/her laboratory and shall sign all reports of such work submitted to the Regional Board.

All monitoring instruments and equipment shall be properly calibrated and maintained to ensure measurement accuracy.

III. DEFINITION OF TERMS

1. Grab Sample is an individual sample collected in a short period of time not exceeding 15 minutes. Grab samples shall be collected during normal peak loading

conditions for the parameter of interest, which may or may not be during hydraulic peaks. It is used primarily in determining compliance with daily maximum and instantaneous maximum limits. Grab samples represent only the conditions that exist at the time the waste water is collected.

2. Flow Sample is the accurate measurement of the average daily flow volume using a properly calibrated and maintained flow measuring device. In this case, a flow sample would measure the average daily flow from Treatment System A, and into each of the disposal areas.
3. Instantaneous Maximum is the highest measurement for the calendar day.
4. Site Map is a topographic-based map of suitable scale to show features of interest and allow accurate scale measurements to be made from the map.

IV. SPECIFICATIONS FOR SAMPLING AND ANALYSIS

The Dischargers are required to perform observations, sampling and analyses as stipulated in the schedules of Tables 1, 2 and 3, and in accordance with the following conditions.

1. Influent
Samples of influent shall be collected on random days at the frequency stipulated in Table 1. Samples shall not include any sidestream wastes or other influent sources not covered under this Order. Deviation from this must be approved by the Executive Officer.
2. Effluent
 - a. Effluent sampling shall be coincident with influent sampling according to the schedule of Table 1, unless otherwise stipulated. The Board or Executive Officer may approve an alternative sampling plan if it is demonstrated to the Board's satisfaction that expected operating conditions warrant a deviation from the standard sampling plan.
 - b. If any instantaneous maximum limit is exceeded, the sampling frequency shall be increased to daily until two samples collected on consecutive days show compliance with the instantaneous maximum limit.

3. Percolation Pond

- a. Pond sampling shall be coincident with influent and effluent sampling unless otherwise stipulated. As in Section IV.2.a. above, an alternative plan may be approved by the Board or Executive Officer if warranted.
- b. Water samples shall be taken one foot below the water surface in the pond, and no less than two feet from the bank.
- c. The method of sampling shall be described in the self-monitoring report, and shall follow existing EPA or similar standards for impoundment sampling.

4. Soil Sampling

- a. Soil sampling may be coincident with influent, effluent and pond sampling. Samples shall be taken at specified points in the pond bottom, irrigated field and irrigated vegetation areas to determine if any buildup of contaminants in the soil is occurring.
- b. Initial soil samples shall be taken for the pond and irrigated field disposal areas, at the locations stipulated herein, upon adoption of this Order and prior to any discharge. These samples will be considered background level samples. Irrigated on site vegetation areas may be sampled initially at a time prior to first discharge of treated waste ground water.
- c. The method of soil sampling shall be described in the self-monitoring report, and shall follow existing EPA or similar standards for soil sampling.
- d. Soil samples shall be analyzed for all constituents represented in NPDES Permit No. CA0029289, Effluent Limitations, Section A.2.
- e. Soil samples from the percolation pond shall be taken of bottom sediments and also in situ soils at discreet depths. Soil samples from irrigated areas shall also be taken from discreet depths near the ground surface and 1 to 1 1/2 feet below ground surface as described in Section V.4., below.

5. Land Observations

Observations and measurements made of site conditions at confined or unconfined waste ground water disposal areas.

For confined disposal areas, or a percolation pond:

- a. Measurement of freeboard shall be made at the lowest elevation point in the dike or sidewalls confining the liquid waste ground water in the pond. There shall be a minimum of 2 feet of freeboard, or distance between the water surface and lowest elevation point in the dike/sidewalls of the pond. Freeboard shall be measured routinely on a weekly basis, and more frequently (ie., at least once daily) during periods of intense precipitation.
- b. Evidence of leakage, seepage, or overflow due to erosion of confining dike or pond sidewalls, with the affected area shown on a site map with an estimate of overflow volume.
- c. Presence or absence of odor, its characterization, source, and distance of travel.
- d. Estimated number of waterfowl and other water-associated birds in the pond area and vicinity.
- e. Estimate of volume and rate of recharge.
- f. Weather conditions including average air temperature and total precipitation during the intervening time between samples to include the day of sampling.

For unconfined disposal areas, or irrigation to field or on site vegetation areas:

- a. Evidence of waste water escaping the disposal area as surface runoff or spray, shown as affected area on a site map.
- b. Evidence of waste water ponding and any mosquito breeding problem within irrigated area due to excessive irrigation.
- c. Presence or absence of odor, its characterization, source, and distance of travel.
- d. Estimate of volume and rate of recharge.

- e. Weather conditions including air temperature, total precipitation during the intervening time between samples to include the day of sampling, and estimated wind direction and velocity.
- f. Warning signs or notices adequately posted to inform the public of the disposal of treated waste ground water by irrigation.

V. DESCRIPTION OF SAMPLING STATIONS

<u>Station</u>	<u>Description</u>
1. <u>Influent</u>	
I-001	At a point in ground water extraction, collection and treatment, utilizing Treatment System A (located near MW-103), immediately prior to treatment. This is the same I-001 station under NPDES Permit No. CA0029289, therefore the NPDES sample analytical results may be reported in this self-monitoring report according to the schedule of Table 1.
2. <u>Effluent</u>	
E-1	At a point in the effluent conveyance line immediately prior to discharge into the percolation pond. If more than one discharge point into the pond exists, then additional effluent points will be required.
E-2	At a point in the effluent conveyance line immediately prior to discharge into the field irrigation system.
E-3	At a point in the effluent conveyance line immediately prior to discharge into the irrigation to vegetation system.
3. <u>Percolation Pond</u>	
C-1, C-2	At opposing points in the pond. Samples of pond water shall be taken as noted in the sampling specifications in Section IV.3. above.

4. Soil

- B-1, B-2 Percolation pond bottom sediment samples taken at opposing sides or ends of the pond. Samples shall be taken of pond bottom sediments to a depth no greater than about 4 inches.
- B-3, B-4 Percolation pond in situ soil samples taken at opposing sides or ends of the pond, and adjacent to sample B-1 and B-2 locations. Samples shall be taken at a discreet depth of 1 or 1 1/2 feet below the pond bottom.
- B-5 to B-'N' At points spaced equidistantly around areas of irrigation. Samples shall be taken in sets at the same or adjacent locations, at discreet depths of about 4 inches and 1 or 1 1/2 feet for irrigated fields, and 4 inches and 1 foot for irrigated vegetation. Each sample set shall represent about 25% of the area of irrigated field, and an area greater than 1000 feet square feet for irrigated onsite vegetation.

5. Land Observations

- L-1 to L-4 Located at quarter-points of the pond periphery. Observations shall be taken in accordance with Table 2.
- L-5 to L-'N' Located at points equidistant around periphery of irrigated areas. Points shall be spaced at no greater than 400 feet.

VI. RECORDS TO BE MAINTAINED

1. Written reports, calibration and maintenance records, sampling and analytical records, and other compliance records shall be maintained by the dischargers at their facility. The records shall be available at the dischargers' facility for a period equal to the length of this Order. The retention time may be extended due to unresolved litigation or by request from the Regional Board or U. S. Environmental Protection Agency, Region IX.

2. Tabulation of flow data to include total flow volume per day and minimum/maximum daily flows.
3. Tabulation of treatment system bypassing or accidental waste spills shall be maintained and for each occurrence shall include: contaminant involved; quantity; length of time; cause; spill prevention/control plan in effect; effects; corrective measures taken; agencies notified.

VII. REPORTS TO BE FILED WITH THE REGIONAL BOARD

1. **Report of Permit Violations**
In the event the dischargers violate or threaten to violate the conditions of the waste discharge requirements, the dischargers shall notify the Regional Board office as soon as they or their agents have knowledge of the incident. Notice by telephone may be made to (415)464-1255, with a written confirmation report forwarded within 7 working days of telephone notification. The written report shall include the information stipulated in Section VI.3. above.
2. **Self-Monitoring Reports**
 - a. Written reports shall be filed regularly for each month, and shall be submitted by the fifteenth day of the following month. The reports may be included as part of the monthly reports required under NPDES Permit No. CA0029289.
 - b. Written reports shall include:
 - 1) Letter of Transmittal - discussions of permit violations for the past month to summarize details required in Section VI.3. above, and a of proposed corrective schedules for previous violation. The letter shall be certified as to veracity and correctness by signature of an authorized representative or responsible official of the dischargers'.
 - 2) Data - to include flow data, sampling methodologies, analytical results for the sampling schedule of Table 1, and observations in accordance with Tables 2 and 3. Analytical results shall be presented in tabular form by station, date and type of sample.

- 3) Compliance with Standard Observations - completed forms for Tables 2 and 3 shall accompany the self-monitoring report.
- 4) Site Map - a site map for all disposal areas shall accompany monthly reports showing locations of sample and observation stations, and any violation locations and effects.

c. Sampling Data Summary

A copy of the monthly self-monitoring report shall be submitted to the EPA's Superfund Division. Send reports to:

- a) Executive Officer
California Regional Water Quality
Control Board
San Francisco Bay Region
1111 Jackson Street, Room 6000
Oakland, California 94607
- b) Regional Administrator
U. S. Environmental Protection Agency
Superfund Division
215 Fremont Street
San Francisco, California 94105


3. Annual Reporting

By January 30 of each year, the dischargers shall submit, in place of the end of the year monthly report, an annual report to the Regional Board covering the previous calendar year. The report may be part of the annual report submitted in compliance with NPDES Permit No. CA0029289. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the report shall contain a comprehensive discussion of the compliance record and the corrective actions taken or planned which may be needed to bring the dischargers into full compliance with the waste discharge requirements.

I Roger B. James, Executive Officer, hereby certify that the foregoing Self-Monitoring Program:

1. Has been developed in accordance with the procedure set forth in this Regional Board's Resolution 73-16 in order to obtain data and document compliance with waste discharge requirements established in Regional Board Order No. 88-075.

2. Is effective on the date shown below.
3. May be reviewed at any time subsequent to the effective date upon written notice from the Executive Officer or request from the dischargers, and revisions will be ordered by the Executive Officer.


for ROGER B. JAMES
Executive Officer

Effective Date: May 18, 1988

Attachments: Disposal Area Location Map
Sample Stations For A Typical Percolation Pond
Table 1
Table 2
Table 3

DISPOSAL AREA LOCATION MAP

Remedial Design Report No. 5
May 1, 1995

UCRL-AR-116583

LLNL

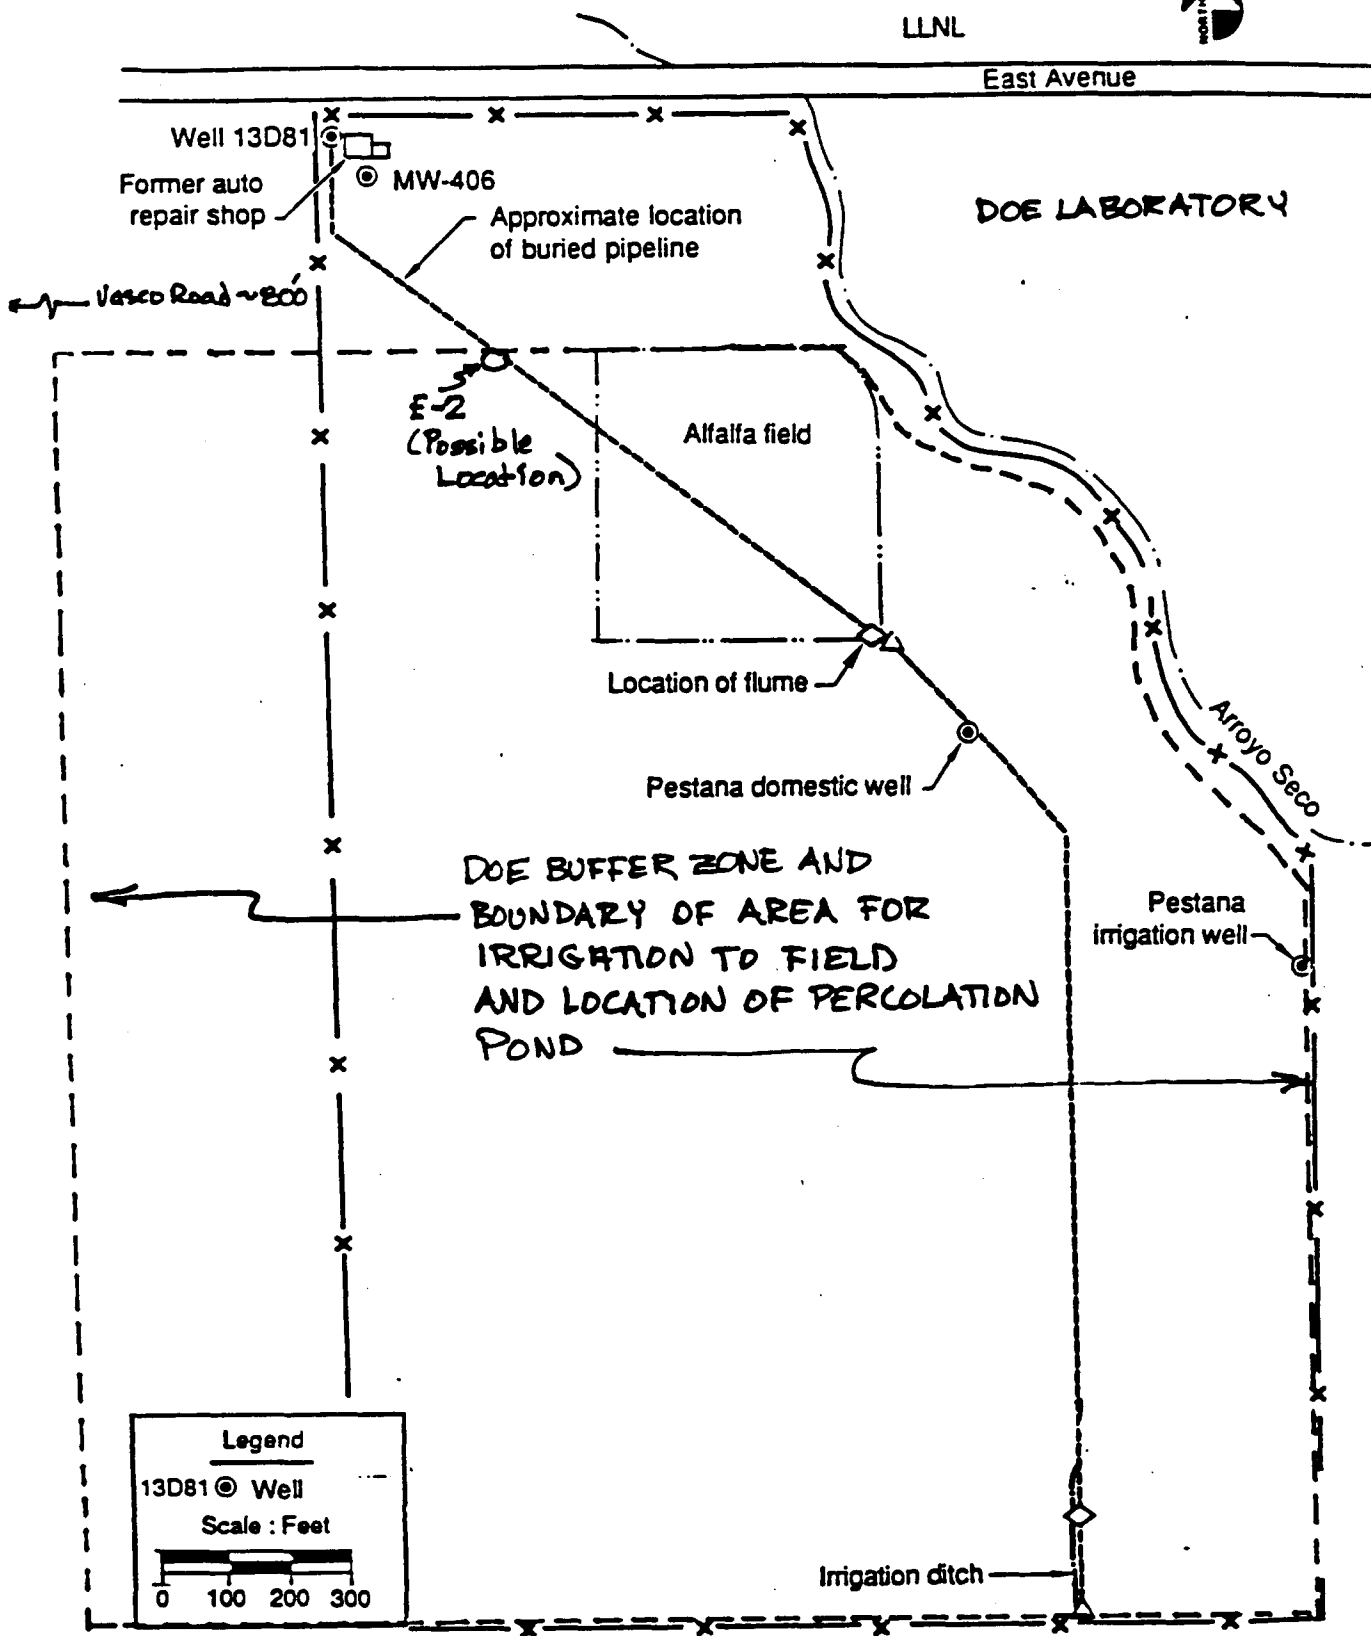


Figure 3. Former Pestana property layout.

SAMPLING STATIONS FOR TYPICAL PERCOLATION POND

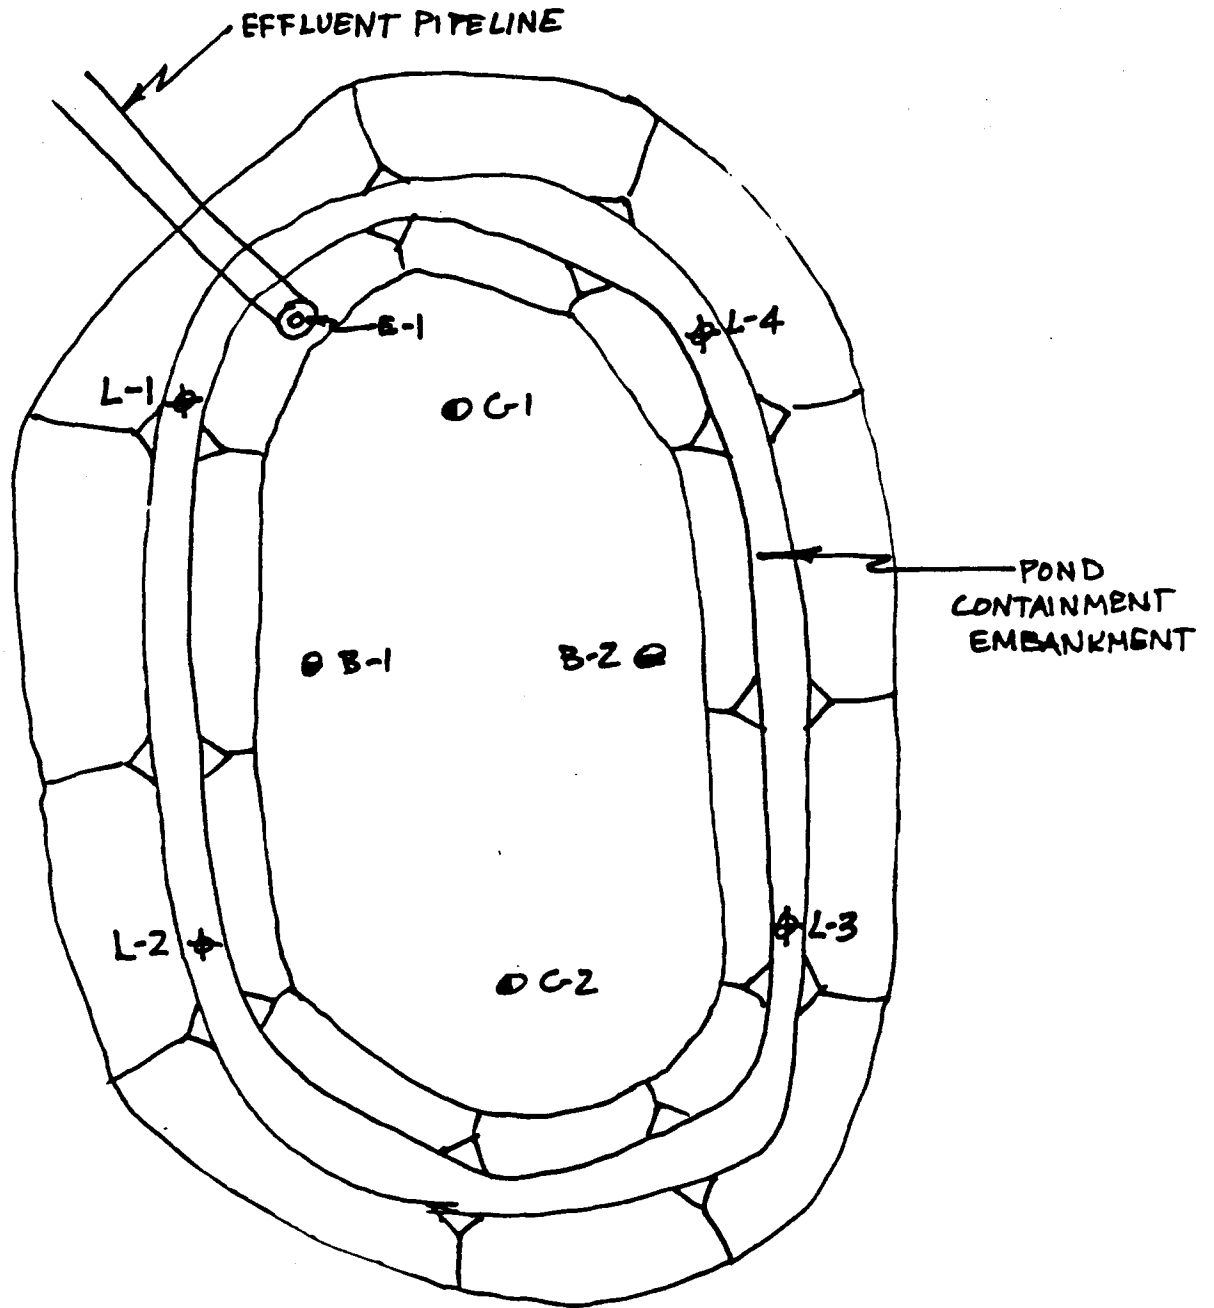


Table 1
SCHEDULE FOR SAMPLING, MEASUREMENTS, AND ANALYSIS
LAWRENCE LIVERMORE NATIONAL LABORATORY, AND
U. S. DEPARTMENT OF ENERGY

Sampling Station	I-001	E-1 to E-3	C-1, C-2	B-1, B-2	B-3, B-4	B-5 to B-N	L-1 to L-N
Sample Type	G	G	G	BS	BI	BI	O
Flow Rate (mgd)	D	D					
Fish Tox'y (1)		Q	S				
Turbidity (2)		Q					
pH, units	M	M					
Temperature, C		M					
Metals (3) mg/l, kg/day	I/S	I/S	S	B/A	B/A	B/A	
Gross alpha/ gross beta particles, tritium		I/A	S	B/A	B/A	B/A	
All Applicable Standard Observations							W
EPA 8040, ug/kg				B/A	B/A	B/A	
EPA 8240, ug/kg				B/A	B/A	B/A	
EPA 8270, ug/kg				B/A	B/A	B/A	
EPA 601 ug/l, kg/l	W/M	D/W	Q				
EPA 624 ug/l, kg/l	I/A*	I/A*	I/A*				
EPA 602 & 625 ug/l, kg/l	I/A	I/A	I/A				
Chlorides	Q	Q	Q				

Table 1 (continued)
SCHEDULE FOR SAMPLING, MEASUREMENTS, AND ANALYSIS

LEGEND FOR TABLE 1

Types of Stations

I = influent
E = effluent
C = receiving water
L = pond embankment or
irrigated area periphery
B = soil sample at pond
bottom or in irrigated
area

Types of Samples

G = grab
BS = soil samples of pond
bottom sediments
BI = soil samples of in situ
soil below pond bottom or
in irrigated areas
O = observation

Frequency of Sampling

D = daily, once each day
W = weekly, once each week
M = monthly, once each month
Q = quarterly, once each March,
June, September and December
S = semiannually, twice each year
B/A = one sample immediately
prior to discharge, then
annually

D/W = daily for the first week
then weekly
W/M = weekly for the first 4
weeks, then monthly
I/A = one sample during the
first week of discharge,
then annually
I/S = one sample during the
first week of discharge,
then semiannually

Notes

- (1) Fish Toxicity, 96 hours, survival in undiluted waste
- (2) Jackson turbidity units
- (3) Metals to include: antimony, arsenic, beryllium, boron, cadmium, chromium (total), copper, cyanide, iron, lead, manganese, mercury, nickel, selenium, silver, thallium, zinc

Table 2
LAND OBSERVATIONS AT PERCOLATION POND
DISCHARGERS' SELF-MONITORING REPORT

1. Dischargers: U. S. Department of Energy, and
Lawrence Livermore National Laboratory,
2. Reporting Period: Month _____ Year _____
3. Circle dates treated waste ground water discharged to
percolation pond: 1 2 3 4 5 6 7 8 9 10 11 12 13
14 15 16 17 18 19 20 21 22 23 24 25 26 27 28
29 30 31
4. Total flow volume for reporting month: _____ gallons
5. Estimated recharge: _____
6. Weather conditions: Average Air _____ Total
Temperature _____ Precip _____
7. Estimated number of waterfowl in pond vicinity: _____
8. Required weekly land observations, in feet for freeboard and
'yes' or 'no' for other observations, for weeks of reporting
month:

Weeks for Reporting Month

Date and Time

Feet of freeboard

Evidence for leakage
or overflow

Odor from waste water

9. If less than 2 feet of freeboard or yes to any of above, a
written report shall be submitted as per section VII.1.,
Self-Monitoring Program.
10. I certify that the information in this report, to the best
of my knowledge, is true and correct.

Inspector
Signature _____

Date _____

Table 3
LAND OBSERVATIONS IN IRRIGATED AREAS
DISCHARGERS' SELF-MONITORING REPORT

1. Dischargers: U. S. Department of Energy, and
Lawrence Livermore National Laboratory,
2. Reporting Period: Month _____ Year _____
3. Circle dates treated waste ground water discharged to land
by irrigation: 1 2 3 4 5 6 7 8 9 10 11 12 13
14 15 16 17 18 19 20 21 22 23 24 25 26 27 28
29 30 31
4. Total flow volume for reporting month: _____ gallons
5. Estimated recharge:
6. Weather conditions:
Average Air _____ Total _____ Wind _____
Temperature _____ Precip _____ Velocity _____
7. Required weekly land observations, as 'yes' or 'no', for
weeks of reporting month:

- | | Weeks for Reporting Month |
|---|---------------------------|
| Date and Time | |
| Escape waste water,
as surface flow or
spray | |
| Evidence for ponding
or mosquito problem | |
| Odor from waste water | |
| Warning signs posted | |
| 8. If yes to any of above, a written report shall be submitted
as per section VII.1., Self-Monitoring Program. | |
| 9. I certify that the information in this report, to the best
of my knowledge, is true and correct. | |
| Inspector
Signature _____ | Date _____ |

Order No. 91-091

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION**

ORDER NO. 91-091
NPDES NO. CA0029289

RECEIVED

JUN 28 1991

WASTE DISCHARGE REQUIREMENTS FOR:

U.S. DEPARTMENT OF ENERGY
and
LAWRENCE LIVERMORE NATIONAL LABORATORY
LIVERMORE, ALAMEDA COUNTY

ENVIRONMENTAL PROTECTION DEPT.
ENVIRONMENTAL RESTORATION DIV

The California Regional Water Quality Control Board, San Francisco Bay Region, (hereinafter the Board) finds that:

1. Lawrence Livermore National Laboratories (LLNL) operates a research facility under contractual agreements with the U.S. Department of Energy (DOE). LLNL and DOE are both hereinafter referred to as dischargers. For the purposes of this Order, DOE will be responsible for compliance in the event that LLNL fails to comply with its requirements.
2. By a report dated April 1991, the dischargers have applied for a revision of their current waste discharge requirements to include groundwater disposal/recharge via an infiltration trench and injection wells. These requirements will be permitted under the National Pollutant Discharge Elimination System.
3. Hazardous materials have been used, stored, and disposed of on the property since it was first used by the federal government in the 1940's as a Naval Air Station, and later as a research for DOE and its predecessor, the U.S. Atomic Energy Commission.
4. Soil and groundwater beneath the site are polluted with chemicals and solvents that have either current or historical usage onsite. These pollutants include trichloroethylene, 1,1,1-trichloroethane, tetrachloroethylene, 1,1-dichloroethylene, 1,1-dichloroethane, carbon tetrachloride, and other halogenated and petroleum hydrocarbons.
5. Suspected sources of hazardous waste releases are from onsite landfills, spillage from outdoor storage facilities that existed throughout the site, leakage from underground storage tanks and pipelines, and past discharges to the LLNL storm drain system. Hazardous waste releases from current research or maintenance activities is not presently ongoing.
6. More than 300 monitoring wells have been installed by the dischargers, both onsite and offsite. Groundwater monitoring data indicate that the groundwater is polluted in several locations beneath the site and that a plume of polluted groundwater extends offsite from the southwest, flowing in a northwesterly direction.
7. Volatile organic compounds (VOCs) in the groundwater occur in large but relatively diffuse plumes that underlie about 85% of the LLNL site and cover a total of about 1.1 miles. VOC plumes are from 30 to 100 feet thick and are rarely found below a depth of 200 feet. VOCs have migrated offsite in two areas: about 2,500 feet west of Vasco Road onto private property and about 800 feet south of the South East Corner Area onto DOE property used by Sandia Laboratories.

8. ^{May 1, 1995} This permit covers several investigative and remedial activities that will generate treated groundwater as waste. These activities are proposed to be conducted in both onsite and offsite areas, and include:

Short Term Discharge

- a. Routine sampling - 3 to 5 well bore volumes removed from monitoring wells prior to obtaining regular groundwater samples for water quality analyses
- b. Well development - preparation of new monitoring wells
- c. hydraulic testing - 1 hour to 2 day pump tests

Long Term Discharge

- a. Pilot study pump test - long term pump test to develop remedial design criteria
- b. remedial treatment - subject to approval by EPA, but may consist of groundwater extraction and treatment prior to discharge at effluent limitations set by this Order.

- 9. Waste generated from routine sampling, well development, and hydraulic testing will reach flows ranging from approximately 800 to 40,000 gallons per day (gpd). These activities will most likely occur on an intermittent basis, but if all three activities are conducted simultaneously maximum flows may reach approximately 51,000 gpd.
- 10. Presently, two pilot study treatment facilities discharge about 180,000 gpd of treated wastewater. Of the 180,000 gallons, 144,000 will be discharged under separate Waste Discharge Requirements. When a permanent remedial alternative is selected by EPA, and it consists of groundwater extraction and treatment, remedial treatment may reach an anticipated total flow of approximately 504,000 gpd.
- 11. Treated waste groundwater will be discharged to the ground, to storm sewers which flow into Arroyo Seco or Arroyo Las Positas, or directly into the arroyos. When there is sufficient storm water flow in the arroyos, treated groundwater may flow through Alameda Creek into San Francisco Bay north of the Dumbarton Bridge.
- 12. LLNL proposes to discharge treated waste groundwater to an infiltration trench west of Greenville Road in southern LLNL, and injections wells located 100 feet south of MW-441. The infiltration trench and injection wells will serve to expedite groundwater cleanup, hydraulically control existing VOC plumes, minimize anticipated water table decreases, and conserve groundwater resources.
- 13. The portion of the Livermore-Amador Valley groundwater basin which LLNL occupies, part of the Spring and Mocho I subbasins, is recognized as a groundwater recharge area in the San Francisco Bay Basin Plan and in technical reports submitted by the dischargers. One goal of this Order is to maximize retention of discharged groundwater within the Spring and Mocho I subbasins.

May 1, 1995

14. This Order will allow discharge of treated groundwater directly to the ground surface, into the surface drainage system (surface drainage channels, storm drains, Arroyo Seco, or Arroyo Las Positas), into an infiltration trench, or injection wells. Discharge from the pilot study treatment systems will be allowed under this permit until a permanent remedial alternative is selected by EPA.
15. The Board adopted a revised Water Quality Control Plan (Basin Plan) for the San Francisco Bay Region on December 17, 1986. The Basin Plan contains objectives and discharge prohibitions for the Livermore-Amador Valley and its subbasins.
16. The existing and potential beneficial uses for surface waters in the Livermore-Amador Valley groundwater basin including Arroyo Mocho, Arroyo Seco, Arroyo Las Positas, Arroyo de la Laguna and their tributaries are:
 - a. Contact and non-contact water recreation,
 - b. Wildlife habitat,
 - c. Groundwater recharge, and
 - d. Fish migration and spawning.
17. The existing and potential beneficial uses for groundwater underlying the Livermore-Amador Valley groundwater basins and its subbasins are:
 - a. Municipal and domestic supply,
 - b. Industrial supply,
 - c. Industrial service supply, and
 - d. Agricultural supply.
18. The Basin Plan prohibits discharge of wastewater which has "particular characteristics of concern to beneficial uses":
 - a. "at any point where the wastewater does not receive a minimal initial dilution of at least 10:1 or onto any nontidal water, dead-end slough, similar confined water, or any immediate tributary thereof", and
 - b. "to Alameda Creek (watershed) where no natural flow occurs."
19. The Basin Plan allows for exemptions to the prohibitions referred to in Finding 18 above when it can be demonstrated that a net environmental benefit can be derived as a result of the discharge.
20. LLNL's discharge can be exempt from the Basin Plan prohibition because it is an integral part of a program to clean up contaminated groundwater and thereby produces a net environmental benefit. Receiving water concentrations are expected to be below levels that would affect beneficial uses. Should studies indicate unanticipated chronic effects, the Board will review the requirements of this Order based upon Receiving Water Limitations B.1.e.
21. The Basin Plan prohibits discharge of "all conservative toxic and deleterious substances, above those levels which can be achieved by a program acceptable to the Board, to waters of the Basin." The dischargers' groundwater extraction and treatment system and associated operation, maintenance, and monitoring plan constitutes an acceptable control program for minimizing discharge of toxicants to waters of the State.

22. ^{May 1, 1995} Effluent limitations of this Order are based on the Basin Plan, State plans and policies, U.S. Environmental Protection agency guidance, and best engineering and geologic judgement as to the best available technology that is economically achievable.
23. The issuance of waste discharge requirements for this discharge is exempt from the provisions of Chapter 3 (commencing with Section 21100) of Division 13 of the Public Resources Code (CEQA) pursuant to Section 13389 of the California Water Code.
24. The Board has notified the dischargers and interested agencies and persons of its intent to reissue waste discharge requirements for the discharge and has provided them with the opportunity for a public hearing and an opportunity to submit their written views and recommendations.
25. The Board, in a public meeting, heard and considered all comments pertaining to the discharge.

IT IS HEREBY ORDERED that the dischargers; in order to meet the provisions contained in Division 7 of the California Water Code and regulations adopted thereunder, and the provisions of the Clean Water Act and regulations and guidelines adopted thereunder; shall comply with the following:

A. EFFLUENT LIMITATIONS

1. Any effluent discharged to the ground surface onsite shall:
 - a. not exceed 10,000 gallons per day,
 - b. be treated before discharge to meet concentrations of less than two times the action level for each compound specified by the California Department of Health Services, and
 - c. be less than 100 ppb of total volatile organic compounds.
2. The effluent at the point of discharge to Arroyo Seco, Arroyo Las Positas, surface drainage channels, storm drains, LLNL infiltration trench, or LLNL injection wells shall not contain constituents in excess of the following:

<u>Constituent</u>	<u>Unit</u>	<u>Instantaneous Maximum</u>
Metals		
Antimony	ug/l	1460
Arsenic	ug/l	20
Beryllium	ug/l	0.7
Boron	ug/l	7000
Cadmium	ug/l	5
Chromium, Total	ug/l	50
Chromium +6	ug/l	11
Copper	ug/l	20
Iron	ug/l	3000
Lead	ug/l	5.6
Manganese	ug/l	500
Mercury	ug/l	1
Nickel	ug/l	7.1
Selenium	ug/l	100

Silver	ug/l	23
Thallium	ug/l	130
Zinc	ug/l	58
<u>Volatile Organic Compounds (VOCs)</u>		
Benzene	ug/l	0.7
Tetrachloroethylene	ug/l	4
Vinyl Chloride	ug/l	2
Total VOCs	ug/l	5

Total VOCs include but are not limited to:

Benzene, Bromoform, Carbon Tetrachloride, Chlorobenzene, Chlorodibromomethane, Chloroethane, Chloroform, 1,1-Dichloroethane, 1,2-Dichloroethane, Ethylbenzene, Tetrachloroethylene, Toluene, trans-1,2-Dichloroethylene, 1,1,1-Trichloroethane, Trichloroethylene, trichlorofluoromethane, Xylene(s), and Vinyl Chloride.

Total Petroleum Hydrocarbons

As identified by modified

EPA Method 8015 ug/l 50

Ethylene Dibromide

As identified by

EPA Method 504 ug/l 0.02

Polynuclear Aromatic Hydrocarbons

Total, as identified by

EPA Method 610 or 625 ug/l 15

Base/Neutral Acid and Pesticide Compounds

Per constituent, as

identified by EPA

Method 610 or 625 ug/l 5

3. The pH of the discharge shall not exceed 8.5 nor be less than 6.5.
4. In any representative set of samples, the discharge of wastes shall meet the following limit of quality:

TOXICITY: The survival of test fishes acceptable to the Executive Officer in 96-hour bioassays of the effluent as discharged shall be a median of 90% survival and a 90 percentile value of not less than 70% survival.

B. RECEIVING WATER LIMITATIONS

1. The discharge of wastes shall not cause the following conditions to exist in waters of the State at any place:
 - a. floating, suspended, or deposited macroscopic particulate matter or foam;

- b. bottom deposits or aquatic growths;
 - c. alteration of temperature or apparent color beyond present natural background levels;
 - d. visible, floating, suspended, or deposited oil or other products of petroleum origin; and
 - e. toxic or deleterious substances to be present in concentrations or quantities which will cause deleterious effects on aquatic biota, wildlife, or water fowl, or which render any of these unfit for human consumption at levels created in the receiving water or as a result of biological concentrations.
2. The discharge of waste shall not cause the following limit to be exceeded in waters of the State within one foot of the water surface:
- pH: The pH shall not be depressed below 6.5 nor raised above 8.5, nor caused to vary from normal ambient pH levels by more than 0.5 pH units.
3. This discharge shall not cause a violation of any applicable water quality standard for receiving waters adopted by the Board or the State Water Resources Control Board as required by the Federal Water Pollution Control Act and regulations adopted thereunder. If more stringent applicable water quality standards are promulgated or approved pursuant to Section 303 of the Federal Water Pollution Control Act or amendments thereto, the Board will revise and modify this Order in accordance with the more stringent standards.


C. PROVISIONS

1. The dischargers shall comply with all sections of this Order immediately upon adoption. For the purposes of enforcing this Order, DOE shall be responsible for achieving full compliance with this Order within 60 days of the Executive Officer's determination that LLNL has failed to comply with the requirements of this Order.
2. The dischargers shall comply with the self-monitoring program as adopted by the Board and as may be amended by the Executive Officer.
3. Board Order 90-106 is hereby rescinded.
4. The dischargers shall notify the Board if the Self-monitoring program results indicate, or if discharge or any activity (to include all site investigation activity) has occurred or will occur which would result in the discharge of any toxic pollutant which is not limited by this Order.
5. Discharge of treated groundwater to the ground may occur only:
 - a. within LLNL legal site boundaries while conducting routine sampling, well development, or hydraulic testing.
 - b. if the total effluent volume does not exceed 10,000 gallons per day,

- c. if the total VOCs in the discharge do no exceed concentrations of two times the action level for each compound specified by the California Department of Health Services, or does not exceed the limit under Effluent Limitation A.1, and
 - d. in offsite areas while conducting routine sampling, well development, or hydraulic testing if it has been shown that the pumped water contains VOC concentrations less that those listed in Item a.2 and permission is obtained from the owners.
6. Discharge of treated waste groundwater to the storm sewers may occur only:
 - a. within LLNL legal site boundaries,
 - b. in offsite areas if the discharge point to a waterway can be identified, and a receiving water sample point is established (if the new discharge point is downstream from all existing receiving water sample points) as discussed under item I.C., Part B, Self-monitoring program.
 - c. for any investigative or remedial activity that generates effluent at all volumes, and
 - d. if the discharge complies with all Effluent Limitations.
7. Discharge of treated waste groundwater to the Arroyo Seco, Arroyo Las Positas, LLNL infiltration trench, or LLNL injection wells may occur only:
 - a. in offsite or onsite areas,
 - b. for any investigative or remedial activity that generates effluent at all volumes, and
 - c. if the discharge complies with all Effluent Limitations.
8. Total discharge from all pilot studies treatment systems shall not exceed 360,000 gallons per day. Discharge from the pilot studies will be allowed under this permit until a Record of Decision for final remediation has been reached.
9. Effluent generated from treatment Facility A shall not be discharged at any point of the arroyo that crosses or is upstream of the main body of the offsite plume unless the channel is lined to prevent infiltration from the point of discharge downstream through the body of the plume. Discharge from treatment Facility A will be managed under separate Waste Discharge Requirements.
10. Any discharge to a location other than the discharge point(s) specified in Provisions 5 through 7 of this Order, or discharge of any hazardous constituent, will require a modification of this Order or submission of a second NPDES application.
11. For additional injection wells, the dischargers must submit a report describing well locations, well construction, and other information to show that discharge from the additional wells have adequate hydraulic control and monitoring. This report shall be to the satisfaction of the Executive Officer.
12. The dischargers shall comply with all items of the attached "Standard Provisions & Reporting Requirements, and Definitions dated December, 1986 except items A.10, B.2, C.8, and C.11.

13. This Order expires June 18, 1996. The dischargers must file a report of waste discharge in accordance with Title 23, Chapter 3, Subchapter 9 of the California Administrative Code no later than 180 days in advance of such expiration date as application for issuance of new waste discharge requirements.
14. This Order is issued to the dischargers in support of investigation and cleanup activities undertaken pursuant to the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA), as amended. Pursuant to CERCLA, all response actions taken by the dischargers must be consistent with guidelines, rule regulations, and criteria developed by the EPA. Issuance of this Order does not constitute approval by the State of California or EPA for any response activities. This Order is meant to facilitate the investigation of the extent of pollution, the evaluation of potential remedies, and the initiation of any selected remedies by specifying the manner in which waste groundwater from investigation and cleanup activities may be discharged.
15. This Order shall serve as a National Pollutant Discharge Elimination System permit pursuant to Section 402 of the Clean Water Act or amendments thereto and shall become effective 10 days after the date of its adoption provided the Regional Administrator, EPA has no objection. If the Regional Administrator objects to its issuance, the permit shall not be effective until such objection is withdrawn.

I, Steven R. Ritchie, Executive Officer, do hereby certify that the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, San Francisco Bay Region on June 19, 1991.



Steven R. Ritchie
Executive Officer

Attachments:

- a. Standard Provisions & Reporting Requirements, Dec 1986
- b. Self-Monitoring Program

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION
DECEMBER 1986

STANDARD PROVISIONS AND REPORTING REQUIREMENTS

A. General Provisions

1. All Provisions and Reporting Requirements apply to all regulated discharges unless otherwise noted.
2. Neither the treatment nor the discharge of pollutants shall create a pollution, contamination, or nuisance as defined by Section 13050 of the California Water Code.
3. The discharger shall take all reasonable steps to minimize or prevent any discharge in violation of this order and permit which has a reasonable likelihood of adversely affecting public health or the environment, including such accelerated or additional monitoring as requested by the Regional Board or Executive Officer to determine the nature and impact of the violation. [40 CFR 122.41(d)]
4. All discharges authorized by this Order shall be consistent with the terms and conditions of this Order.
5. Pursuant to Environmental Protection Agency regulations the discharger must notify the Regional Board as soon as it knows or has reason to believe (1) that they have begun or expect to begin, use or manufacture of a pollutant not reported in the permit application, or (2) a discharge of toxic pollutants not limited by this permit has occurred, or will occur, in concentrations that exceed the limits specified in 40 CFR 122.42(a).
6. If a toxic effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is established under Section 307 (a) of the Clean Water Act, or amendments thereto, for a toxic pollutant which is present in the discharge authorized herein and such standard or prohibition is more stringent than any limitation upon such pollutant in a Board adopted Order, discharger must comply with the new standard or prohibition. The Board will revise or modify the Order in accordance with such toxic effluent standard or prohibition and so notify the discharger.
7. If more stringent applicable water quality standards are approved pursuant to Section 303 of the Clean Water Act, or amendments thereto, the discharger must comply with the new standard. The Board will revise and modify this Order in accordance with such more stringent standards.
8. The discharge of any radiological, chemical, or biological warfare agent waste is prohibited.

9. Solids storage prior to final disposal shall be maintained to minimize runoff, to prevent leaching, and shall comply with all requirements contained in Title 23, Chapter 3, Subchapter 15 of the California Administrative Code.
10. All facilities used for transport, treatment, or disposal of wastes shall be adequately protected against overflow or washout as the result of a 100-year frequency flood.
11. Collection, treatment, storage and disposal systems shall be operated in a manner that precludes public contact with wastewater, except where excluding the public is inappropriate, warning signs shall be posted.
12. Collected screenings, sludges, and other solids removed from liquid wastes shall be disposed of at a legal point of disposal, and in accordance with the provisions of Chapter 15 of Title 23 of the California Administration Code. For the purpose of this requirement, a legal point of disposal is defined as one for which waste discharge requirements have been prescribed or waived by a Regional Water Quality Control Board and which is in full compliance therewith.
13. This Order and Permit does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to the property of another, nor protect the discharger from liabilities under federal, state or local laws, nor create a vested right for the discharge to continue the waste discharge or guarantee the discharger a capacity right in the receiving water. [40 CFR 122.41(g)]
14. The Regional Board or its authorized representatives shall be allowed:
 - a. Entry upon premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of the order and permit;
 - b. Access to and copy at reasonable times any records that must be kept under the conditions of the order and permit;
 - c. To inspect at reasonable times any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under the order and permit; and
 - d. To photograph, sample, and monitor at reasonable times for the purpose of assuring compliance with the order and permit or as otherwise authorized by the Clean Water Act any substances or parameters at any locations. [40 CFR 122.41(i)]

15. This Order and Permit may be modified, revoked and reissued, or terminated in accordance with applicable State and/or Federal regulations. Cause for taking such action includes, but is not limited to any of the following:
 - a. Violation of any term or condition contained in the Order and Permit;
 - b. Obtaining the Order and Permit by misrepresentation, or by failure to disclose fully all relevant facts;
 - c. Endangerment to public health or environment that can only be regulated to acceptable levels by order and permit modification or termination; and
 - d. Any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
16. The filing of a request by the discharger for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition. [40 CFR 122.41(f)]
17. The discharger shall furnish, within a reasonable time, any information the Regional Board may request to determine whether cause exists for modifying, revoking and reissuing, or terminating the permit. The discharger shall also furnish to the Regional Board, upon request, copies of records required to be kept by its permit. [40 CFR 122.41(h)]
18. Bypass (the intentional diversion of waste streams from any portion of a treatment facility) is prohibited. The Regional Board may take enforcement action against the discharger for plant bypass unless:
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage. (Severe property damage means substantial physical damage to property, damage to the treatment facilities that causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production.);
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment down time. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and

- c. The permittee submitted advance notice of the need for a bypass to the Regional Board. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible at least 10 days before the date of the bypass. The permittee shall submit notice of an unanticipated bypass as required by 40 CFR 122.41(1)(6) (24 hour notice), as required in paragraph C.10.

The permittee may allow a bypass to occur that does not cause effluent limitations to be exceeded, but only if it is for essential maintenance to assure efficient operation. In such a case, the above bypass conditions are not applicable.

B. Treatment Reliability

1. The discharger shall, at all times, properly operate and maintain all facilities and systems of treatment disposal and control (and related appurtenances) which are installed or used by the discharger to achieve compliance with this order and permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. All of these procedures shall be described in an Operation and Maintenance Manual. The discharger shall keep in a state of readiness all systems necessary to achieve compliance with the conditions of this order and permit. All systems, both those in service and reserve, shall be inspected and maintained on a regular basis. Records shall be kept of the tests and made available to the Regional Board. [40 CFR 122.41(e)]
2. Safeguard to electric power failure:
 - a. The discharger shall, within ninety (90) days of the effective date of this permit, submit to the Regional Board for approval a description of the existing safeguards provided to assure that, should there be reduction, loss, or failure of electric power, the discharger shall comply with the terms and conditions of its Order. Such safeguards may include alternate power sources, standby generators, retention capacity, operating procedures or other means. A description of the safeguards provided shall include an analysis of the frequency, duration, and impact of power failures experienced over the past five years on effluent quality and on the capability of the discharger to comply with the terms and conditions of the Order. The adequacy of the safeguards is subject to the approval of the Regional Board.

- b. Should the Regional Board not approve the existing safeguards, the discharger shall, within ninety (90) days of having been advised by the Regional Board that the existing safeguards are inadequate, provide to the Regional Board and the Environmental Protection Agency a schedule of compliance for providing safeguards such that in the event of reduction, loss, or failure of electric power, the permittee shall comply with the terms and conditions of this permit. The schedule of compliance shall, upon approval of the Regional Board Executive Officer, become a condition of the Order.
 - c. If the discharger already has approved plan(s), the plan shall be revised and updated as specified in the plan or whenever there has been a material change in design or operation. A revised plan shall be submitted to the Regional Board within ninety (90) days of the material change.
3. POTW facilities subject to this order and permit shall be supervised and operated by persons possessing certificates of appropriate grade pursuant to Chapter 3, Subchapter 14, Title 23 of the California Administrative Code.
- C. General Reporting Requirements
1. All reports required by the order and permit and other information requested by the Regional Board or EPA Region 9 shall be signed by a principal executive officer or ranking elected official of the discharger, or by a duly authorized representative of that person. [40 CFR 122.22(b)]
 2. All reports signed by a duly authorized representative shall contain the following certification:

"I certify under penalty of law that this document and all attachments are prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who managed the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. [40 CFR 122.22(d)]
 3. Should the discharger discover that it failed to submit any relevant facts or that it submitted incorrect information in any report, it shall promptly submit the missing or correct information. [40 CFR 122.41(1)(8)]

4. Any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance shall be subject to enforcement procedures as identified in Section D of these Provisions.
5. This permit is not transferable to any person except after notice to the Regional Board. The Regional Board may require modification or revocation and reissuance of the permit to change the name of the permittee and incorporate such other requirements as may be necessary under the Clean Water Act.
6. Transfer of control or ownership of a waste discharge facility under an National Pollutant Discharge Elimination System permit must be preceded by a notice to the Regional Board at least 30 days in advance of the proposed transfer date. The notice must include a written agreement between the existing discharger and proposed discharger containing specific dates for transfer of responsibility, coverage, and liability between them. Whether an order and permit may be transferred without modification or revocation and reissuance is at the discretion of the Regional Board. If order and permit modification or revocation and reissuance is necessary, transfer may be delayed 180 days after the Regional Board's receipt of a complete application for waste discharge requirements and an NPDES permit.
7. The discharger shall file with the Board a report of waste discharge at least 120 days before making any material change or proposed change in the character, location or volume of the discharge.
8. The discharger shall file with the Board, for Executive Officer review and approval within ninety (90) days after the effective date of this Order, a technical report or a statement that the existing plan(s) was reviewed and updated, as appropriate, on preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. The technical report or updated revisions should:
 - a. Identify the possible sources of accidental loss, untreated or partially treated waste bypass, and polluted drainage. Loading and storage areas, power outage, waste treatment unit outage, and failure of process equipment, tanks and pipes should be considered.
 - b. Evaluate the effectiveness of present facilities and procedures and state when they became operational.
 - c. Predict the effectiveness of the proposed facilities and procedures and provide an implementation schedule containing interim and final dates when they will be constructed, implemented, or operational.

This Board, after review of the technical report or updated revisions, may establish conditions which it deems necessary to control accidental discharges and to minimize the effects of such events. Such conditions may be incorporated as part of this Order, upon notice to the discharger. If the discharger already has an approved plan(s) he shall update them as specified in the plan(s).

9. Reports of compliance or noncompliance with, or any progress reports on, interim and final compliance dates contained in any compliance schedule shall be submitted within 10 working days following each scheduled date unless otherwise specified within this order and permit. If reporting noncompliance, the report shall include a description of the reason for failure to comply, a description and schedule of tasks necessary to achieve compliance and an estimated date for achieving full compliance. A final report shall be submitted within 10 working days of achieving full compliance, documenting full compliance.
10. Twenty-four hour reporting:
 - (a) The permittee shall report any noncompliance that may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the permittee becomes aware of the circumstances. A written submission shall also be provided within five working days of the time the permittee becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times and, if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance.
 - (b) The following shall be included as information that must be reported within 24 hours under this paragraph:
 - (A) Any unanticipated bypass that exceeds any effluent limitation in the permit.
 - (B) Any upset that exceeds any effluent limitation in the permit.
 - (C) Violation of a maximum daily discharge limitation for any of the pollutants listed in this permit to be reported within 24 hours.
 - (c) The Regional Board may waive the above-required written report on a case-by-case basis.

11. All FOIWs must provide adequate notice to the Regional Board of:
 - (a) Any introduction of new pollutants into the POTW from an indirect discharger that would be subject to Sections 301 or 306 of the Clean Water Act if it were directly discharging those pollutants.
 - (b) Any substantial or material change in the volume or character of pollutants being introduced into that POTW by an input source at the time of issuance of the permit.

Adequate notice shall include information on the quality and quantity of influent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

D. Enforcement

1. The provision contained in this enforcement section shall not act as a limitation on the statutory or regulatory authority of the Regional Board.
2. Any violation of the permit constitutes violation of the California Water Code and regulations adopted thereunder and the provisions of the Clean Water Act, and is the basis for enforcement action, permit termination, permit revocation and reissuance, denial of an application for permit reissuance; or a combination thereof.
3. The Regional Board may impose administrative civil liability, may refer a discharger to the State Attorney General to seek civil monetary penalties, may seek injunctive relief or take other appropriate enforcement action as provided in the California Water Code or federal law for violation of Regional Board orders.
4. It shall not be a defense for a discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this order and permit.
5. A discharger seeking to establish the occurrence of any upset (See Definitions, E.23) has the burden of proof. A discharger who wishes to establish the affirmative defense of any upset in an action brought for noncompliance shall demonstrate, through properly signed contemporaneous operating logs, or other relevant evidence that:
 - a. an upset occurred and that the permittee can identify the cause(s) or the upset;
 - b. the permitted facility was being properly operated at the time of the upset;

- c. the permittee submitted notice of the upset as required in paragraph c.10.; and
- d. the permittee complied with any remedial measures required under A.3.

No determination made before an action for noncompliance, such as during administrative review of claims that noncompliance was caused by an upset, is final administrative action subject to judicial review.

In any enforcement proceeding, the permittee seeking to establish the occurrence of any upset has the burden of proof. [40 CFR 122.41(n)]

E. Definitions

- 1. Bypass means the intentional diversion of waste streams from any portion of treatment facility.
- 2. Daily discharge means:
 - a. For flow rate measurements, the average flow rate measured during a calendar day or during any 24-hour period reasonably representative of the calendar day for purposes of sampling.
 - b. For pollutant measurements, the concentration or mass emission rate measured during a calendar day or during any 24-hour period reasonably representative of the calendar day for purposes of sampling.
- 3. Daily Maximum Limit means the maximum acceptable daily discharge. For pollutant measurements, unless otherwise specified, the results to be compared to the daily maximum limit are based on composite samples.
- 4. DDT and Derivatives shall mean the sum of the p,p' and o,p' isomers of DDT, DDD (TDE), and DDE.
- 5. Duly authorized representative is one whose:
 - a. Authorization is made in writing by a principal executive officer or ranking elected official;
 - b. Authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity, such as general manager in a partnership, manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.); and

- c. Written authorization is submitted to the Regional Board and EPA Region 9. If an authorization becomes no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements above must be submitted to the Regional Board and EPA Region 9 prior to or together with any reports, information, or applications to be signed by an authorized representative.
6. Hazardous substance means any substance designated under 40 CFR 116 pursuant to Section 311 of the Clean Water Act.
7. HCH shall mean the sum of the alpha, beta, gamma (Lindane), and delta isomers of hexachlorocyclohexane.
8. Inadequately Treated Waste is wastewater receiving partial treatment but failing to meet discharge requirements.
9. Incompatible pollutants are:
 - a. Pollutants which create a fire or explosion hazard in the POTW;
 - b. Pollutants which will cause corrosive structural damage to the POTW, or wastewaters with pH lower than 5.0 pH units, unless the facilities are specifically designed to accommodate such wastewater;
 - c. Solid or viscous pollutants in amounts which will cause obstruction to the flow in the POTW resulting in interference;
 - d. Any pollutant, including oxygen-demanding pollutants (e.g., BOD) released into the wastewater system at a flow rate and/or pollutant concentration which will cause interference with the POTW.
 - e. Heat in amounts which will inhibit biological activity in the POTW and result in interference, or heat in such quantities that the temperature at the POTW treatment plant exceeds 40°C (104°F) unless the works is designed to accommodate such heat or the Regional Board approves alternate temperature limits.
10. Indirect discharger means a non-domestic discharger introducing pollutants into a publicly owned treatment and disposal system.
11. Initial dilution is the process which results in the rapid and irreversible turbulent mixing of wastewater with receiving water around the point of discharge.

12. Mass emission rate is obtained from the following calculation for any calendar day:

$$\text{Mass emission rate (lb/day)} = \frac{8.345}{N} \sum_{i=1}^N Q_i C_i$$

$$\text{Mass emission rate (kg/day)} = \frac{3.785}{N} \sum_{i=1}^N Q_i C_i$$

in which 'N' is the number of samples analyzed in any calendar day. 'Q_i' and 'C_i' are the flow rate (MGD) and the constituent concentration (mg/L), respectively, which are associated with each of the 'N' grab samples which may be taken in any calendar day. If a composite sample is taken, 'C_i' is the concentration measured in the composite sample and 'Q_i' is the average flow rate occurring during the period over which samples are composited. The daily concentration measured over any calendar day of all constituents shall be determined from the flow-weighted average of the same constituents in the combined waste streams as follows:

$$C_d = \text{Average daily concentration} = \frac{1}{Q_t} \sum_{i=1}^N Q_i C_i$$

in which 'N' is the number of component waste streams. 'Q' and 'C' are the flow rate (MGD) and the constituent concentration (mg/L), respectively, which are associated with each of the 'N' waste streams. 'Q_t' is the total flow rate of the combined waste streams.

13. Maximum allowable mass emission rate, whether for a 24-hour, weekly 7-day, monthly 30-day, or 6-month period, is a limitation expressed as a daily rate determined with the formulas in paragraph above, using the effluent concentration limit specified in the order and permit for the period and the specified allowable flow. (Refer to Section C of Part A of Self-monitoring Program for definitions of limitation period)
14. Overflow is defined as the intentional or unintentional spilling or forcing out of untreated or partially treated wastes from a transport system (e.g. through manholes, at pump stations, and at collection points) upstream from the plant headworks caused by excess flow in the transport system.
15. POTW means Publically Owned Treatment Works.

16. POTW Removal efficiency is expressed as the percentage of the ratio of pollutants removed by the treatment facilities to pollutants entering the treatment facilities. Removal efficiencies of a treatment plant shall be determined using monthly averages of pollutant concentration of influent and effluent samples collected at about the same time and using the following equation (or its equivalent):

$$\text{Removal Efficiency (\%)} = 100 \times [1 - (\text{Effluent Conc.} / \text{Influent Conc.})]$$

When preferred, the discharger may substitute mass loadings and mass emissions for the concentrations.

17. Priority pollutants are those constituents referred to in 40 CFR S122, Appendix D and listed in the EPA NPDES Application Form 2C, (dated 6/80) Items V-3 thru V-9.
18. Sludge means the solids, semi-liquid suspensions of solids, residues, screenings, grit, scum, and precipitates separated from, or created in wastewater by the unit processes of a treatment system. It also includes but is not limited to, all supernatant, filtrate, centrate, decantate, and thickener overflow/underflow in the solids handling parts of the wastewater treatment system.
19. Toxic pollutant means any pollutant listed as toxic under Section 307(a)(1) of the Clean Water Act or under 40 CFR S401.15.
20. Total Identifiable Chlorinated Hydrocarbons (TICH) shall be measured by summing the individual concentrations of DDT, DDD, DDE, aldrin, BHC, chlordane, endrin, heptachlor, lindane, dieldrin, PCBs and other identifiable chlorinated hydrocarbons.
21. Severe property damage means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass or overflow. It does not mean economic loss caused by delays in production.
22. Untreated waste is defined as raw wastewater.
23. Upset means an exceptional incident in which there is unintentional temporary noncompliance with effluent technology based permit limitations in the order and permit because of factors beyond the reasonable control of the discharger. It does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.

24. Waste, waste discharge, discharge of waste, and discharge are used interchangeably in this order and permit. The requirements of this order and permit are applicable to the entire volume of water, and the material therein, which is disposed of to surface and ground waters of the State of California.

Table 3
LAND OBSERVATIONS IN IRRIGATED AREAS
DISCHARGERS' SELF-MONITORING REPORT

1. Dischargers: U. S. Department of Energy, and
Lawrence Livermore National Laboratory,
2. Reporting Period: Month _____ Year _____
3. Circle dates treated waste ground water discharged to land
by irrigation: 1 2 3 4 5 6 7 8 9 10 11 12 13
14 15 16 17 18 19 20 21 22 23 24 25 26 27 28
29 30 31
4. Total flow volume for reporting month: _____ gallons
5. Estimated recharge:
6. Weather conditions:
Average Air _____ Total _____ Wind _____
Temperature _____ Precip _____ Velocity _____
7. Required weekly land observations, as 'yes' or 'no', for
weeks of reporting month:

	Weeks for Reporting Month
Date and Time	
Escape waste water, as surface flow or spray	
Evidence for ponding or mosquito problem	
Odor from waste water	
Warning signs posted	
8. If yes to any of above, a written report shall be submitted as per section VII.1., Self-Monitoring Program.	
9. I certify that the information in this report, to the best of my knowledge, is true and correct.	

Inspector
Signature _____ Date _____

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
SAN FRANCISCO BAY REGION**

**SELF-MONITORING PROGRAM
FOR:**

U.S. DEPARTMENT OF ENERGY

and

**LAWRENCE LIVERMORE NATIONAL LABORATORY
LIVERMORE, ALAMEDA COUNTY**

**NPDES NO. CA 0029289
ORDER NO. 91-091**

CONSISTS OF:

PART A, January 1987

and PART B, Adopted June 19, 1991

December 1986
Mod. SBTD 1/23/87

SELF-MONITORING PROGRAM
PART A

A. GENERAL

Basis

Reporting responsibilities of waste dischargers are specified in Sections 13225(a), 13267(b), 13268, 13383 and 13387(b) of the California Water Code and this Regional Board's Resolution No. 73-16 and the Environmental Protection Agency's Discharge Monitoring Report (Form 3320-1).

Purpose

The principal purposes of a monitoring program by a waste discharger, also referred to as self-monitoring program, are: (1) to document compliance with waste discharge requirements and prohibitions established by this Regional Board, (2) to facilitate self-policing by the waste discharger in the prevention and abatement of pollution arising from waste discharge, (3) to develop or assist in the development of effluent or other limitations, discharge prohibitions, national standards of performance, pretreatment and toxicity standards, and other standards, and (4) to prepare water and wastewater quality inventories.

B. SAMPLING AND ANALYTICAL METHODS

Sample collection, storage, and analyses shall be performed according to the 40 CFR 136 or other methods approved and specified by the Executive Officer of this Regional Board. (See Appendix E, attached)

Water and waste analyses shall be performed by a laboratory approved for these analyses by the State Department of Health Services (DOHS) or a laboratory waived by the Executive Officer from obtaining a certification for these analyses by the DOHS. The director of the laboratory whose name appears on the certification or his/her laboratory supervisor who is directly responsible for analytical work performed shall supervise all analytical work including appropriate quality assurance/quality control procedures in his or her laboratory and shall sign all reports of such work submitted to the Regional Board.

All monitoring instruments and equipment shall be properly calibrated and maintained to ensure accuracy of measurements.

C. DEFINITION OF TERMS

1. A grab sample is defined as an individual sample collected in a short period of time not exceeding 15 minutes. Grab samples shall be collected during normal peak loading conditions for the parameter of interest, which may or may not be during hydraulic peaks. It is used primarily in determining compliance with daily maximum limits and instantaneous maximum limits. Grab samples represent only the condition that exists at the time the wastewater is collected.
2. A composite sample is defined as a sample composed of individual grab samples mixed in proportions varying not more than plus or minus five percent from the instantaneous rate (or highest concentration) of waste flow corresponding to each grab sample collected at regular intervals not greater than one hour, or collected by the use of continuous automatic sampling devices capable of attaining the proportional accuracy stipulated above throughout the period of discharge for 8 consecutive or of 24 consecutive hours, whichever is specified in Table 1 of Part B.
3. A flow sample is defined as the accurate measurement of the average daily flow volume using a properly calibrated and maintained flow measuring device.
4. Duly authorized representative is one whose:
 - a. Authorization is made in writing by a principal executive officer or ranking elected official;
 - b. Authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity, such as general partner in a partnership, sole proprietor in a sole proprietorship, the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.)
5. Average values for daily and monthly values are obtained by taking the sum of all daily values divided by the number of all daily values measured during the specified period.
6. Daily Maximum limit is the total discharge in a calendar day for pollutants measured by mass or the average measurement obtained for other pollutants.
7. Instantaneous maximum is defined as the highest measurement obtained for the calendar day.
8. Median of an ordered set of values is that value below and above which there is an equal number of values, or which is the arithmetic mean of the two middle levels, if there is no one middle value

9. A 6-month median means a moving median of daily values for any 180 day period in which daily values represent flow-weighted average concentrations within a daily or 24-hour period. For intermittent discharges, the daily value shall be considered to equal zero for days on which no discharge occurred.

D. SPECIFICATIONS FOR SAMPLING AND ANALYSES

The discharger is required to perform sampling and analyses according to the schedule in Part B in accordance with the following conditions:

1. Influent

- a. Samples of influent shall be collected on varying days selected at random and shall not include any plant recirculation or other sidestream wastes. Deviation from this must be approved by the Executive Officer.

2. Effluent

- a. Samples of effluent shall be collected on days coincident with influent composite sampling unless otherwise stipulated. At least one sampling event/day shall be taken during major unit operation shutdown or startup. The Board or Executive Officer may approve an alternative sampling plan if it is demonstrated to the Board's satisfaction that expected operating conditions for the facility warrant a deviation from the standard sampling plan.
- b. Grab samples of effluent shall be collected during periods of maximum peak flows and shall coincide with effluent sample days.
- c. Fish bioassay samples shall be collected on days coincident with effluent sampling.
 - 1) Bioassay sample should be collected after chlorination, if chlorination is part of the treatment process. Bioassay test should be performed on dechlorinated samples. Dechlorination may be performed at the laboratory before testing.
 - 2) Total ammonia nitrogen shall be analyzed and un-ionized ammonia calculated whenever fish bioassay test results fail to meet the specified percent survival.
- d. If two consecutive samples of a constituent monitored on a weekly or monthly basis in a 30 day period exceed the effluent limit for any parameter, (or if the required sampling frequency is once per month and the monthly sample exceeds the limit), the sampling frequency shall be increased to daily until the additional sampling shows that the most recent three (3) days are in compliance.

- e. If any instantaneous maximum limit is exceeded, the discharge shall be terminated until the cause of violation is found and corrected.
- f. If the final or intermediate results of any single bioassay test indicate a threatened violation (i.e. the percentage of surviving test organisms is less than the required survival percentage), a new test will begin and the discharger shall investigate the cause of the mortalities and report the finding in the next self-monitoring report.
- g. Chlorine residual analyzers shall be calibrated against grab samples as frequently as necessary to maintain accurate control and reliable operation. If an effluent violation is detected, grab samples shall be collected at least every 30 minutes until compliance is achieved.
- h. When any type of bypass occurs, grab samples shall be collected on a daily basis for all constituents at all affected discharge points which have effluent limits for the duration of the bypass.

3. Receiving Waters

- a. Receiving water sampling shall be conducted on days coincident with sampling of effluent.
- b. Receiving water samples shall be collected at each station on each sampling day during the period within 1 hour following low slack water. Where sampling at lower slack water period is not practical, sampling shall be performed during higher slack water period. Samples shall be collected within the discharge plume and downcurrent of the discharge point so as to be representative, unless otherwise stipulated.
- c. Samples shall be collected within one foot below the surface of the receiving water body, unless otherwise stipulated.

E. Standard Observations

1. Receiving Water

- a. Floating and suspended materials of waste origin (to include oil, grease, algae, and other macroscopic particulate matter): presence or absence, source, and size of affected area.
- b. Discoloration and turbidity: description of color, source, and size of affected area.
- c. Odor: presence or absence, characterization, source, distance of travel, and wind direction.
- d. Evidence of beneficial water use: presence of water-associated waterfowl or wildlife, fishermen, and other recreational activities in the vicinity of the sampling stations.

e. Hydrographic condition:

- 1) Time and height of corrected high and low tides (corrected to nearest NOAA location for the sampling date and time of sample and collection).
- 2) Depth of water columns and sampling depths.

f. Weather condition:

- 1) Air temperatures.
- 2) Wind - direction and estimated velocity.
- 3) Precipitation - total precipitation during the previous five days and on the day of observation.

2. Wastewater Effluent

- a. Floating and suspended material of waste origin (to include oil, grease, algae, and other macroscopic particulate matter): presence or absence.
- b. Odor: presence or absence, characterization, source, distance of travel.

3. Beach and Shoreline

- a. Material of waste origin: presence or absence, description of material, estimated size of affected area, and source.
- b. Beneficial use: estimated number of people sunbathing, swimming, waterskiing, surfing, etc.

4. Land Retention or Disposal Area

This applies both to liquid and solid wastes confined or unconfined.

- a. For each impoundment determine amount of the freeboard at lowest point of dikes confining liquid wastes.
- b. Evidence of leaching liquid from area of confinement and estimated size of affected area. (Show affected area on a sketch and volume of flow (gpm, etc.))
- c. Odor: presence or absence, characterization, source, and distance of travel.
- d. Estimated number of waterfowl and other water-associated birds in the disposal area and vicinity.

5. Periphery of Waste Treatment and/or Disposal Facilities

- a. Odor: presence or absence, characterization, source, and distance of travel.
- b. Weather condition: wind direction and estimated velocity.

F. RECORDS TO BE MAINTAINED

1. Written reports, strip charts, calibration and maintenance records, and other records shall be maintained by the discharger and accessible (at the waste treatment plant), and retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Board or Regional Administrator of the U.S. Environmental Protection Agency, Region IX. Such records shall show the following for each sample:
 - a. Identity of sampling and observation stations by number.
 - b. Date and time of sampling and/or observations.
 - c. Method of sampling (See Section C - Definition of Terms)
 - d. Type of fish bioassay test (96 hour static or flow-through bioassay)
 - e. Date and time that analyses are started and completed, and name of personnel performing the analyses.
 - f. Complete procedure used, including method of preserving sample and identity and volumes of reagents used. A reference to a specific section of Standard Methods is satisfactory
 - g. Calculations of results.
 - h. Results of analyses and/or observations.
2. A tabulation shall be maintained showing the following flow data for influent and effluent stations and disposal areas:
 - a. Total waste flow or volume for each day.
 - b. Maximum and minimum daily flows for each month.
3. A tabulation reflecting bypassing and accidental waste spills shall be maintained showing information items listed in Sections F -1 and F-2 for each occurrence.

G. REPORTS TO BE FILED WITH THE REGIONAL BOARD

1. Spill Reports

If any hazardous substance is discharged in or on any waters of the state, or discharged and deposited where it is, or probably will be discharged in or on any waters of the state, the discharger shall report such a discharge to this Regional Board, at (415) 464-1255 on weekdays during office hours from 8 a.m. to 5 p.m., and to the Office of Emergency Services at (800) 852-7550 during non-office hours. A written report shall be filed with the Regional Board within five (5) working days and shall contain information relative to:

- a. nature of waste or pollutant,
- b. quantity involved,
- c. duration of incident,
- d. cause of spilling,
- e. Spill Prevention, Control, and Countermeasure Plan (SPCC) in effect, if any,
- f. estimated size of affected area,
- g. nature of effects (i.e., fish kill, discoloration of receiving water, etc.),
- h. corrective measures that have been taken or planned, and a schedule of these activities, and
- i. persons/agencies notified.

2. Reports of Plant Bypass, Treatment Unit Bypass and Permit Violation

In the event the discharger violates or threatens to violate the conditions of the waste discharge requirements and prohibitions or intends to permit a plant bypass or treatment unit bypass due to:

- a. Maintenance work, power failures, or breakdown of waste treatment equipment, or
- b. accidents caused by human error or negligence, or
- c. other causes, such as acts of nature,

The discharger shall notify the Regional Board office by telephone as soon as he or his agents have knowledge of the incident and confirm this notification in writing within 5 working days of the telephone notification. The written report shall include time, date, duration and estimated volume of waste bypassed, method used in estimating volume and person notified of the incident. The report shall include

pertinent information explaining reasons for the noncompliance and shall indicate what steps were taken to prevent the problem from recurring.

In addition, the waste discharger shall promptly accelerate his monitoring program to analyze the discharge at least once every day (Section D.2.h). Such daily analyses shall continue until such time as the effluent limits have been attained, until bypassing stops or until such time as the Executive Officer determines to be appropriate. The results of such monitoring shall be included in the regular Self-Monitoring Report.

3. The discharger shall file a written technical report to be received at least 30 days prior to advertising for bid (or 60 days prior to construction) on any construction project which would cause or aggravate the discharge of waste in violation of requirements; said report shall describe the nature, cost, and scheduling of all action necessary to preclude such discharge. In no case will any discharge of wastes in violation of permit and order be permitted unless notification is made to the Executive Officer and approval obtained from the Regional Board.

4. Self-Monitoring Reports

Written reports shall be filed regularly for each calendar month (unless specified otherwise) and filed no later than the fifteenth day of the following month. The reports shall be comprised of the following:

a. Letter of Transmittal:

A letter transmitting self-monitoring reports should accompany each report. Such a letter shall include:

- 1) Identification of all violations of waste discharge requirements found during the reporting period,
- 2) Details of the magnitude, frequency, and dates of all violations,
- 3) The cause of the violations, and
- 4) Discussion of the corrective actions taken or planned and the time schedule for completion. If the discharger has previously submitted a detailed time schedule for correcting requirement violations, a reference to the correspondence transmitting such schedule will be satisfactory.

Monitoring reports and the letter transmitting reports shall be signed by a principal executive officer or ranking elected official of the discharger, or by a duly authorized representative of that person.

The letter shall contain the following certification:

"I certify under penalty of law that this document and all attachments are prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who managed the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

b. Compliance Evaluation Summary

Each report shall be accompanied by a compliance evaluation summary sheet prepared by the discharger. The report format will be prepared following the example shown in APPENDIX A (attached). The discharger will prepare the format using those parameters and requirement limits for influent, effluent and receiving water constituents specified in the permit.

c. Map or Aerial Photograph

A map or aerial photograph shall accompany the report showing sampling and observation station locations.

d. Results of Analyses and Observations

Tabulations of the results from each required analysis specified in Part B by date, time, type of sample, detection limit and station, signed by the laboratory director. The report format will be prepared using the examples shown in APPENDIX B.

- 1) If the permittee monitors any pollutant more frequently than required by this permit using test procedures approved under 40 CFR Part 136 or as specified in this permit, the results of this monitoring shall be included in the calculation and reporting of the data submitted in the Self-Monitoring Report.
- 2) Calculations for all limitations that require averaging of measurements shall utilize an arithmetic mean unless otherwise specified in this permit.
- 3) The report shall also identify a table identifying by method number the analytical procedures used for analyses. Any special methods shall be identified and should have prior approval of the Board's Executive Officer.
- 4) Lab results shall be copied and submitted as an appendix to the regular report.

e. Influent and Effluent Data Summary

Summary tabulations of the data to include for each constituent total number of analyses, maximum, minimum, and average values for each period. The report format will be the NPDES Discharge Monitoring Report, EPA Form 3320-1. Flow data shall be included.

- 1) The original is to be submitted to EPA:

Regional Administrator
U.S. Environmental Protection Agency
Attention: Enforcement Division (W-5)
215 Fremont Street
San Francisco, CA 94105

- 2) with a copy to the Regional Board:

Executive Officer
California Regional Water Quality Control Board
San Francisco Bay Region
1111 Jackson Street, Room 6000
Oakland, CA 94607

f. List of Approved Analyses

- 1) Listing of analyses for which the discharger is approved by the State Department of Health Services.
- 2) List of analyses performed for the discharger by another approved laboratory (and copies of reports signed by the laboratory director of that laboratory shall also be submitted as part of the report).
- 3) List of "waived" analyses, as approved by the Executive Officer.

g. Flow Data

- 1) The tabulation pursuant to Section F-2.

5. Annual Reporting

By January 31 of each year, the discharger shall submit an annual report to the Regional Board covering the previous calendar year. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year. In addition, the report shall contain a comprehensive discussion of the compliance record and the corrective actions taken or planned which may be needed to bring the discharger into full compliance with the waste discharge requirements. The report format will be prepared by the discharger using the examples shown in APPENDIX C (attached) and should be maintained and submitted with each regular self-monitoring report.

PART B

U.S. DEPARTMENT OF ENERGY
and
LAWRENCE LIVERMORE NATIONAL LABORATORY
LIVERMORE, ALAMEDA COUNTY

I. DESCRIPTION OF STATIONS

A. INFLUENT

<u>Station</u>	<u>Description</u>
I-001	At a point in ground water extraction, collection, and treatment utilizing Treatment Facility A; immediately prior to treatment.
I-002	At a point in ground water extraction, collection, and treatment utilizing Treatment Facility B; immediately prior to treatment.
I-003	At a point in ground water extraction, collection, and treatment utilizing Treatment Facility C; immediately prior to treatment.
I-004 to I-XXX	At a point in groundwater extraction and treatment that uses a single or multiple well treatment system, immediately prior to treatment. These points will be assigned by the dischargers to all monitoring or extraction wells listed in Finding 8 of Board Order 91-XXX when such activities are initiated. Once assigned, each number will be used in all future extraction events for the same well.

B. EFFLUENT

<u>Station</u>	<u>Description</u>
E-001	At a point in ground water extraction and treatment using Treatment Facility A; immediately following treatment and prior to discharge to surface waters or drainage ways.
E-002	At a point in ground water extraction and treatment using Treatment Facility B; immediately following treatment and prior to discharge to surface waters or drainage ways.
E-003	At a point in ground water extraction and treatment using Treatment Facility C; immediately following treatment and prior to discharge to surface waters or drainage ways.
E-004 to E-XXX	At a point in groundwater extraction and treatment that uses a single or multiple well treatment system, immediately following treatment and prior to discharge onto the ground site storm drain systems, surface waters, drainage ways, or injection wells. These points will be assigned by the dischargers to all monitoring or extraction wells listed in Finding 8 and provisions 5 to 7 of Board Order 91-XXX when such activities are initiated. Once assigned, each number will be used in all future extraction events for the same well.

C. RECEIVING WATERS

<u>Station</u>	<u>Description</u>
R-001	At a point in the north flowing drainage ditch east of Vasco Road, between 50 and 100 feet downstream from the effluent discharge point for Treatment Facility B.
R-002	At a point in Arroyo Seco between 50 and 100 feet downstream from the effluent discharge point for Treatment Facility C.
R-003 to R-XXX	At a point in Arroyo Las Positas, Arroyo Seco, or any surface drainage way between 50 and 100 feet downstream from the effluent discharge point established by the dischargers

II. SCHEDULE OF SAMPLING AND ANALYSIS

The schedule of sampling and analysis is provided in Table 1.

III. MODIFICATIONS TO PART A

A. ADDITIONS

Add Section E.1.e.3) to read:

Stream gage height measurements and their conversion to stream flow measurements.

B. DELETIONS

Sections D.2.b., D.2.g., E.1.e.1), E.3., and E.4.

C. MODIFICATIONS

All items of Self Monitoring Program Part A, dated January 1987 shall be complied with except for the following modifications:

1. Section D.2.a. shall be changed to read as follows:

Samples of effluent shall be collected on days coincident with effluent grab samples unless otherwise stipulated. The Board or Executive Officer may approve an alternative sampling plan if it is demonstrated to the Board's satisfaction that expected treatment facility operation warrant a deviation from the standard sampling plan.

2. Section D.2.e. shall be changed to read as follows:

If the instantaneous maximum limit is exceeded, the sampling facility shall be increased to daily until two samples collected on consecutive days show compliance with the instantaneous maximum limit.

3. Section D.3.b. shall be changed to read as follows:

3. Section D.3.b. shall be changed to read as follows:

Receiving water samples shall be collected at each station on each sampling day. Samples shall be collected within the discharge plume and downcurrent of the discharge point so as to be representative, unless otherwise stipulated.

4. In Section F.1., the phrase:

"... shall be maintained by the dischargers and accessible (at the waste treatment plant) ..."

shall be changed to read as follows:

"... shall be maintained by the dischargers and accessible (at the dischargers' facility) ..."

5. Information requested in Section G.4.e. shall be prepared in a format similar to EPA form 3320-1 and shall be submitted to the EPA's Superfund Division rather than the Enforcement Division.

6. The Annual Report required in Section G.5. shall be submitted in place of the end of year monthly report.

I, Steven R. Ritchie, Executive Officer, hereby certify that the foregoing Self-Monitoring Program:

1. Has been developed in accordance with procedures set forth in this Regional Board's Resolution No. 73-16 in order to obtain data and document compliance with waste discharge requirements established in Regional Board Order No 91-091.
2. Was adopted by the Board on June 19, 1991, and
3. May be reviewed at any time subsequent to the effective date upon written notice from the Executive Officer or request from the dischargers, and revisions will be ordered by the Executive Officer or the Regional Board.


Steven R. Ritchie
Executive Officer

Attachments:

1. Table 1
2. Site Map

**TABLE 1
SCHEDULE FOR SAMPLING, MEASUREMENTS, AND ANALYSIS**

Sampling Station	1001- 1004- 1003, XXX		E001- E004- E003, EXXX		R001- R003- R002, RXXX															
	C	C	C	C	C	C														
PI OF SAMPLE	D	D	D	D	D	D														
Flow Rate (mgd)																				
Flow Rate, 20 C, or DOB (mg/l & kg/day)																				
Flow Rate, Residual & Flow (mg/l & kg/day)																				
Flow Rate, Soluble Matter (mg/l-hr. & cu. ft./day)																				
Total Suspended Matter (mg/l & kg/day)																				
Oil and Grease (mg/l & kg/day)																				
Sludge (Total or Total) (mg/100 ml) per mg/l																				
Survival 96-hr. (Surv.) in undiluted waste					0	0			2/X	2/X										
Ammonia Nitrogen (mg/l & kg/day)																				
Nitrate Nitrogen (mg/l & kg/day)																				
Nitrite Nitrogen (mg/l & kg/day)																				
Total Organic Nitrogen (mg/l & kg/day)																				
Total Phosphate (mg/l & kg/day)																				
Turbidity (Jackson Turbidity Units)					0	0			2/X	2/X										
pH (units)	M	M			M	M			M	M										
Dissolved Oxygen (mg/l and % Saturation)																				
Temperature (°C)					M	M			M	M										
Apparent Color (color units)																				
Secchi Disc (inches)																				
Sulfides (if DO < 5.0 mg/l) Total & Dissolved (mg/l)																				
Arsenic (mg/l & kg/day)	1/8	1/8			1/8	1/8			1/8	1/8										
Cadmium (mg/l & kg/day)										
Chromium, Total (mg/l & kg/day)										
Copper (mg/l & kg/day)										
Cyanide (mg/l & kg/day)										
Silver (mg/l & kg/day)										
Lead (mg/l & kg/day)										
Antimony, Beryllium, Boron, Iron, Manganese, Selenium, Thallium (mg/l & kg/day)										
Gross Alpha Particles, Gross Beta Particles, Tritium (pCi/l)					1/A	1/A			1/A	1/A										

**TABLE I (continued)
SCHEDULE FOR SAMPLING, MEASUREMENTS, AND ANALYSIS**

Station	1001-1004-1003		E001-E004-E003		R001-R003-R002		RXXX		RXXX	
	C	C	C	C	C	C				
OF SAMPLE										
kg/day)	I/S	I/S	I/S	I/S	I/S	I/S				
kg/day)				
kg/day)				
CONCENTRATIONS (kg/day)										
placable and Observations			Z	Z	Z	Z				
Sediment Analyses										
Observations										
Identifiable Chlorinated hydrocarbons (ng/l & kg/day)										
601 (ug/l & kg/l)	W/M	W/M	D/M	D/M		W/M	W/M			
624 (ug/l & kg/l)	I/A	I/A	I/A	I/A						
675 & 676 (ug/l & kg/l)	I/A	W/M	I/A	D/M		I/A	W/M			
Dissolved Solids & Solids (mg/l & kg/l)	O	O	O	O		O	O			

When EPA 624 is performed, it is not necessary to perform EPA 601

LEGEND FOR TABLE

TYPES OF SAMPLES

- C = grab sample
- 24 = composite sample - 24-hour
- C-X = composite sample - X hours (used when discharge does not continue for 24-hour period)
- Cont = continuous sampling
- DI = depth-integrated sample
- BS = bottom sediment sample
- O = observation

TYPES OF STATIONS


- I = intake and/or water supply stations
- A = treatment facility influent stations
- E = waste effluent stations
- C = receiving water stations
- P = treatment facilities perimeter stations
- L = basin and/or pond level stations
- S = bottom sediment stations
- G = groundwater stations

FREQUENCY OF SAMPLING

- Z = each occurrence
- M = once each hour
- D = once each day
- W = once each week
- M = once each month
- Y = once each year
- Daily for the first week, weekly thereafter
- W/M = Weekly for the first 4 weeks, monthly thereafter
- I/A = One sample during the first week of discharge, annually thereafter
- I/S = One sample during the first week of discharge, semi-annually thereafter

- 2/H = twice per hour
- 2/W = 2 days per week
- 5/W = 5 days per week
- 2/M = 2 days per month
- 2/Y = once in March and once in September
- Q = quarterly, once in March, June, Sept. and December

- 2H = every 2 hours
- 2D = every 2 days
- 2W = every 2 weeks
- 2M = every 2 months
- Cont = continuous

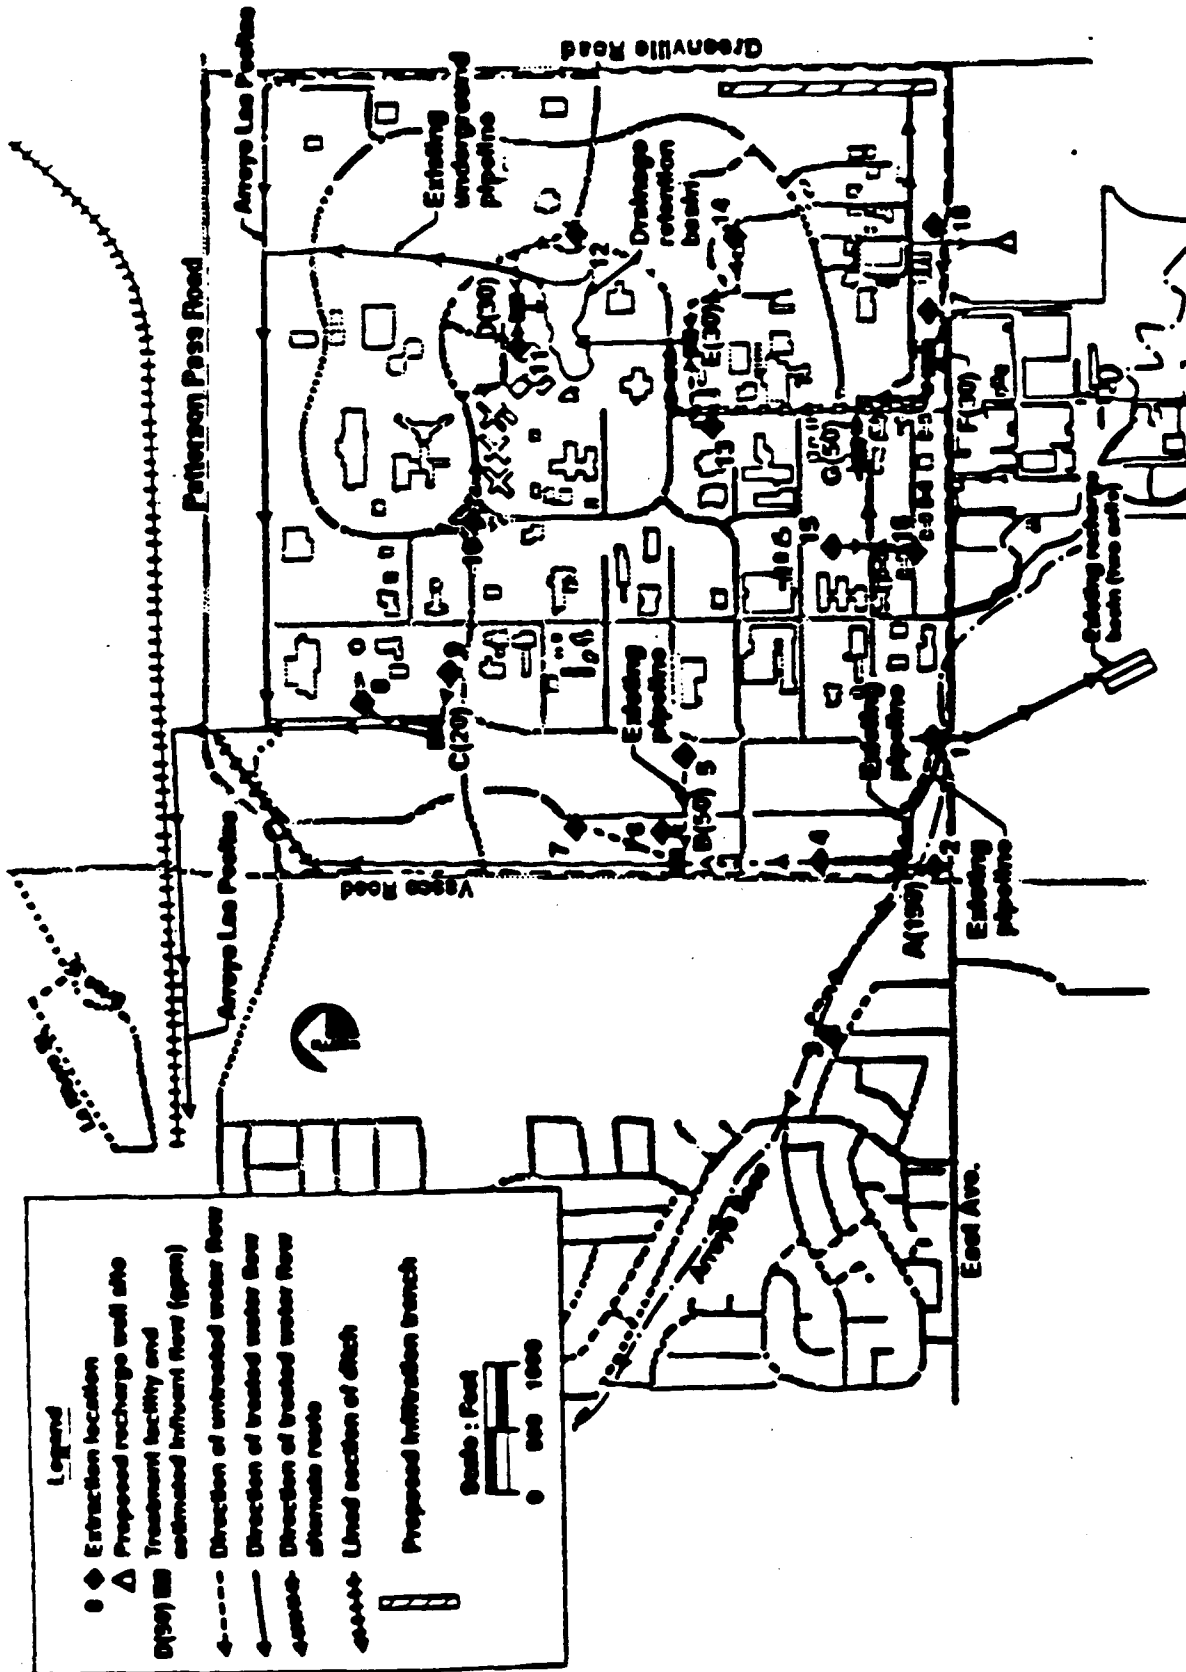

Preliminary ground water extraction and treatment facility locations (modified from Isherwood et al., 1990).

Appendix C

**Operations and Maintenance Quality
Assurance/Quality Control Plan**

Appendix C

Operations and Maintenance Quality Assurance/Quality Control Plan

C-1. Introduction

This QA/QC Plan has been developed in support of the O&M for TFG-1 and TFG-2 ground water remediation at the Livermore Site. This plan was prepared to meet the O&M requirements of TFG-1 and TFG-2 using the American Society of Mechanical Engineers (ASME) National Quality Assurance NQA-1, 1989 Edition, as a guideline.

The purpose of this plan is to define the quality objectives and areas of responsibility in accordance with the requirements of the O&M of TFG-1 and TFG-2.

C-2. Organization

This section documents the organizational structure, functional responsibilities, levels of authority, and lines of communications for those aspects of the O&M of TFG-1 and TFG-2 that affect quality.

Figure C-1 shows the organizational structure for QA activities. The descriptions below generally describe the QA responsibilities of those mainly involved in carrying out the QA program for the O&M of TFG-1 and TFG-2. The LLNL ERD Livermore Site Restoration Section Leader, the Quality Assurance Manager, the Remediation Engineer, and other individuals have the following responsibilities:

- The Livermore Site Restoration Section Leader (LSRSL) issues this QA plan and periodically reviews its implementation. The LSRSL may request an independent review or formal audit of the QA program.
- The Quality Assurance Manager (QAM) is responsible for the development and implementation of the QA plan, establishment and control of the QA document files, coordination with appropriate project personnel to assure compliance within groups over which the quality organization has no administrative control, and development of tracking and reporting systems to provide management visibility of implementation activities and results.
- The Remediation Engineer (RE) is responsible for overseeing facility startup and monitoring its performance and operations.
- The LLNL Plant Engineering Project Manager (PEPM) reports to the ERD LSRSL and RE. The PEPM is Plant Engineering's primary contact with ERD for each assigned project. Working as the project team leader, the PEPM is responsible for achieving the objectives of each specific project within the allocated budget and schedule while meeting the established performance criteria, as well as DOE, LLNL, and regulatory standards.

C-2

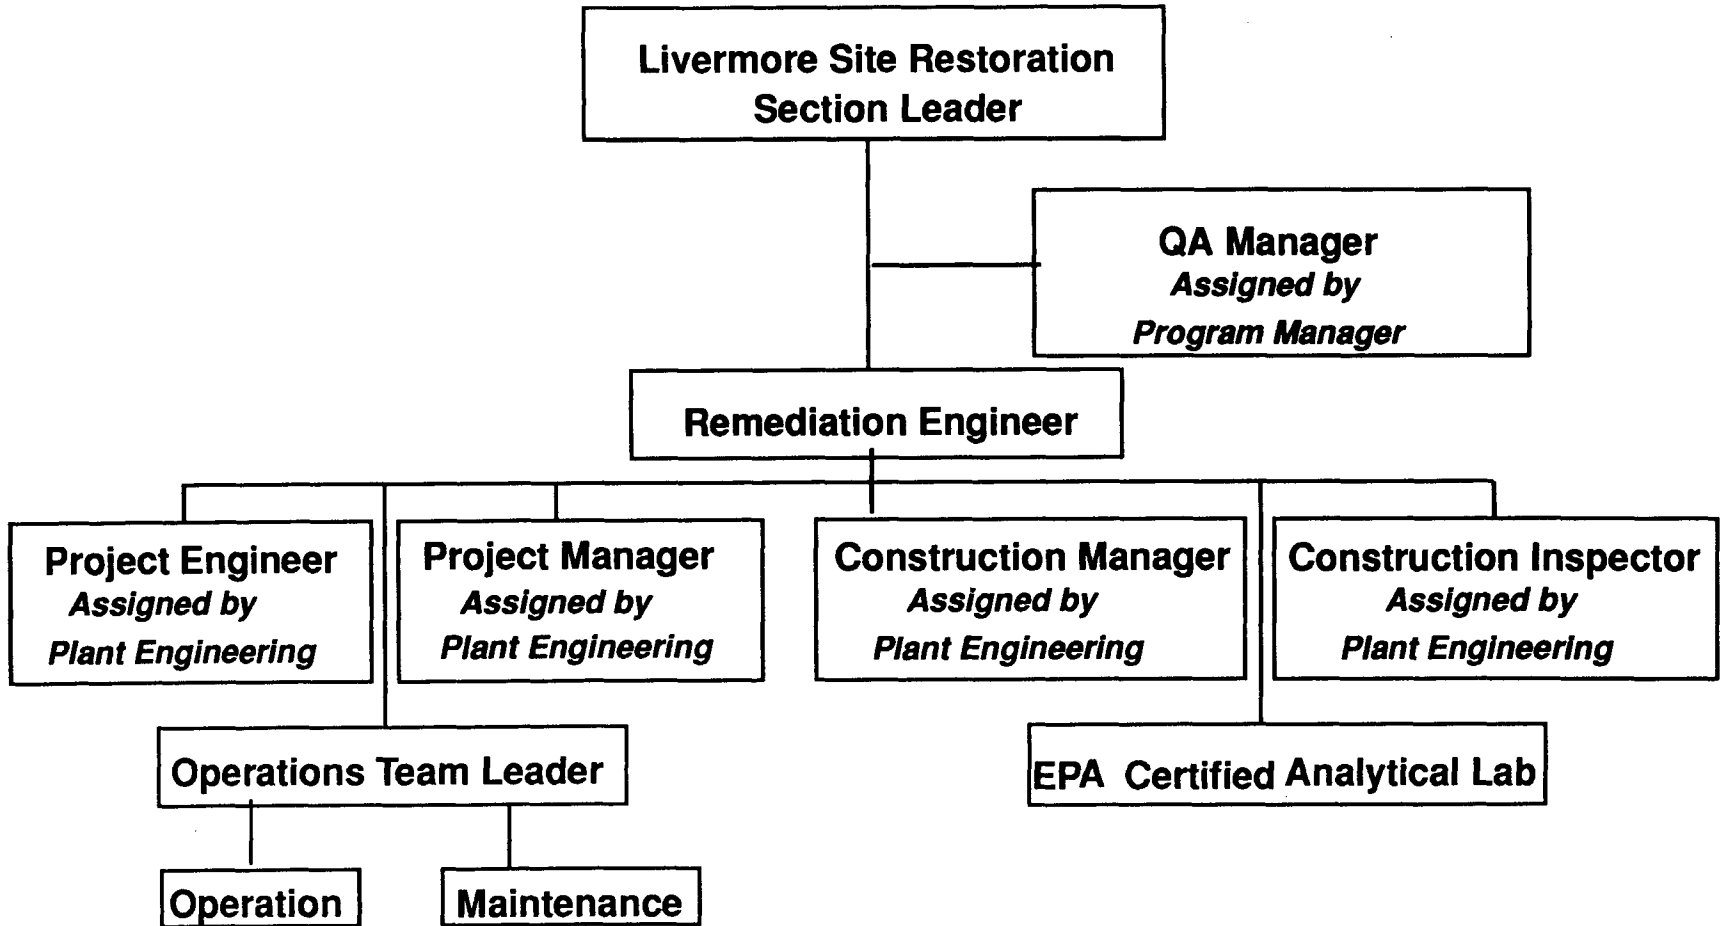


Figure C-1. Organization chart for operation and maintenance quality assurance/quality control for the B-518 Vapor Treatment Facility.

- The LLNL Plant Engineering Project Engineer (PEPE) performs the design or monitors and provides direction to engineers/architects with regard to design concepts, schedule, and budget. The PEPE reports operationally to the PEPM.
- The Construction Manager (CM) acts as the single point contact with construction subcontractors, and reports and advises on status, projected cost, and time of completion. Working in conjunction with the Construction Inspector, the CM protects LLNL's interest by assuring that all work is accomplished safely and in conformance with the contract documents. The CM reports operationally to the PEPM.
- The Construction Inspector (CI) will perform all inspector's duties as specified in the "Construction Inspector's Policy and Procedures Manual," the "Construction Manager Manual," and this QA plan. The CI is assigned to specific projects as the LLNL field representative, and provides quality control and status of all construction activities. The CI reports operationally to the CM.
- The Operations Team Leader (OTL) is responsible for the day-to-day maintenance and operation of ground water and soil treatment facilities. This includes scheduling required maintenance and ensuring that the maintenance requested is completed in a timely fashion.
- State Certified Analytical Laboratories using EPA methods are responsible for providing independent chemical analytical results on soil and ground water samples. For TFG-1 and TFG-2, these samples are submitted as part of the self-monitoring program required by LLNL's discharge permit, in addition to operational testing samples collected prior to the official operation of a facility and routine samples taken to evaluate facility performance.

C-3. Quality Assurance Program

This section covers objectives, quality goals, and QA levels. The procedures for the implementation of QA are included in the plan or cited in the list of codes, standards, and specifications (Table C-1).

The objectives of the project supported by this QA plan are to:

- Assure excellence in maintenance services and operations to achieve quality.
- Provide the QA requirements to meet all programmatic and institutional needs.

This QA plan defines the process for providing confidence that these QA objectives will be achieved and that achievement will include due consideration for health, safety, property, and the environment. Table C-2 shows a list of auditable records (including responsible personnel) that are required to document compliance with the requirements of this plan. Table C-3 shows the 18 elements of NQA-1 and their applicability to the Livermore Site Restoration Section activities.

Table C-1. Applicable Codes, Specifications, and Standards for O&M QA for TFG-1 and TFG-2.

<p>"LLNL Procurement Manual," Vol II, Books 1, 2, and Book 4 (Construction Subcontract Manual)</p> <p>"LLNL Plant Engineering Manual," Volumes 1-5, latest revision</p> <p>"LLNL Plant Engineering Drafting Manual," PEL-P-02065</p> <p>"Guidelines For In-House Design Reviews and Project Presentations," Frank Tokarz/ Roger Lake, Plant Engineering Department, Engineering/ Construction Division, LLNL, March 27, 1989 (with May 25, 1989 Rev.)</p> <p>"Construction Manager Manual, Subcontracted Construction Projects," Plant Engineering Department, LLNL, W. Kleck, January 1989</p> <p>"Construction Inspector's Policy and Procedures Manual," Plant Engineering Department, LLNL</p> <p>LLNL "Health and Safety Manual" (M010-May 1991)</p> <p>Electronics Engineering / Instrument Services Calibration and Certification Manual, LER 87-1007-99</p> <p>Quality Assurance Plan for Calibration Services, Engineering Measurements and Analysis Section, Engineering Sciences Division, M.E.</p> <p>LLNL Management Policy Memorandum MPM 02.2 "National Environmental Policy Act (NEPA) Compliance"</p> <p>DOE Order 4330.4A, Real Property Maintenance Management</p> <p>Plant Engineering (PE) QA Program Plan</p> <p>PE QA Manual PEL-P-01010</p> <p>LLNL Environmental Protection Handbook, issued by the Environmental Protection Department</p> <p>PE Policy and Operations Manual, PEL-P-01000</p> <p>PE Specifications, PEL-P-02075</p> <p>PE Maintenance and Operations QA Plan, M-078-30.6</p> <p>PE Maintenance and Operations Electric Utilities QA Plan, M-078-30.10</p> <p>PE Maintenance Services/Operations QA Plan, M-078-30.9</p> <p>PE Maintenance and Operations Utilities QA Plan, M-078-30.7</p> <p>PE Maintenance and Operations Maintenance Engineering and Production Control QA Plan, M-078-30.8</p> <p>PE Maintenance and Operations Electric Utilities QA Plan, M-078-30.10</p>
--

Table C-2. Required QA records.

QA files	QA record title	Person responsible
TFG1/G2-2-1	Personnel Training Records	QAM
TFG1/G2-3-1	Design Criteria	PEPE
TFG1/G2-3-2	Design Calculations	PEPE
TFG1/G2-3-3a	Design Changes	PEPE
TFG1/G2-3-3b	Specifications	PEPE
TFG1/G2-3-4a	Drawing List	PEPM
TFG1/G2-3-4b	Specifications List	PEPM
TFG1/G2-3-6	NEPA Compliance Documents	PEPM
TFG1/G2-4-1	Design or Construction Purchase Orders	PEPM
TFG1/G2-5	Work Performance and Facility Operations Log	OTL
TFG1/G2-6-1	As-Built Prints	CM
TFG1/G2-7-1	Notice of Completion	CM
TFG1/G2-9-1	Welder Certification	CI
TFG1/G2-9-2	Welding Test Reports	CI
TFG1/G2-9-3	Cemented Joints Test Reports	CI
TFG1/G2-10-1	Inspection Prints	CI
TFG1/G2-10-2	Final Inspection Report	CI
TFG1/G2-10-3	Final Acceptance Report	CI
TFG1/G2-18-1	Audit Requests and Reports	PEPM

Table C-3. Applicability of NQA-1 Elements to the Quality Assurance of TFG-1 and TFG-2.

NQA-1 requirement	Title	Applicable ?
Basic 1	Organization	Y
Supplement S-1	Terms and Definitions	Y
Supplement 1S-1	Supplementary Requirements for Organization	N
Basic 2	Quality Assurance Program	Y
Supplement 2S-1	Supplementary Requirements for the Qualification of Inspection and Test Personnel	N
Supplement 2S-2	Supplementary Requirements for the Qualification of Nondestructive Examination Personnel	N
Supplement 2S-3	Supplementary Requirements for the Qualification of Quality Assurance Program Audit Personnel	N
Supplement 2S-4	Supplementary Requirements for Personnel Indoctrination and Training	N
Basic 3	Design Control	Y
Supplement 3S-1	Supplementary Requirements for Design Control	N
Basic 4	Procurement Document Control	Y
Supplement 4S-1	Supplementary Requirements for Procurement Document Control	N
Basic 5	Instructions, Procedures, and Drawings	Y
Basic 6	Document Control	Y
Supplement 6S-1	Supplementary Requirements for Document Control	N
Basic 7	Control of Purchased Items and Services	Y
Supplement 7S-1	Supplementary Requirements for Control of Purchased Items and Services	N
Basic 8	Identification and Control of Items	Y
Supplement 8S-1	Supplementary Requirements for Identification and Control of Items	N
Basic 9	Control of Processes	Y
Supplement 9S-1	Supplementary Requirements for Control of Processes	N
Basic 10	Inspection	Y
Supplement 10S-1	Supplementary Requirements for Inspection	N
Basic 11	Test Control	Y
Supplement 11S-1	Supplementary Requirements for Test Control	N
Supplement 11S-2	Supplementary Requirements for Computer Program Testing	N
Basic 12	Control of Measuring and Test Equipment	Y

Table C-3. (Continued.)

NQA-1 requirement	Title	Applicable ?
Supplement 12S-1	Supplementary Requirements for Control of Measuring and Test Equipment	N
Basic 13	Handling, Storage, and Shipping	Y
Supplement 13S-1	Supplementary Requirements for Handling, Storage, and Shipping	N
Basic 14	Inspection, Test, and Operating Status	Y
Basic 15	Control of Nonconforming Items	Y
Supplement 15S-1	Supplementary Requirements for the Control of Nonconforming Items	N
Basic 16	Corrective Action	Y
Basic 17	Quality Assurance Records	Y
Supplement 17S-1	Supplementary Requirements for Quality Assurance Records	N
Basic 18	Audits	Y
Supplement 18S-1	Supplementary Requirements for Audits	N

C-4. Operations and Maintenance

C-4.1. Scope

TFG-1 and TFG-2 will operate to treat ground water containing VOCs. Prior to discharge to the storm sewer, the ground water will be treated to meet the requirements specified in California RWQCB WDR Order No. 91-091 (NPDES Permit No. CA 0029289). A table summarizing the effluent discharge requirements is presented in Section A.2 of Order No. 91-091 (Appendix B). If treated water was discharged to the Recharge Basin, it would be treated to meet the requirements specified in WDR Order No. 88-075, if approved by the RWQCB. A table summarizing the effluent discharge requirements is presented in Section B of Order No. 88-075 (Appendix B). Therefore, O&M activities at these facilities shall be controlled by quality procedures.

C-4.2. Operations

The LSRSL is responsible for ensuring the quality of operations at these facilities. The OTLs are responsible for ensuring that all field operations, including maintenance and operations, are performed with the appropriate quality procedures and are completed in a timely fashion. Each treatment facility, per their respective permits, has a required Self-Monitoring Program. This involves collecting water samples for submission to State-certified analytical laboratories for analysis by EPA methods. The results of these analyses are used by LLNL, EPA, RWQCB, and DTSC to monitor the performance of each treatment facility. The OTLs are responsible for ensuring that the technicians are properly trained to collect these samples according to documented procedures.

Each treatment facility has its own set of operating procedures. These procedures, which are being developed, cover the different modes of operation, including startup and shutdown, and are described in the TFG-1 and TFG-2 operating procedure manuals.

Daily operational logs are kept at each facility. These logs record the operating parameters of each system (i.e., temperature, pressure, etc.), the number and type of samples taken, all maintenance performed on the system, and all adjustments made by the operators to the system.

C-4.3. Maintenance

Two types of maintenance are performed at TFG-1 and TFG-2:

- Preventive.
- Corrective.

C-4.3.1. Preventive Maintenance

Preventive maintenance is performed on those components that need routine servicing and are part of systems related to quality. The preventive maintenance schedule is kept at each facility with the operations procedures for TFG-1 and TFG-2. The OTL is responsible for ensuring that the preventive maintenance items are scheduled and completed. Maintenance is performed by the LLNL Plant Operations and/or ERD personnel and follows the QA/QC manuals to ensure quality maintenance is performed.

TFG-1 and TFG-2 are treatment facilities designed to operate on a 24-hr-per-day, 7-day-per-week schedule. To keep these systems in continuous 24-hr operation, a preventive maintenance program is required.

Table C-4 is a tentative schedule of the preventive maintenance for TFG-1 and TFG-2, which includes an ion-exchange system, if necessary.

Table C-4. Preventive Maintenance for TFG-1 and TFG-2.

Action	Frequency/comments
Check all components and pipelines for leaks	Daily. If leaks are found, determine potential effects of leak and take appropriate action
Check prefilter packs 1 and 2	Daily. Pressure drop across filter greater than 2 pounds per square inch (psi) (maximum variation of 5 psi is allowable) indicates a need to change filters
Check air stripper trays for scale build-up (calcium carbonate deposits/iron scale)	Daily. Scale buildup requires system shutdown and lockout of power to the blowers and source well pumps. Remove and clean the trays at B-322, then replace in the air stripper
Sample effluent	Weekly. See WDR Order No. 91-091 (NPDES Permit No. CA 0029289) or WDR Order No. 88-075 (if used)
Clean organic debris from area surrounding the building	Weekly or when necessary. Notify the gardeners (Ext. 3-0495)

Table C-4. (Continued.)

Action	Frequency/Comments
Check for proper operation of eye wash and shower	Weekly. Open eye wash valve. Dust covers should pop off as water flows from eye wash ports, and water should spray up a minimum of 6 in.
Regenerate one of the two resin columns for the ion-exchange unit with 1 to 2 Molar sodium chloride (NaCl) (if an ion-exchange unit is used)	Every 12 days or as necessary based on monitoring. Regeneration is performed at Treatment Facility D (TFD)
Recharge the ion-exchange unit with approximately 500 gal of 1 to 2 molar NaCl (if an ion-exchange unit is used)	Every 12 days or as necessary based on monitoring. Recharging is performed at TFD
Remove waste 1 to 2 molar NaCl and hexavalent chromium (approximately 500 gal) from the ion-exchange unit (if an ion-exchange unit is used)	Every 12 days or as necessary based on monitoring. Performed at TFD
Top off the ion-exchange unit canisters at regular intervals (if an ion-exchange unit is used)	To be determined. Requires approximately 5 ft ³ per year
Shut down and clean out the built-up deposits of calcium bicarbonate or other precipitates in the ion-exchange unit tanks (if an ion-exchange unit is used)	As required
Replenish the hydrochloric acid or the carbon dioxide supply for the pH adjustment (if pH adjustment is used)	As required
Floor maintenance	As required. Contact custodians (Ext. 2-9744) to set up date for stripping and waxing of floors
Service blower motors on air stripper	Annually or as necessary. Motors and pumps to be serviced by Plant Engineering motor shop (Ext. 2-7751), B-511
Test interlock control system	Quarterly
Service well pumps	Annually
Service air stripper variable-speed discharge pump	Annually
Recertify flow sensors	Annually
Operationally verify and/or service level sensors	Annually
Service air compressor	Annually
Inspect miscellaneous hoses, seals, fittings, valves, etc.	Weekly
Replace GAC on air stripping vapor stream	As needed
Replace the entire resin charge for the ion-exchange unit (if an ion-exchange unit is used)	Every 5 years. Requires about 60 ft ³
Service the ion-exchange unit air-actuated valves (if an ion-exchange unit is used)	Every 5 years

C-4.3.2. Corrective Maintenance

Corrective maintenance is performed when a system component fails or is beginning to fail and the quality of facility operations could be compromised if operation continues. Root cause analyses are performed each time a component fails before the corrective maintenance action commences. This is to ensure that the nature of the problem is understood and can be prevented. This root cause analysis is also used to modify the preventive maintenance plan where appropriate. The results of the root cause analyses are documented in the daily facility operations log. As with preventive maintenance, corrective maintenance is performed by the plant operations personnel or ERD in accordance with their maintenance procedures and QA/QC plan.

All corrective maintenance actions and their times of completion are recorded in the facility daily operations log. Once complete, the specific component or system is started up and operated. This ensures that the maintenance is correctly performed and that system quality is maintained. An entry in the facility log is made, indicating that an operational check was made following preventive or corrective maintenance and the performance of the system's new component is noted. If successful, the system is allowed to resume normal operations.

The O&M manuals for TFG-1 and TFG-2, which are currently being developed, will indicate the required spare parts for system components that have relatively high risk of failure or require a long lead time to obtain. These components are to be maintained onsite to prevent extended shutdown of the treatment systems.

C-4.4. Drawing and Specification

The PEPM is responsible for preparing and updating complete drawing and specification lists. The lists shall include all drawings, specifications, and changes for purchase order (PO) contracts, labor only contracts, Job Orders, and Mechanical and Electronic Engineering Department drawings. This list will serve as the index for the QA print files and as the list of prints required in the QA files.

QA records to be filed as required in Table C-2:

(TFG1/G2-3-4a) A current and/or final copy of the drawing list.

(TFG1/G2-3-4b) A current and/or final copy of the specification list.

C-4.5. National Environmental Policy Act (NEPA)

The PEPM is responsible for assuring compliance with NEPA requirements. Completed documentation consists of LLNL Plant Engineering Form 1, NEPA Compliance Project Notification Form, and the NEPA Compliance Environmental Checklist. Memos to and from DOE and Environmental Impact Studies, as applicable, are evidence of NEPA compliance.

QA records to be filed as required in Table C-2:

(TFG1/G2-3-6) NEPA Compliance Documents.

C-5. Procurement

C-5.1. Procurement Contracts

Preparation and approval of PO contracts, when necessary for the purchase of equipment or services needed for maintenance, shall comply with standard LLNL purchasing policies.

QA records to be filed as required in Table C-2:

(TFG1/G2-4-1) Copy of all material and equipment POs over \$5,000.

C-5.2. Documents

The approval and control of procurement documents shall conform to LLNL Procurement Manual, Vol. II, Books 1, 2, and 4. The control and approval of maintenance construction drawings shall conform to LLNL Plant Engineering Drafting Manual, PEL-P-02065. Control, format, and approvals of specifications shall conform to Plant Engineering Standard PEL-P-02075 Specifications.

All drawings shall be approved for maintenance construction and have all applicable approval signatures before the bidding process, or, for LLNL construction, before the estimate process. Approvals of major changes to instructions, drawings, and specifications shall be the same as for the original issue.

Minor technical design changes made in the field shall be approved by the CM and the CI on the inspection print, and on the as-built drawings.

QA records to be filed (as required in Table C-2):

(TFG1/G2-6-1) One set of as-built prints for each project.

C-5.3. Control of Purchased Items and Services

Purchased items and services shall be controlled in accordance with standard LLNL Purchasing Policies. A Notice of Completion shall be prepared with all required LLNL signature approvals, and sent to the LLNL Procurement Department before contract close-out.

QA records to be filed (as required in Table C-2):

(TFG1/G2-7-1) Copy of the Notice of Completion for each project.

C-5.4. Handling, Storage, and Shipping

Items and materials shipped to LLNL shall be packaged, shipped, and stored according to instructions on drawings, specifications, contracts, and POs. The RE or OTL will perform a receiving inspection and/or the CI shall inspect incoming items and materials to identify any damage that may have occurred during shipping and storage.

Handling equipment, such as fork lifts and cranes, shall be operated, maintained, and tested in compliance with DOE and California State regulations. When LLNL equipment is used, compliance with the LLNL Health and Safety Manual is required.

Inspection reports are initiated and maintained per the CI's Policy and Procedures Manual. No additional QA records are required for the QA files.

C-5.5. Control of Nonconforming Items

The CI and CM shall maintain cognizance of salvage (rejected or damaged) materials and items (M&I), and arrange for segregation and prompt disposition of LLNL-supplied rejected M&I. The construction subcontractor shall be notified to immediately remove any rejected subcontractor-supplied M&I from LLNL. Any nonconformance that cannot be immediately corrected and verified by the CI shall be documented on a Deficiency Notice or punch list as applicable. Nonconformances to be dispositioned as "use as is" or "repair" (as opposed to rework) must be recorded on a Deficiency Report, approved and signed by the CM.

Inspection reports are initiated and maintained per the CI's Policy and Procedures Manual. No additional QA records are required for the QA files.

C-6. Maintenance Support

C-6.1. Identification and Control of Items

Material delivered to the job site is inspected to verify compliance with the approved submittals to assure that only correct and accepted items are used or installed.

The CM will request identification and inspection of items arriving at the construction site, when required. Acceptance of M&I not in conformance with requirements shall be approved by the LSRSL and PEPE, and shall comply with the LLNL Procurement Manual.

Inspection reports are initiated and maintained per the CI's Policy and Procedures Manual. No additional QA records are required for the QA files.

C-6.2. Inspection, Test, and Operating Status

The CI and CM shall maintain cognizance of incoming and stored M&I, and inspect or test them for conformance to requirements. When the CI or CM is concerned with maintaining identification of the status of a shipment of critical M&I, they shall tag them to ensure that untested or rejected items are not inadvertently used.

Lockout tags shall be tied on electrical equipment, lifts and hoists, valves, etc., where such items are unsafe to use, are uncertified, or to protect personnel working on the system.

Inspection reports are initiated and maintained per the CI's Policy and Procedures Manual. No additional QA records are required for the QA files.

C-6.3. Control of Processes

Procedures for welding, bonding, and other processes shall be called out in specifications or drawings, as required.

When required in construction specifications, bonded joints, welding tests, and inspections, welder certifications shall be verified by the CM and the CI, as required.

QA records to be filed (as required in Table C-2):

- (TFG1/G2-9-1) Welder certifications.
- (TFG1/G2-9-2) Welding test reports.
- (TFG1/G2-9-3) Cemented joints test reports.

C-6.4. Inspection

All maintenance work, and LLNL acceptances within the scope of this QA plan, including PO contract and labor only contract, are subjected to inspection. Work shall be inspected and documented according to the "Construction Inspector's Policy and Procedures Manual" and the "Construction Manager Manual." The inspection team shall delay progress payments to the subcontractor if the work is not in place, or is not up to contract quality.

During construction of modifications, the CI shall maintain a set of as-built marked prints to compare with the subcontractor's prints, and shall review and approve the subcontractor's prints.

After construction, the CI shall verify the accuracy of the as-built drawings in accordance with the CI's policy and procedures manual. The CI and PEPM shall indicate approval of the subcontractors marked up print by signing the as-built drawing.

QA records to be filed (as required in Table C-2):

- (TFG1/G2-10-1) All inspection prints, with copies of field memos, change orders, calculations, and sketches attached.
- (TFG1/G2-10-2) Final inspection report per Construction Manager Manual.
- (TFG1/G2-10-3) Final acceptance report per Construction Manager Manual.

C-6.5. Control of Measuring and Test Equipment

Certified testing laboratory subcontractors shall periodically calibrate measuring and test equipment used for LLNL work according to the requirements in the contract and according to Federal and State codes.

C-7. Activation of Measuring and Testing Equipment

All measuring and test equipment (M&TE) used in acceptance testing of electronic, monitoring, and interlocks systems and items shall be calibrated in accordance with the applicable LLNL calibration manual or plan. The individual conducting the test shall be responsible for assuring that all test equipment is calibrated and within its certification period.

The two major calibration laboratories at LLNL are the Engineering Measurements & Analysis Section, Mechanical Engineering (ME), and the Instrument Services Group, Engineering Services Division, Electronic Engineering (EE). The ME facility typically calibrates M&TE that make pressure, force, displacement, flow, humidity, acceleration, velocity, or temperature measurements. The EE facility services and calibrates M&TE that measures frequency, time, and electrical and magnetic measurements.

Calibration of M&TE may be performed by LLNL calibration laboratories or by outside vendors providing calibration services. Vendors providing calibration shall be required to meet the requirements of MIL-STD-45662, where necessary.

No additional QA records are required in QA files, but such records are filed in the EE and ME calibration facilities.

C-8. Quality Assurance Records

C-8.1. Quality Assurance Records

QA records shall be prepared, archived, and made readily available as evidence that TFG-1 and TFG-2 were specified, designed, constructed, operated, and maintained to meet the quality goals of this QA Plan. They shall be protected and maintained for a minimum of 6 months after completion of the project, prior to being microfilmed and archived for long-term storage.

The QA records specified by this plan do not include all the project records generated in the project. In addition to the QA records, there are microfilmed records are maintained by LLNL Plant Engineering, and contract records are maintained by the LLNL Procurement Department. Although these records are not defined as QA records, they are available for examination.

C-8.2. Filing Systems

QA records required by this plan shall be filed in lockable cabinets in the order given in Table C-2. Before filing, each record shall be numbered and titled according to Table C-2, and stamped with a black ink stamp:

QA RECORD

QA PLAN NO. X-XXX-XX

DATE: _____

A file drawer insert shall be set up and labeled for each file number, and each record shall be placed in a labeled folder or binder and kept in the QAM's office. QA records are not working files, and shall not be so utilized. If files are borrowed, a file checkout system shall be used to track record location and to ensure their prompt return.

C-8.3. Plant Engineering Records

In addition to the separate QA records file of this QA plan, the PEPM, PE, CM, and CI shall organize and maintain working engineering files for the project. These files are not QA records files; they are files normally kept when required for compliance or legal purposes. Records, as specified in the CM Manual and the Construction Inspector's Manual, shall be collected by the CM, CI, and the PEPE, and transmitted by the PEPM to the Standards and Documentation group of PE for microfilming. These files shall be preserved for a period of not less than 6 years after project completion.

C-9. Audits

The PEPM shall arrange for periodic independent audits of the implementation of this QA plan.

QA records to be filed:

(TFG1/G2-18-1) Audit requests and reports.

C-10. References

American Society of Mechanical Engineers (ASME), 1989, NQA-1, *Quality Assurance Program Requirements for Nuclear Facilities*, ASME NQA-1-1989 edition.

MIL-STD-45662, "Calibration System Requirements."

PEL-01000, "Plant Engineering Policy and Operations Manual."

Appendix D
Operations and Maintenance
Health and Safety Plan

Appendix D

Operations and Maintenance Health and Safety Plan

This Appendix contains the O&M HASP for TFG-1 and TFG-2.

D-1. Reason for Issue

Safety procedures are required to operate and maintain the air-stripping system, water filtering system, and ion-exchange unit (if needed) for TFG-1 and TFG-2. This HASP also serves as an administrative tool to summarize many of the requirements of the LLNL Health and Safety Manual that are pertinent to TFG-1 and TFG-2 O&M. This HASP supplements the vendor's operating instruction manuals for the ion-exchange unit (if installed).

D-2. Work to be Done and Location of Activity

D-2.1.

TFG-1, when constructed, will be located east of Building 212, and TFG-2 will be located west of the Building 321 Complex; both locations are in the south central portion of the Livermore Site.

D-2.2.

TFG-1 and TFG-2 are used to treat VOCs and possibly chromium. Ground water containing VOCs and chromium will be extracted from extraction wells utilizing submersible pumps generating from 10 to 20 gpm output.

D-2.3.

The influent passes through two 5-micron filters that have differential pressure gauges across them in the range of 0 to 25 psi.

D-2.4.

Water is forced to pass through an air-stripping tank to remove the VOCs. Acid, carbon dioxide, or other approved additives may be injected into the flow as needed to reduce the formation of precipitates or to achieve a pH within the discharge limits, if necessary.

D-2.5.

VOCs are removed from the water by injecting air into the bottom of the air stripper trays and subjecting the water to intense aeration.

D-2.6.

The effluent passes through an ion-exchange unit (to be installed if necessary) to reduce the concentration of hexavalent chromium at or below the 11 ppb discharge limit (detection limit is 10 ppb).

D-2.7.

The vapor from the stripping tank passes through demister pads to remove the water droplet fraction. The air stream then passes through vapor-phase GAC canisters that trap the VOCs.

D-3. Responsibilities

D-3.1.

Ed Folsom, phone number (510) 422-0389, LLNL pager number 02892, and home phone number (510) 490-7028, is responsible for the safety of this operation and for assuring that all work is performed in conformance with this HASP and applicable sections of the LLNL Health and Safety Manual and Environmental Protection Handbook. In the absence of the responsible individual, Sally Bahowick, phone number (510) 423-6773, LLNL pager number 05565, or Jerry Duarte, phone number (510) 423-2638, LLNL pager number 03180, shall assume these responsibilities.

D-3.2.

Any changes in operations that improve or do not significantly affect safety and environmental controls may be approved by the authorizing individuals in Section D-3.1, and the LLNL Environmental Safety & Health (ES&H) team leader. The responsible individual will ensure that this action is documented in a memorandum. Any changes in the operation that increase the hazard level, introduce additional hazards, or decrease safety shall not be made until a revision to this HASP has been reviewed and approved consistent with the review and approval process of the original HASP.

D-3.3.

Before starting operation, the responsible individual shall verify and document that the operating personnel have read and understand the HASP.

D-4. Hazard Analysis

D-4.1. Pressure Hazard

None is anticipated.

D-4.2. Chemical Hazard

If an ion-exchange unit is used, injury may occur from the unit to personnel exposed to the 1 to 2 Molar sodium chloride solution. Also, injury may occur to personnel exposed to the corrosive substances, such as hydrochloric acid, sodium hydroxide, or other chemicals if they are used to control scaling or pH.

D-4.3. Confined Space

Not applicable.

D-4.4. Noise Hazard

Injury may occur if continued exposure to the aeration system's blowers exceeds the recommended levels.

D-4.5. Electrical Hazard

If an ion-exchange unit is used, injury may occur if the unit panel door is open and contact is made with energized electrical components.

D-4.6. Seismic Hazard

Personnel may be injured during an earthquake due to falling equipment or missile hazards (equipment or materials moving energetically due to seismic forces).

D-5. Hazard Control

D-5.1. Chemical Hazard Control

If used, stored corrosives are doubly contained. Facility operators will follow Health and Safety Manual Sections 21 and 21.05.

D-5.2. Noise Hazard Control

D-5.2.1.

Noise protection is required in the aeration system blower room, if required by LLNL Industrial Hygiene personnel.

D-5.2.2.

The facility operator is required to follow noise safety precautions as outlined in the LLNL Health and Safety Manual, Section 10.08 and Supplement to 10.08.

D-5.3. Electrical Hazard Control

D-5.3.1.

An interlock system and panel doors with keyed locks prevent contact with energized electrical components. Keys to panel door locks are kept in a lock box in TFG-1 and TFG-2.

D-5.3.2.

All personnel will follow safety precautions as outlined in the Health and Safety Manual.

D-5.4. Seismic Hazard Control

Equipment will remain securely bolted inside the shipping container to avoid damage and injury during an earthquake. The shipping container will be secured to a level asphaltic concrete surface or a compacted aggregate-base pad.

D-6. Environmental Concerns and Controls

D-6.1.

Concern: Discharge of untreated ground water.

Controls:

- Interlocks will shut off the system and the flow of air and water if physical damage to the treatment system occurs (as discussed in Section 3.1.3 of the text).
- Scheduled sampling per discharge permit monitors discharge.
- Facility operator inspects the system daily.

D-7. Training

D-7.1.

Basic Facility Operators Courses:

Required:

- HS-0039—SARA/OSHA Training (40-hr course with yearly refreshers).
- HS-0001—New Employee Safety Orientation.

Recommended:

- HS-1620—Standard First Aid.
- HS-1640—Cardiopulmonary Resuscitation (CPR) (CPR certification valid for 1 year).
- HS-5300—Back Care Workshop.

D-7.2.

Facility Operator Courses:

Required:

- HS-4360—Noise Safety.
- HS-0006—Hazardous Waste Handling Practices.
- HS-5245—Lock and Tag Procedure (refresher training required whenever job assignments, equipment or processes that present new hazards, or the Energy Control Procedures change).

Recommended:

- HS-4150—Confined Space.
- HS-4240—Chemical Safety.
- HS-5220—Electrical Safety (required every 5 years).
- HS-5230—High Voltage Safety.

D-7.3.

Training courses identified in this section do not qualify a person to operate the treatment equipment and treatment systems located in treatment facilities TFG-1 and TFG-2. Only the responsible individual identified in Section D-3.1 of this HASP will determine if and when a person is qualified to operate the treatment facilities. Once qualified, each technician's personnel file is updated to reflect their status as a treatment facility operator.

D-7.4.

The responsible individual, or designee, shall ensure that all required training (including on-the-job training if applicable) is completed and documented. Untrained personnel may work under the supervision of a trained person until the required training is completed.

D-8. Maintenance

Items requiring periodic maintenance do not impact the safety of the operation.

D-9. Quality Assurance

Scheduled weekly, monthly, quarterly, and annual sampling of water at various parts in the system ensure compliance and quality.

D-10. Emergency Response Procedures

D-10.1.

In the event of an emergency, facility operations personnel will first dial "911" to report to the Emergency Dispatcher, then administer first aid if necessary to injured personnel. The Emergency Dispatcher uses reserved telephone lines to promptly relay the emergency call to the following members of the LLNL Emergency Response Team:

- Fire Department.
- Security Department.
- Hazards Control Safety Teams.
- Plant Engineering.
- Health Services.

The Emergency Response Team will go to the scene of the emergency immediately. During off-shift hours, the phone numbers of individuals to be notified in the event of an emergency are posted at TFG-1 and TFG-2. The LLNL Health and Safety Plan describes the emergency response procedures.

D-11. References

D-11.1.

Operating manual for the air stripper, and the ion-exchange unit (if installed).

D-11.2. Health and Safety Manual Sections

1. LLNL General Policies and Responsibilities
2. Work Planning and Safety Procedures
- 10.08 Hearing Protection
21. Chemicals
- 21.04 Facilities and Equipment
- 21.05 Handling Solid and Liquid Chemicals
- 23.00 Electricity

- 23.01 Introduction
- 23.02 Biological Effects of Electrical Hazards
- 23.03 Emergency Assistance and Rescue
- 23.04 Personal Protective Equipment
- 23.05 Design and Documentation Electrical Equipment
- 23.06 Training Requirements for Electrical Work
- 23.10 General Practices for Work on Electrical Equipment
- 23.13 Work on Other Electrical Apparatus and Systems
- 23.20 Clearances and Illumination for Electrical Enclosures
- 23.21 Power Disconnect Points
- 23.23 Extension Cords
- 23.30 Portable Electric Tools and Equipment
- 23.35 Power Supplies
- 23.36 Microwave and Electromagnet Sources
- 23.37 Electromagnets and Inductors
- 23.38 Batteries
- 23.39 Capacitors
- 26.14 Working in Confined Spaces

D-11.3. Electronics Engineering Department—Electrical Safety Policy, LED-61-00-01-A1A

D-11.4. Health and Safety Manual Supplements

- 11.07 Personnel Safety Interlocks
- 10.08 Noise—Its Measurements, Evaluation, and Control
- 26.13 General Lockout and Tagout Procedure
- 26.14 Working in Confined Spaces

D-11.45 Environmental Protection Handbook

D-12. Reviewers

The following are reviewers for this O&M HASP:

- Facility Supervisor.
- Section Head or Group Leader.
- Hazard Control Safety Team 4.
- Individual assigned responsibility for safety.
- Division/Department who authorized HASP.
- Supervisor of matrixed technical personnel.

Appendix E
TFG-1 and TFG-2 Sampling Procedures

Appendix E


TFG-1 and TFG-2 Sampling Procedures

Water samples will be collected prior to and following treatment, and prior to discharge to a storm drain and/or the Recharge Basin. Ground water discharged to a storm drain will be collected according to the schedule outlined in WDR Order No. 91-091 and presented in Table 11 of this report. Ground water discharged to the Recharge Basin will be collected according to the schedule outlined in WDR Order No. 88-075 and presented in Table 12, if approved by the RWQCB. Prior to collecting a sample, the office preparation procedures described in SOP No. 2.6— "Sampling for Volatile Organic Compounds" and SOP No. 4.2— "Sample Control and Documentation" will be followed (Rice *et al.*, 1990).

Samples will be collected from the TFG-1 and TFG-2 designated sampling stations shown on Figures 10 and 11. The influent and effluent samples will be collected by opening the valve at the sampling port and allowing water to flow through it for about 15 seconds. A bottle will be introduced into the flow stream and filled. If the bottle is not certified clean, it will be rinsed first with the water to be sampled. Any untreated water flowing through the valve during sampling will be captured with a bucket and returned to the system for treatment.

A specific sample container is used, depending on the analysis. In addition, some analyses require sample preservation. Such requirements for each analysis are described in SOP No. 4.3— "Sample Containers and Preservation" (Rice *et al.*, 1990). Samples are then packaged and shipped to a certified analytical laboratory according to SOP No. 4.4— "Guide to the Handling, Packaging, and Shipping of Samples" (Rice *et al.*, 1990).



Results of the treatment facility sampling are discussed in the self-monitoring section of *LLNL Livermore Site Ground Water Project Monthly Progress Reports*.

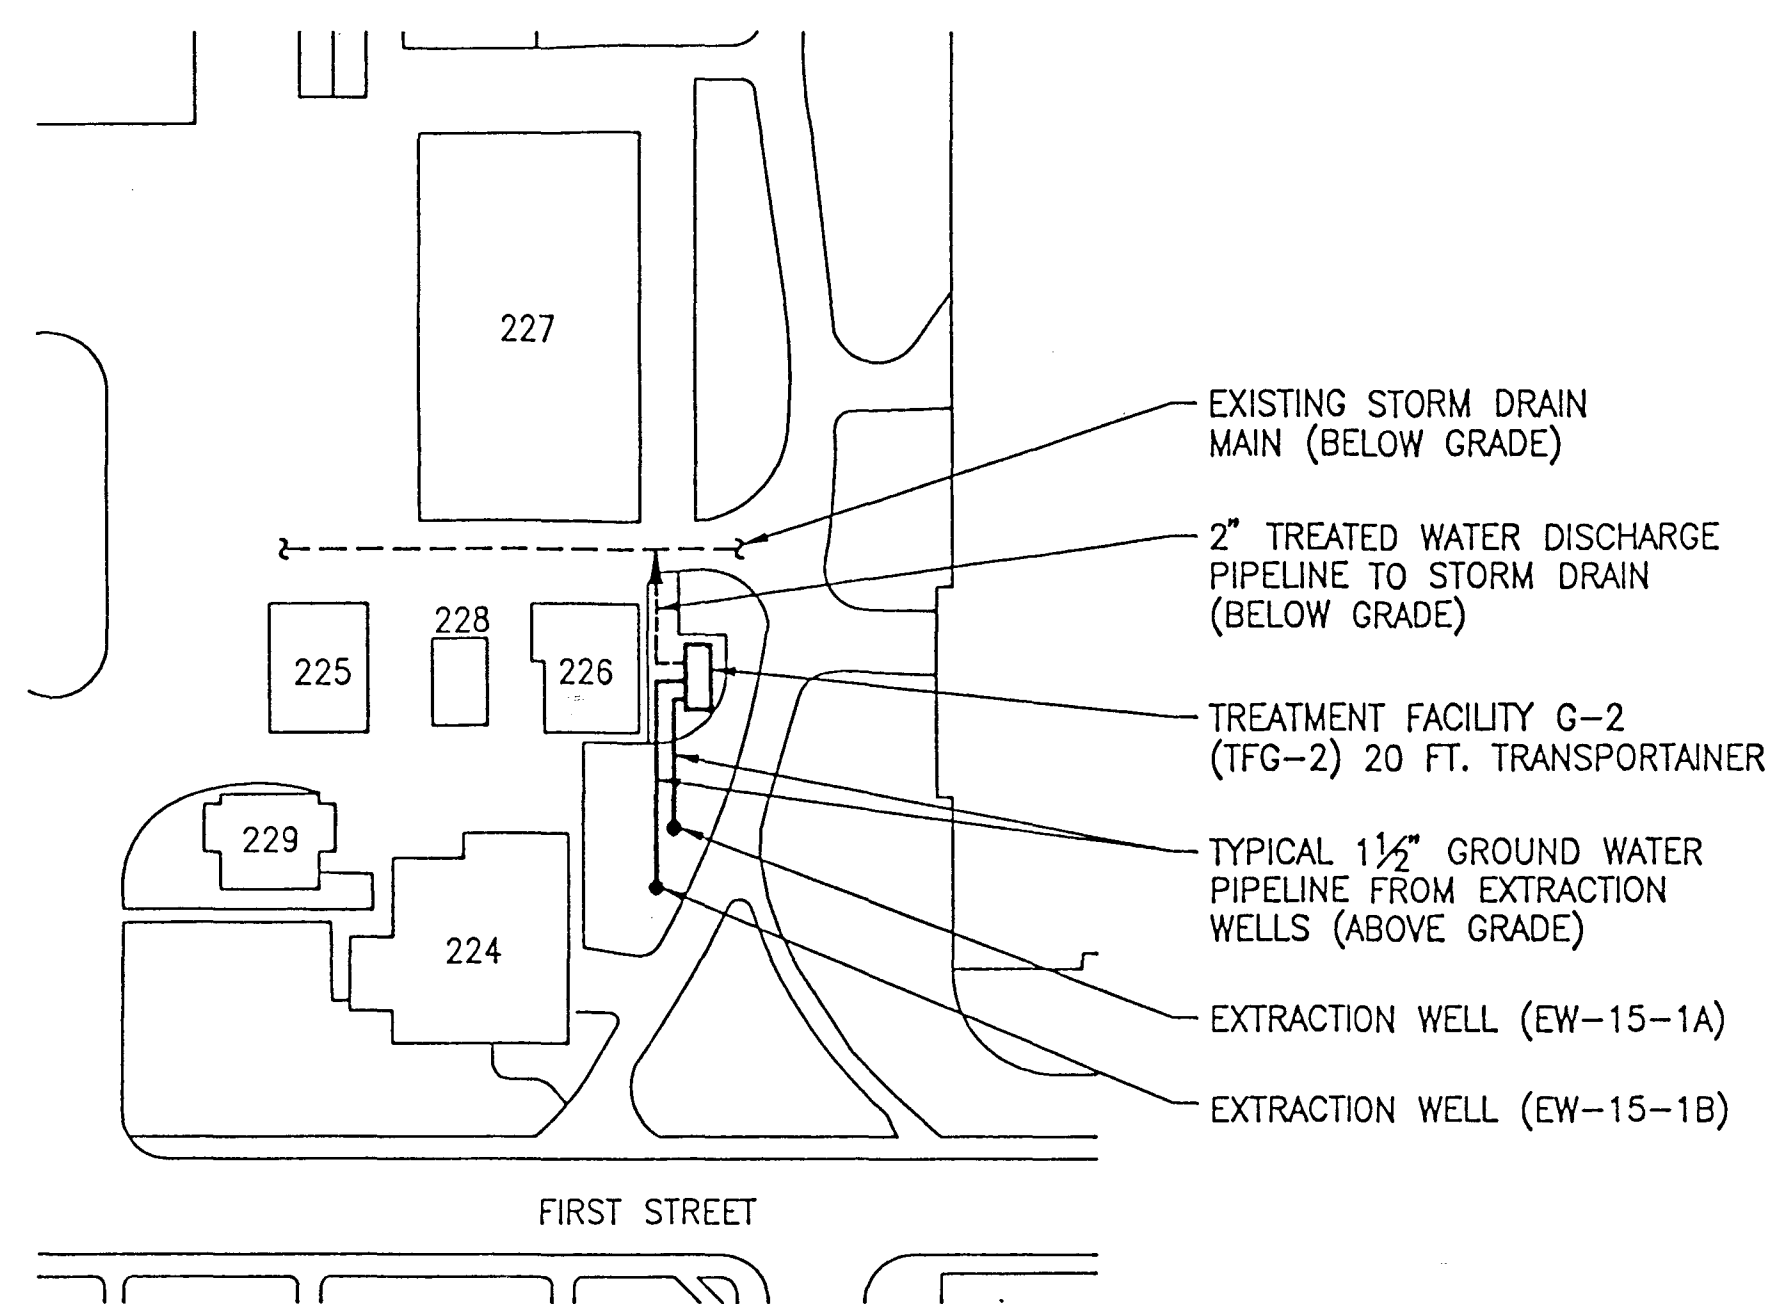

TFG-2 LOCATION PLAN

SCALE: 1" = 60'-0"

DO NOT REVISE THIS DRAWING
 PROPOSED MODIFICATIONS AND REVISIONS TO THIS DOCUMENT MUST BE SUBMITTED TO THE PLANT ENGINEERING FAST TRACK CADS GROUP. EXTENSION 3-4928
 DRAWING FILE NAME: TFG-PLATE1

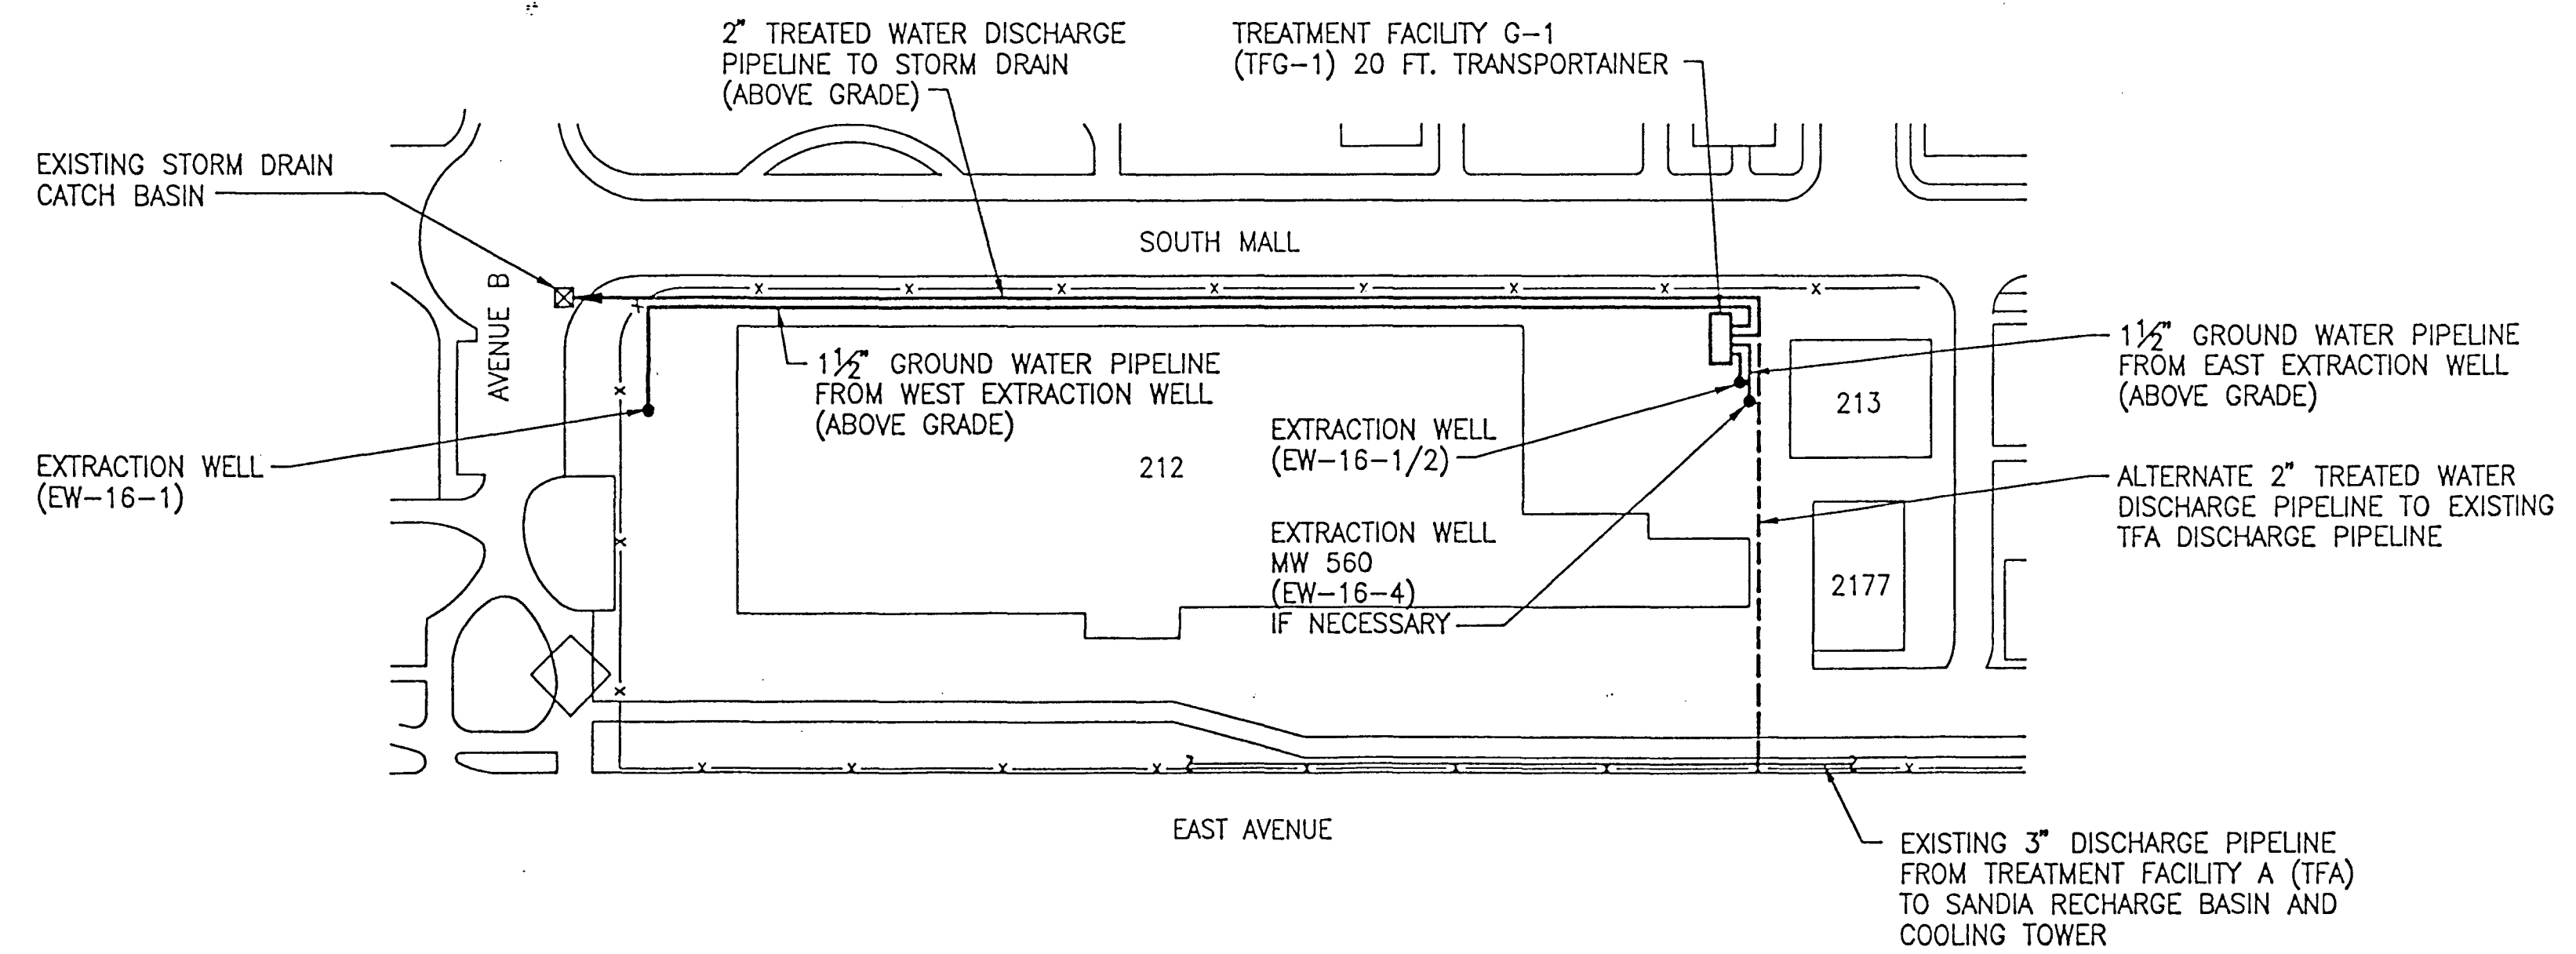

TFG-1 LOCATION PLAN

SCALE: 1" = 60'-0"

NO.	DATE	REVISION	BY	CHKED	DC	PE/A

DRAWING TITLE

LOCATION PLANS

Lawrence Livermore National Laboratory
 Plant Engineering
 Livermore, CA 94550


PROJECT TITLE **TREATMENT FACILITY TFG-1, TFG-2**

EST		
PM/CL		
PE/A		
SEC		
M/O		
H.C.		
DES	L. KITA	7/11/94
DWG	L. MONTERO	7/11/94
CHK	E. FOLSOM	10/26/94
GL		

STAMP SCALE: DATE

PFNID: SHEET NO.: OF: 2

DWG. NO.: **PLATE 1**

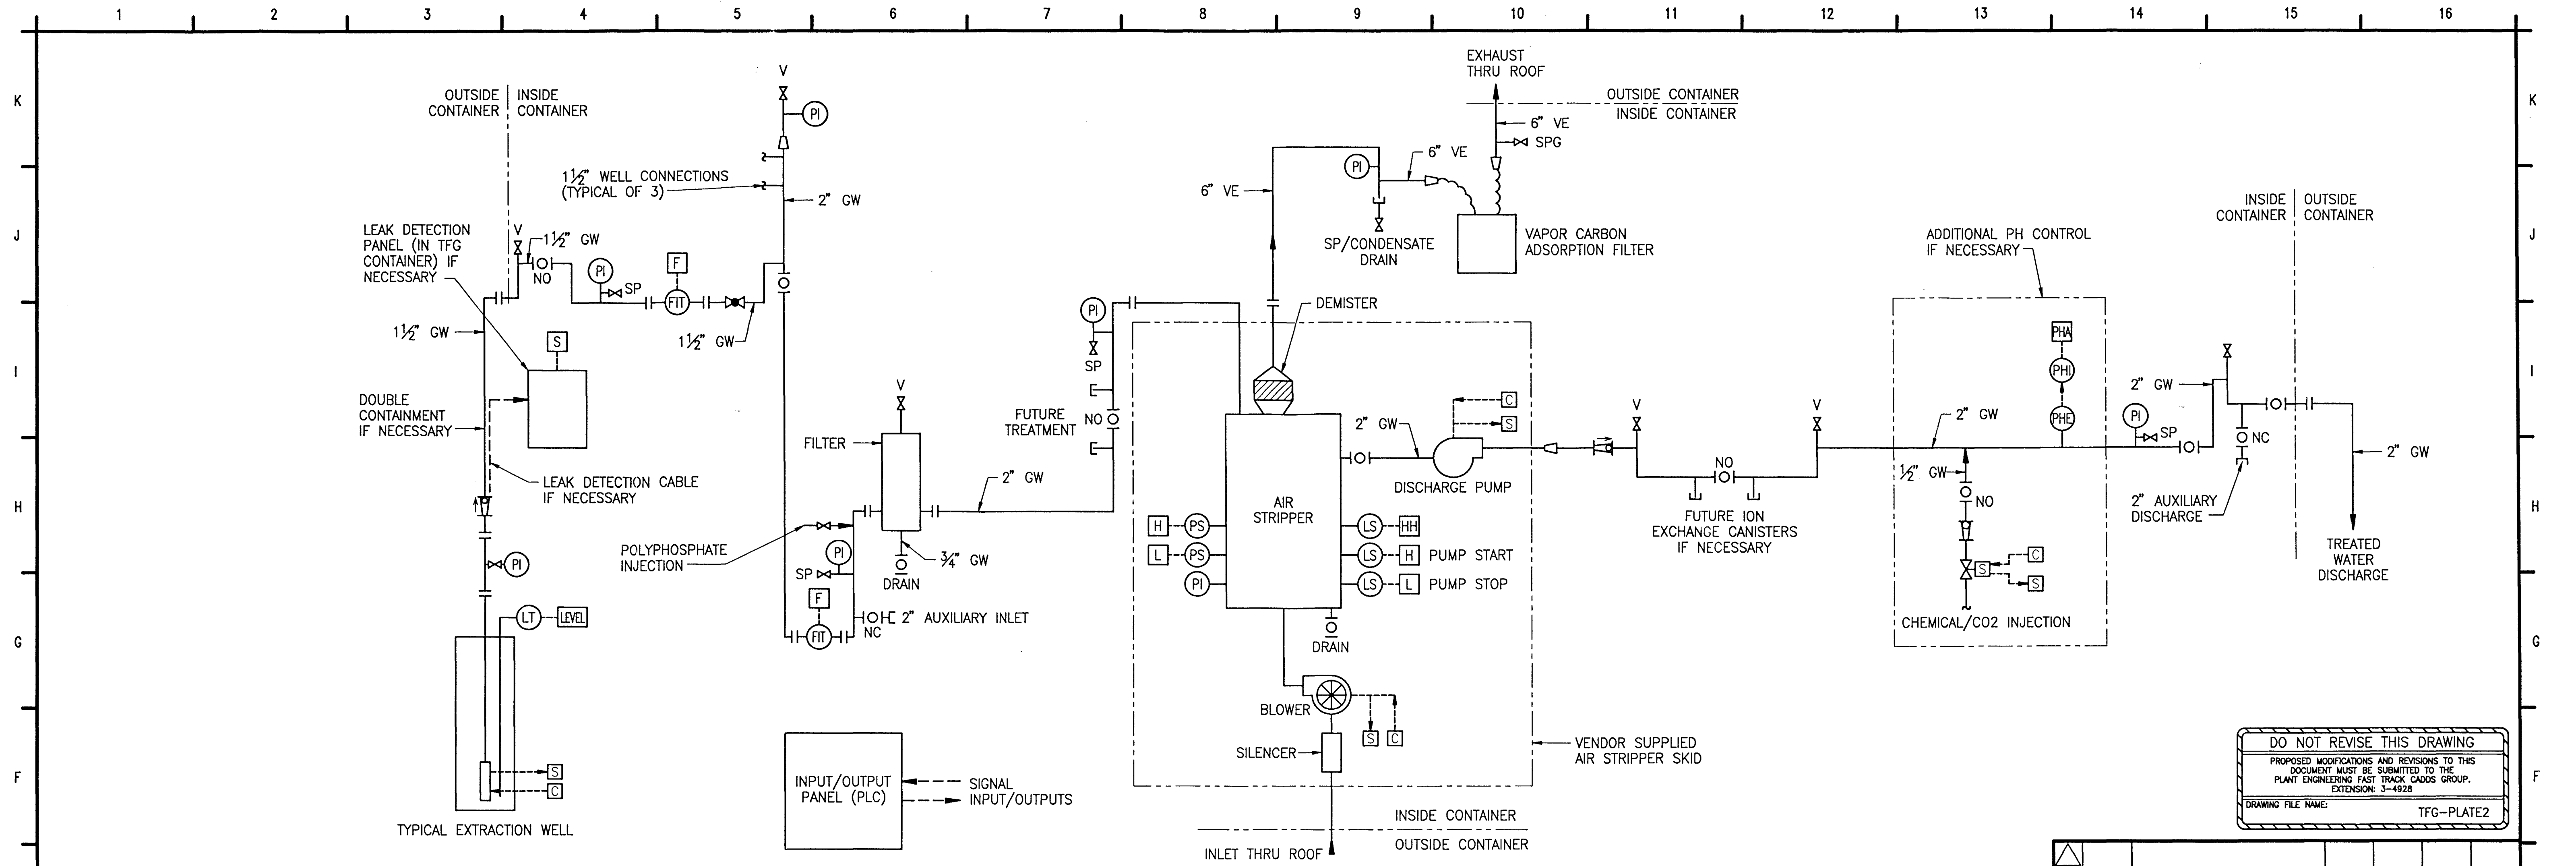

P & I D
SCALE: NONE

TFG-1 EXTRACTION WELLS	EW-16-1/2
	EW-16-1
	EW-16-4 (MW-560) IF NECESSARY
TFG-2 EXTRACTION WELLS	EW-15-1A
	EW-15-1B

CONTROL INPUTS/OUTPUTS

- [F] FLOW
- [HH] HIGH HIGH LEVEL
- [H] HIGH
- [L] LOW
- [PHA] PH ALARM
- [C] CONTROL
- [S] STATUS
- [LEVEL] LEVEL
- [] -- SIGNAL TO PLC

LEGEND

- [] BALL VALVE
- [] BALL CHECK VALVE
- [S] SOLENOID VALVE
- [] GLOBE VALVE
- SPG GAS SAMPLE POINT
- SP SAMPLE POINT
- [] PUMP
- [] BLOWER
- [] CONCENTRIC REDUCER
- [] PIPE FLANGE
- [] FLEXIBLE HOSE
- [FIT] FLOW INDICATING TRANSMITTER
- [LT] LEVEL TRANSMITTER
- [] EXTRACTION WELL PUMP
- [PDI] PRESSURE DIFFERENTIAL INDICATOR
- [LS] LEVEL SWITCH
- [PI] PRESSURE INDICATOR
- [PHE] PH SENSOR
- [PHI] PH INDICATOR
- [HS] HAND SWITCH
- GW GROUND WATER
- VE VAPOR EXHAUST
- V VENT (MANUAL VALVE)
- SP SAMPLE POINT
- SPG GAS SAMPLE POINT
- NO NORMALLY OPEN
- NC NORMALLY CLOSED

DO NOT REVISE THIS DRAWING
PROPOSED MODIFICATIONS AND REVISIONS TO THIS DOCUMENT MUST BE SUBMITTED TO THE PLANT ENGINEERING FAST TRACK GROUP. EXTENSION: 3-4928
DRAWING FILE NAME: TFG-PLATE2

NO.	DATE	REVISION	BY	CHKD	DC	PE/A
DRAWING TITLE						
P & I D						
Lawrence Livermore National Laboratory Plant Engineering Livermore, CA 94550						
PROJECT TITLE						
TREATMENT FACILITY TFG-1, TFG-2						
EST						
PM/CL						
PE/A						
SEC						
M/O						
H.C.						
DES L. KITA 7/11/94						
DWG L. MONTERO 7/11/94						
CHK E. FOLSOM 10/26/94						
GL						
STAMP						
SCALE: AS NOTED						
DATE						
PFNID:						
SHEET NO.: OF: 2						
DWG. NO.: PLATE 2						